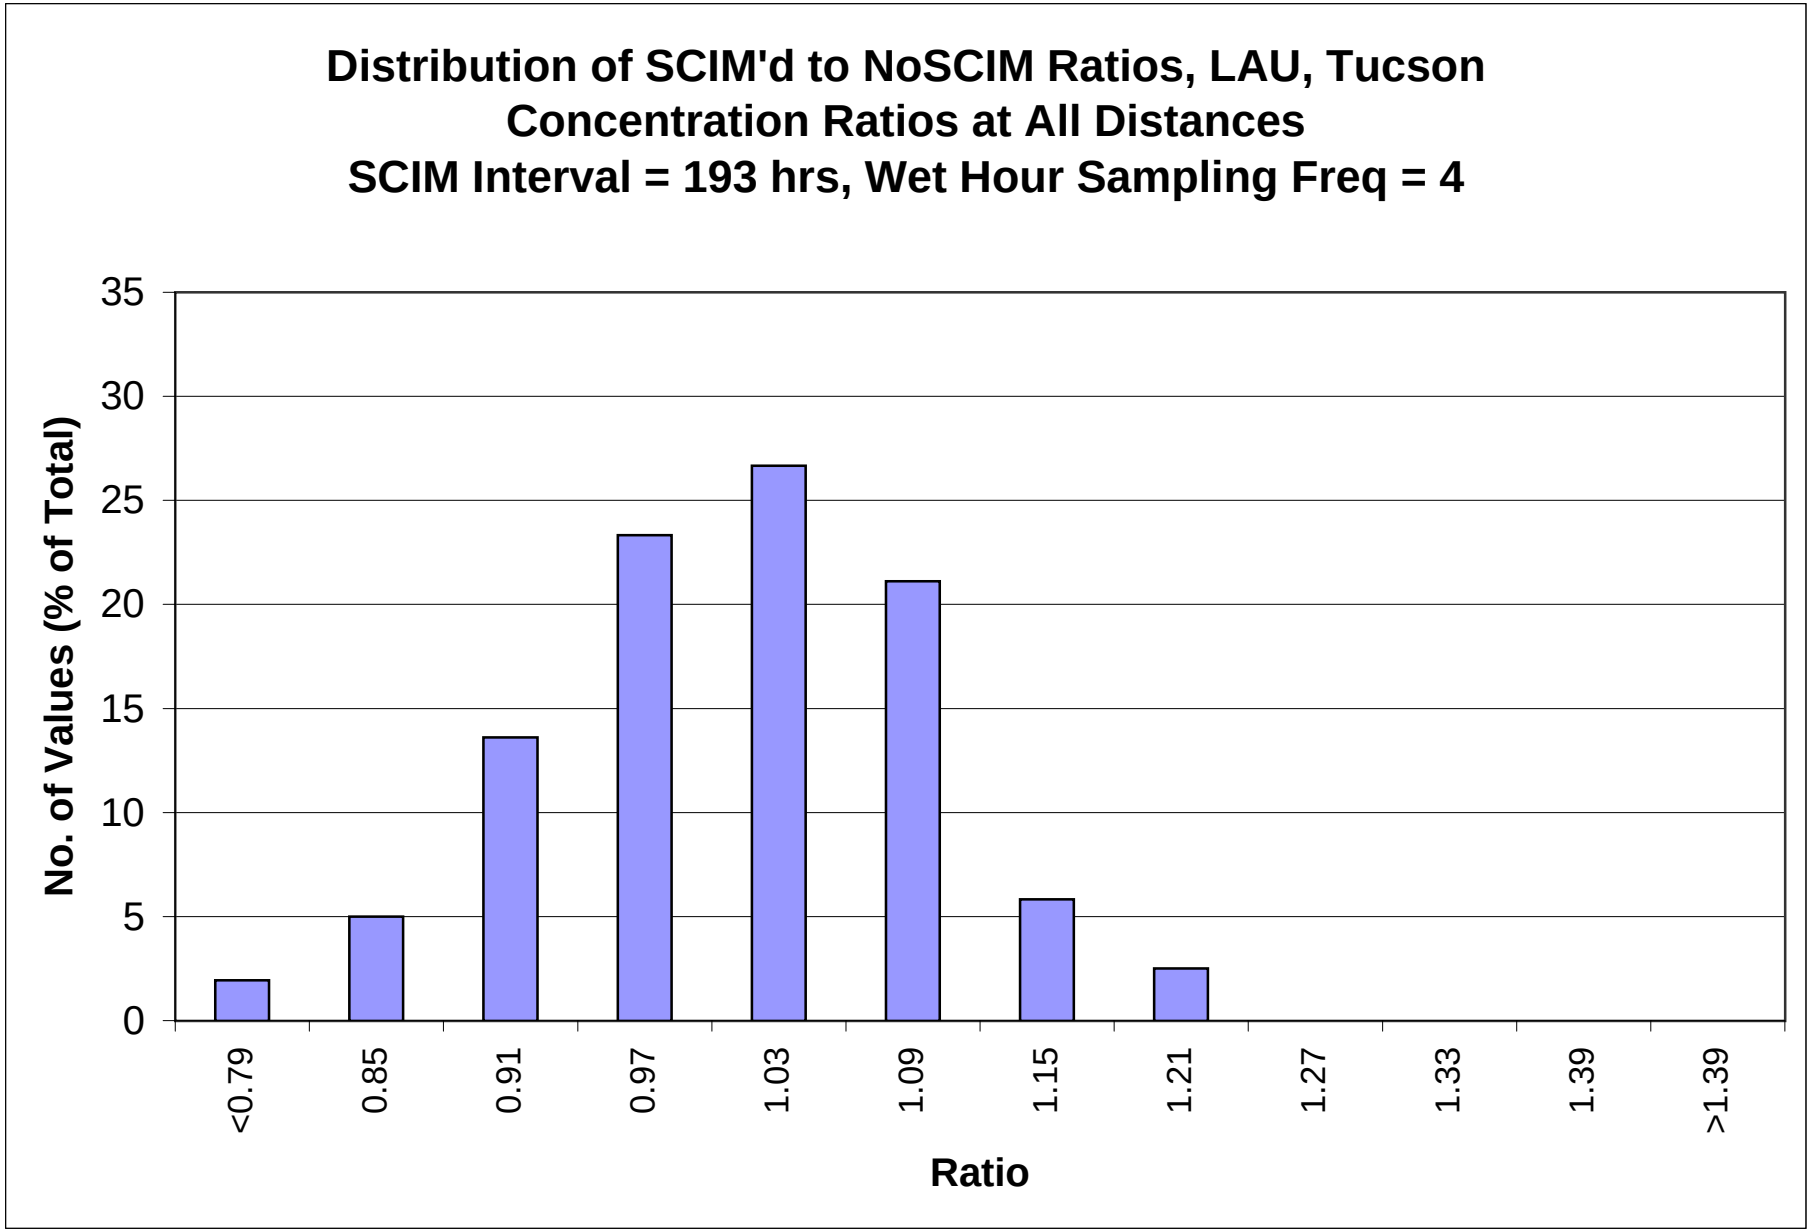
Distribution of SCIM'd to NoSCIM Ratios, LAU, Tucson
Concentration Ratios at All Distances
SCIM Interval = 193 hrs, Wet Hour Sampling Freq = 4
No. of Values (% of Total)
35
30
25
20
15
10
5
0
<0.79
0.85
0.91
0.97
1.03
1.09
1.15
1.21
1.27
1.33
1.39
>1.39
Ratio

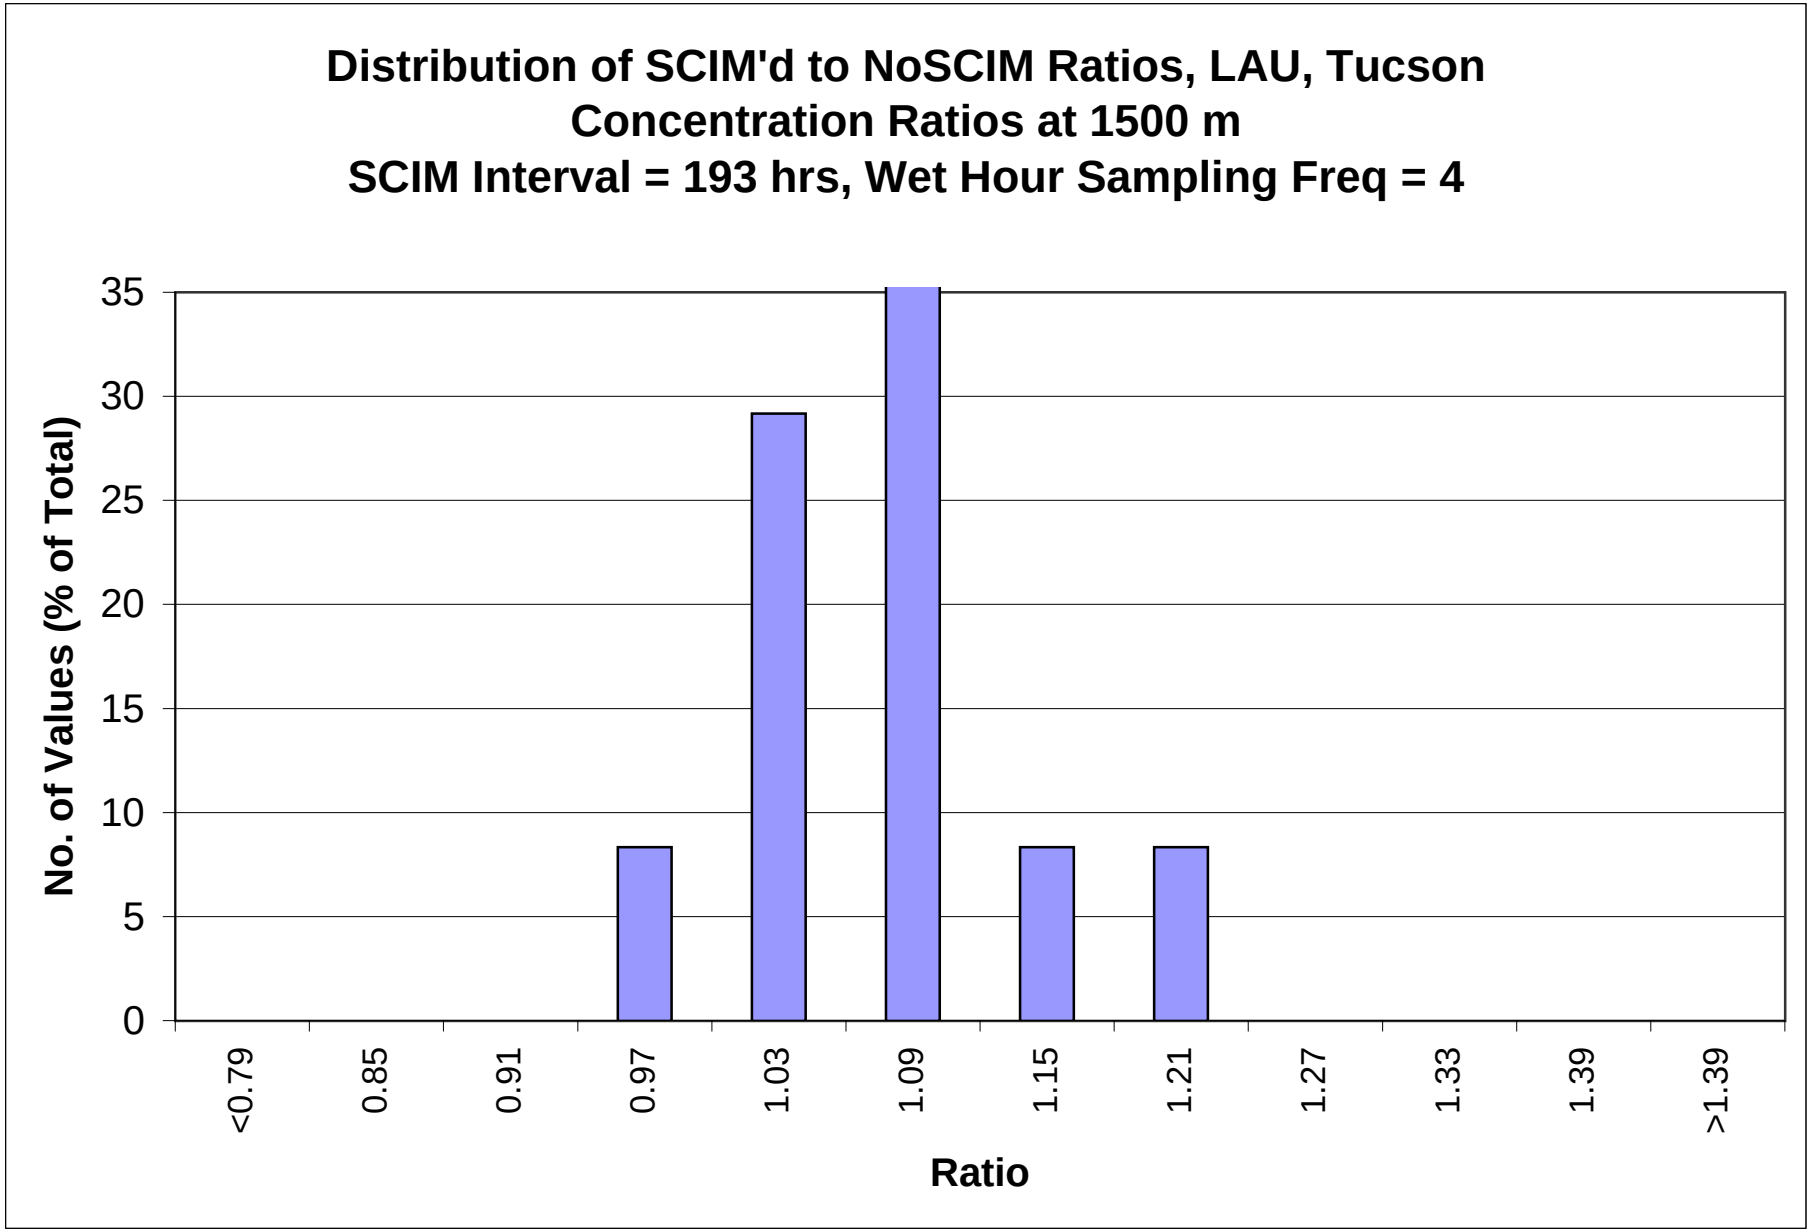
Distribution of SCIM'd to NoSCIM Ratios, LAU, Tucson
Concentration Ratios at 1500 m
SCIM Interval = 193 hrs, Wet Hour Sampling Freq = 4
No. of Values (% of Total)
35
30
25
20
15
10
5
0
<0.79
0.85
0.91
0.97
1.03
1.09
1.15
1.21
1.27
1.33
1.39
>1.39
Ratio

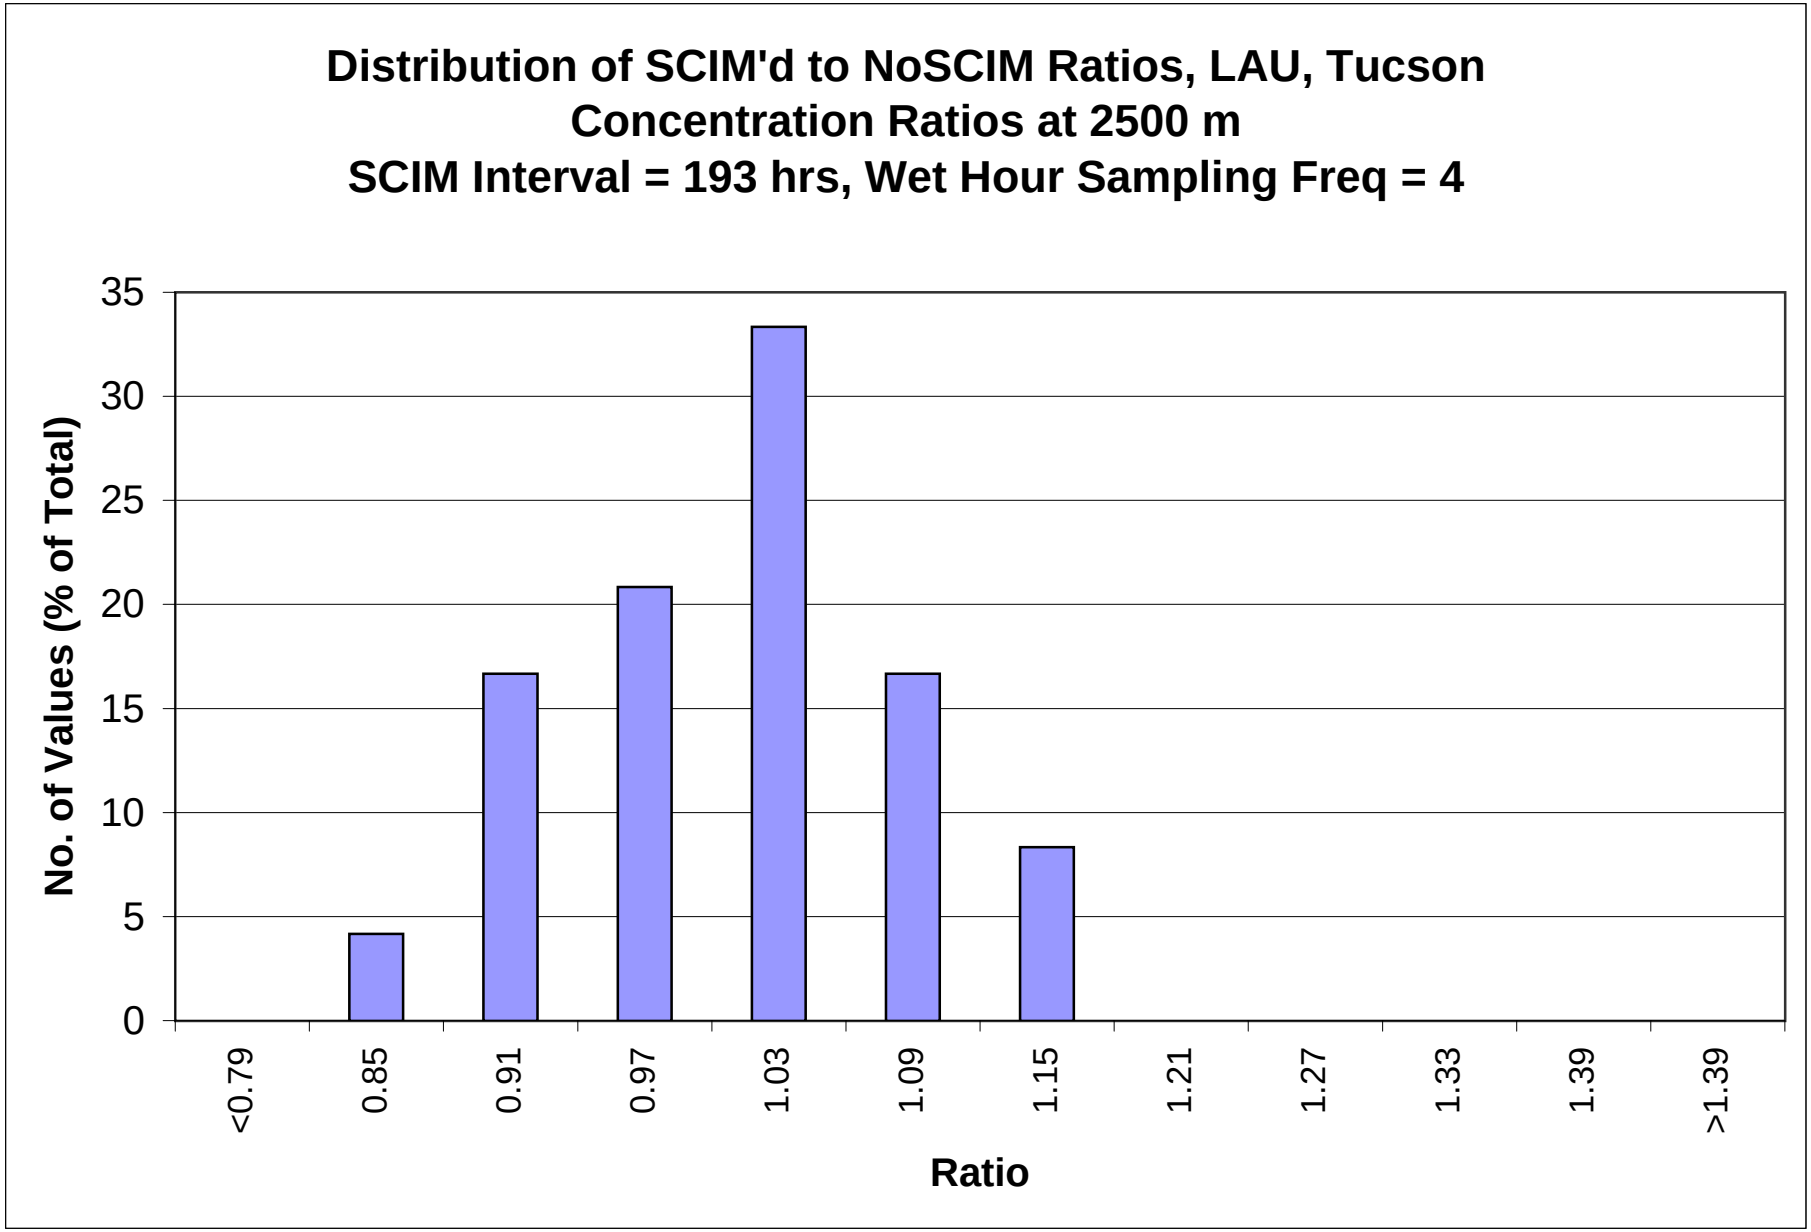
Distribution of SCIM'd to NoSCIM Ratios, LAU, Tucson
Concentration Ratios at 2500 m
SCIM Interval = 193 hrs, Wet Hour Sampling Freq = 4
No. of Values (% of Total)
35
30
25
20
15
10
5
0
<0.79
0.85
0.91
0.97
1.03
1.09
1.15
1.21
1.27
1.33
1.39
>1.39
Ratio

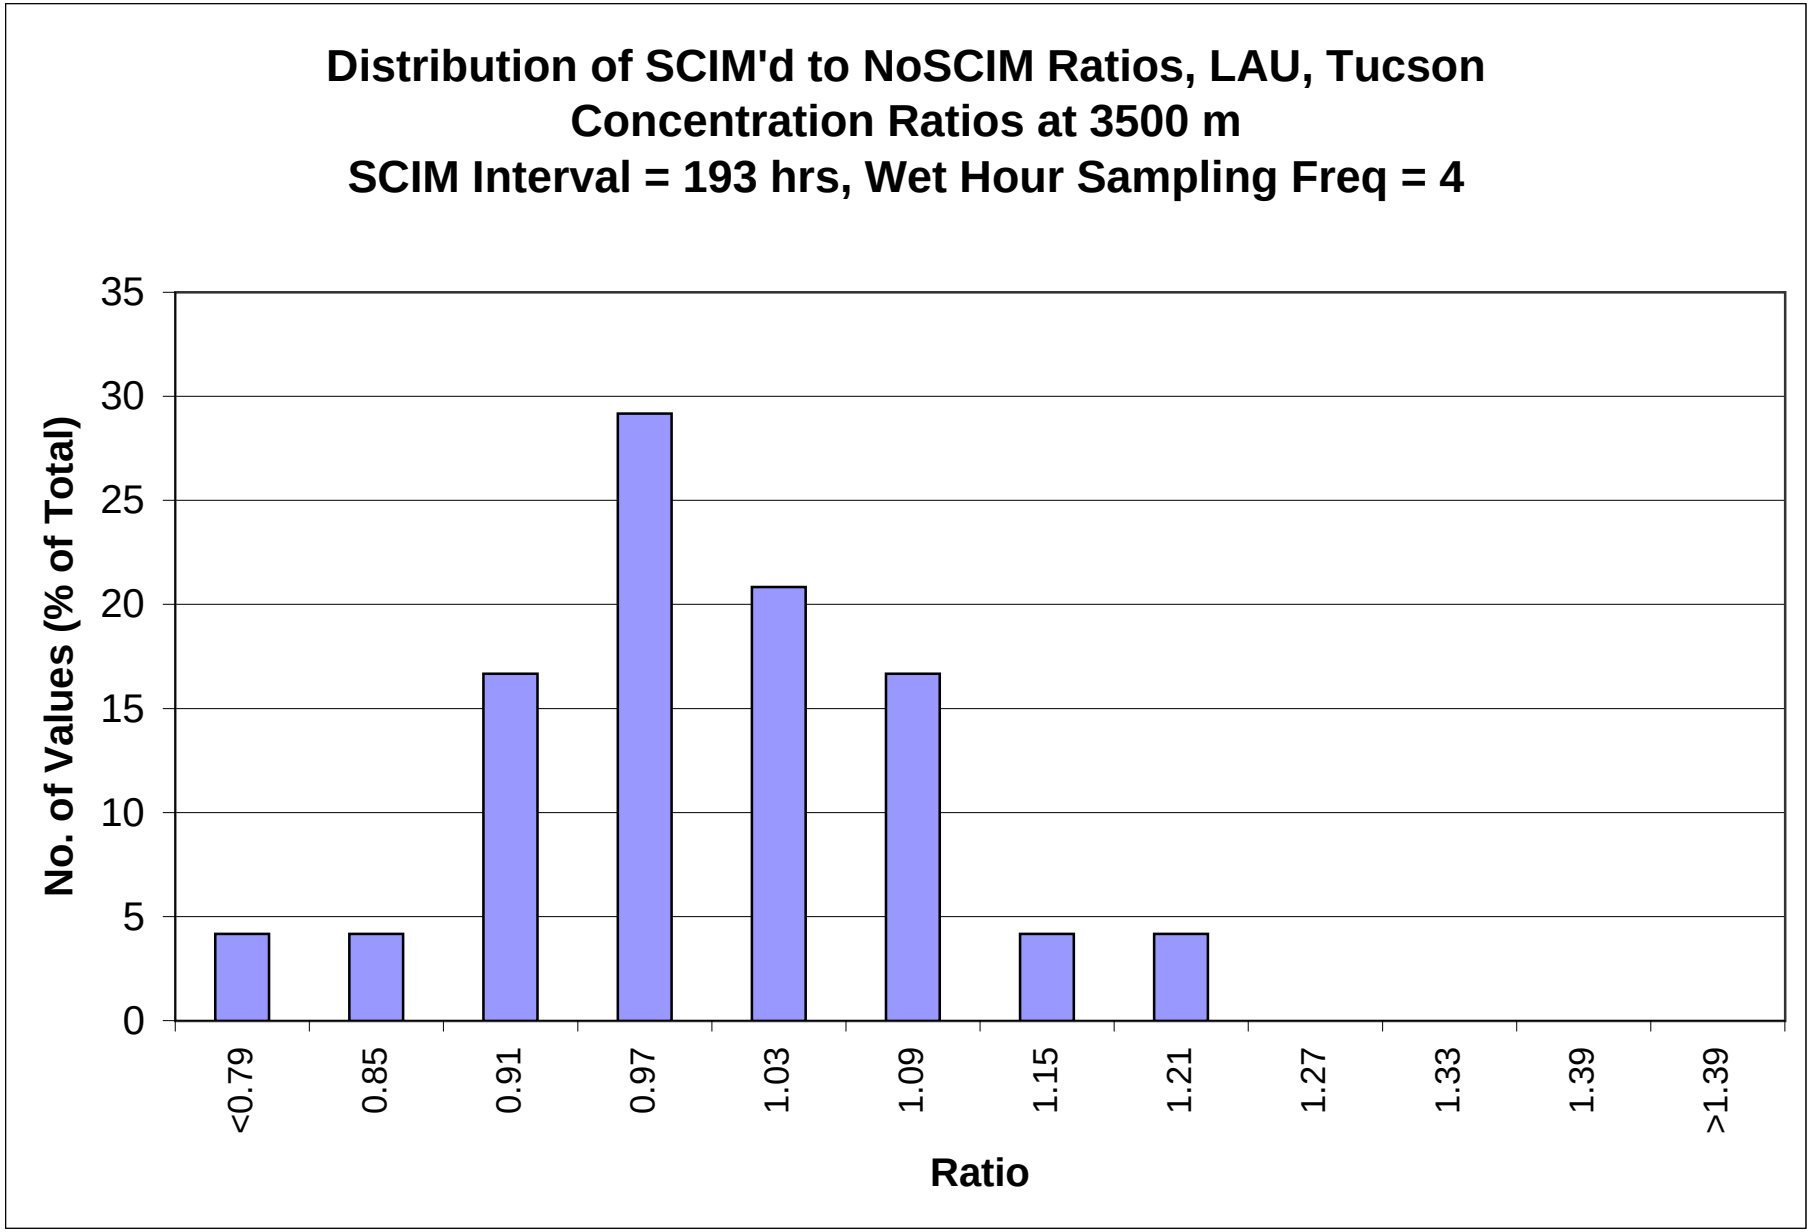
Distribution of SCIM'd to NoSCIM Ratios, LAU, Tucson
Concentration Ratios at 3500 m
SCIM Interval = 193 hrs, Wet Hour Sampling Freq = 4
No. of Values (% of Total)
35
30
25
20
15
10
5
0
<0.79
0.85
0.91
0.97
1.03
1.09
1.15
1.21
1.27
1.33
1.39
>1.39
Ratio

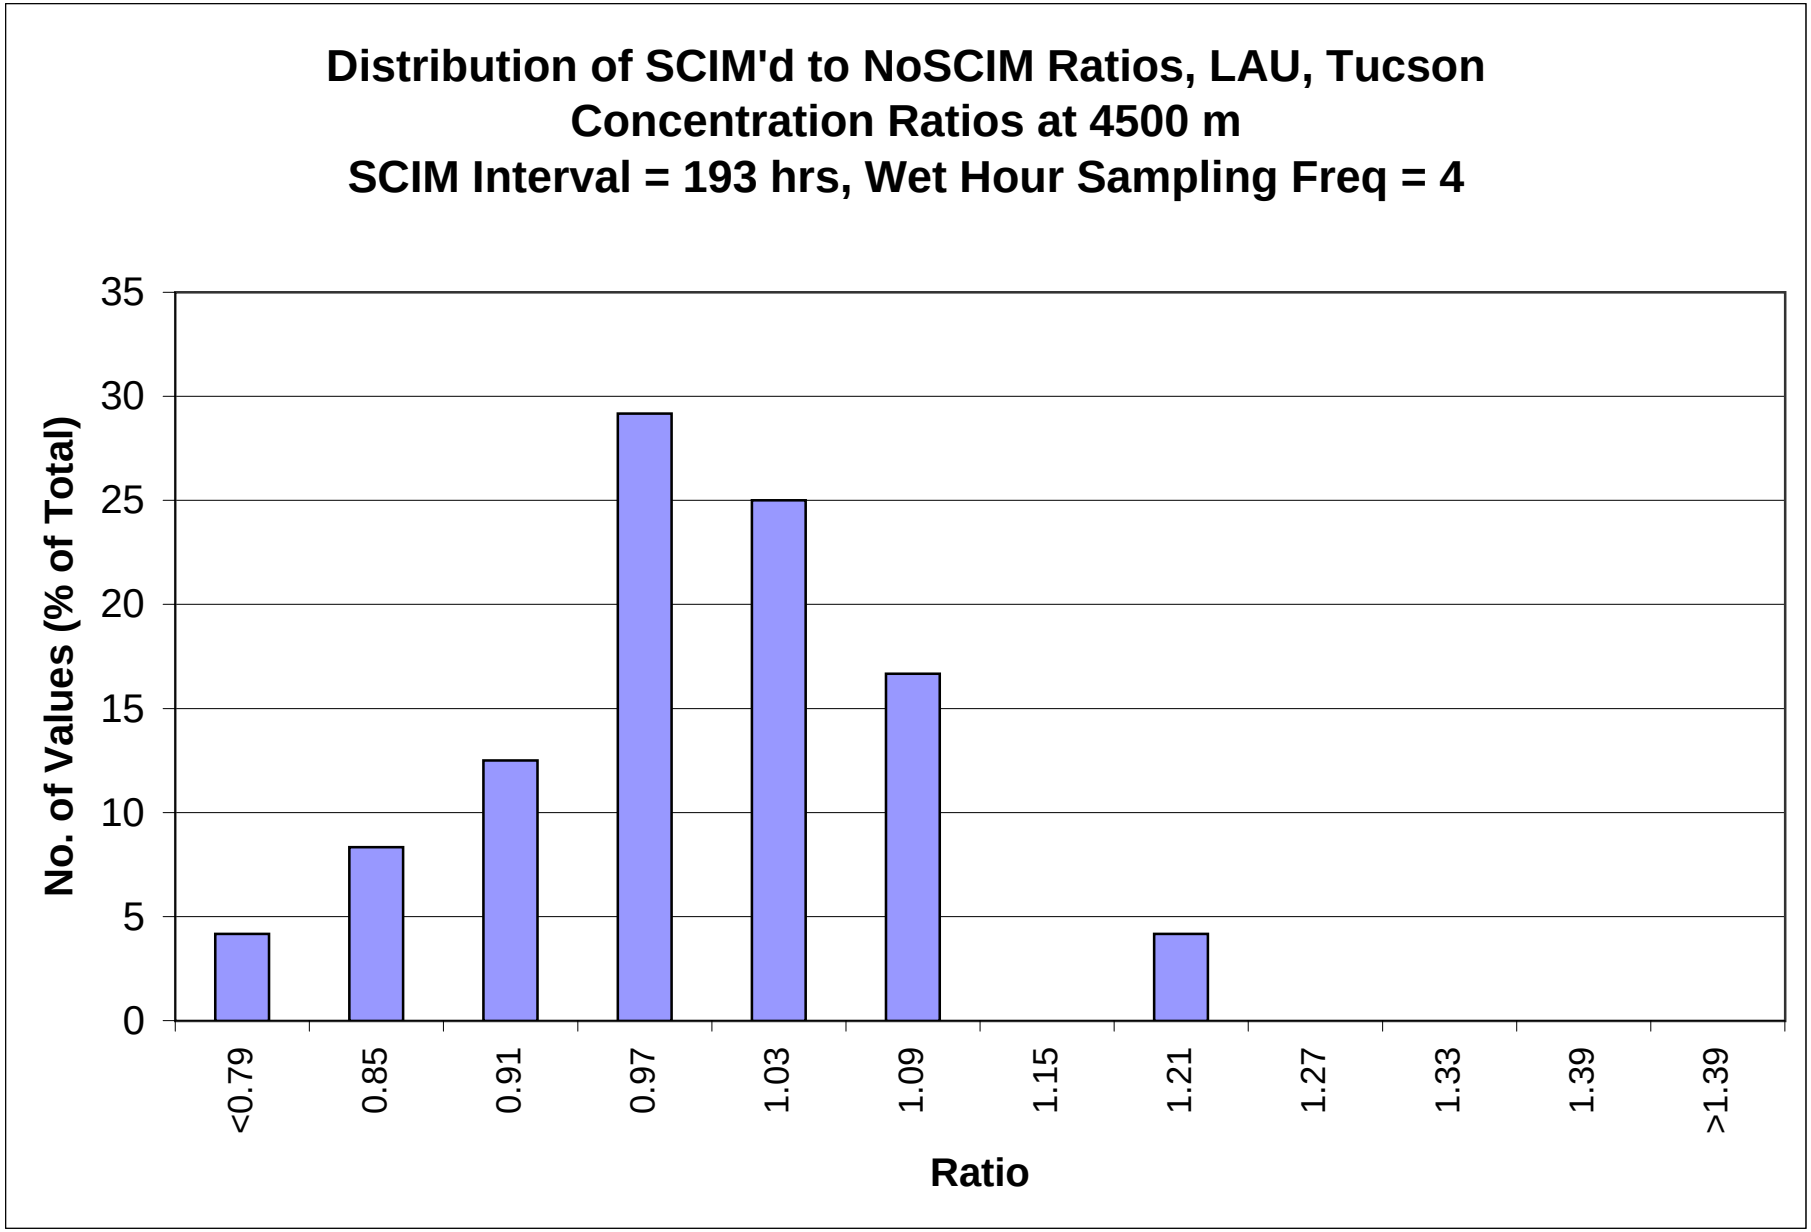
Distribution of SCIM'd to NoSCIM Ratios, LAU, Tucson
Concentration Ratios at 4500 m
SCIM Interval = 193 hrs, Wet Hour Sampling Freq = 4
No. of Values (% of Total)
35
30
25
20
15
10
5
0
<0.79
0.85
0.91
0.97
1.03
1.09
1.15
1.21
1.27
1.33
1.39
>1.39
Ratio

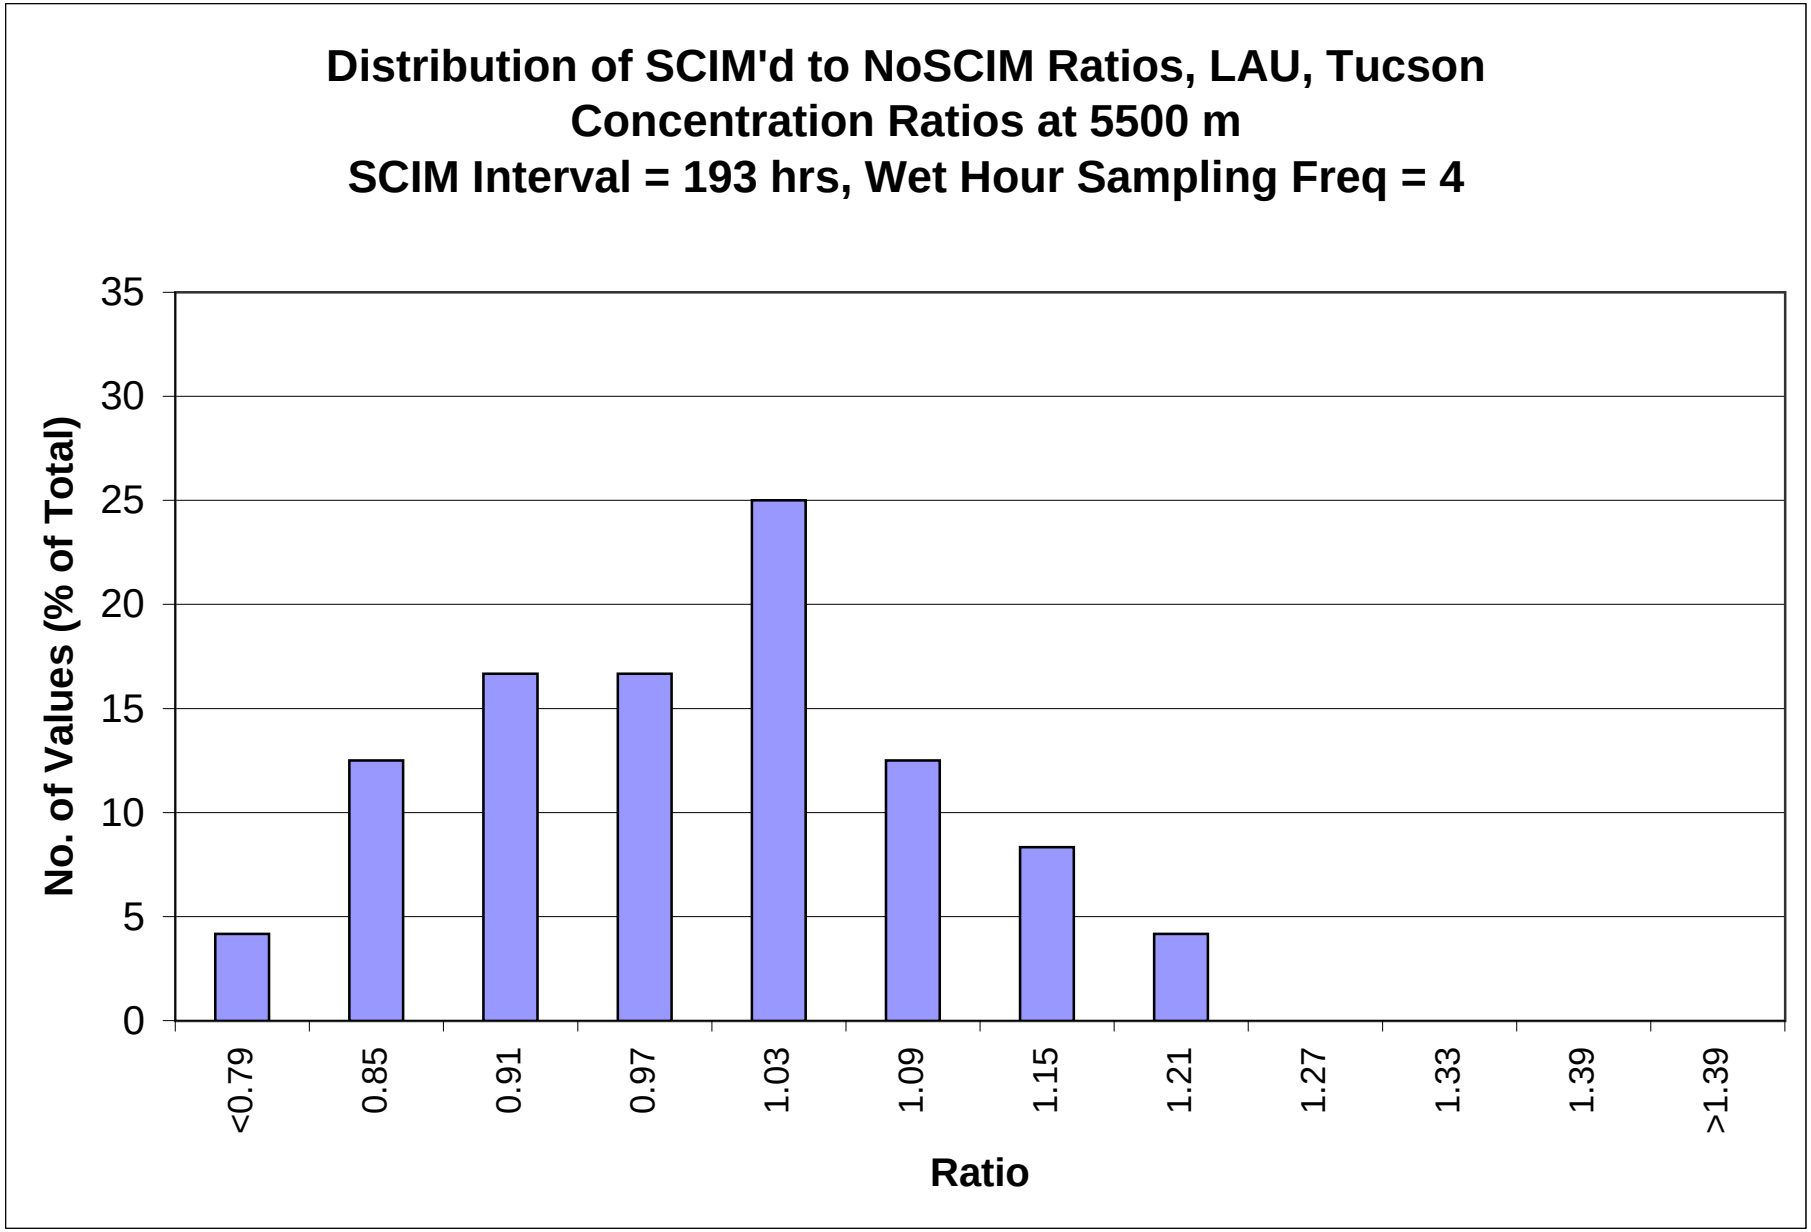
Distribution of SCIM'd to NoSCIM Ratios, LAU, Tucson
Concentration Ratios at 5500 m
SCIM Interval = 193 hrs, Wet Hour Sampling Freq = 4
No. of Values (% of Total)
35
30
25
20
15
10
5
0
<0.79
0.85
0.91
0.97
1.03
1.09
1.15
1.21
1.27
1.33
1.39
>1.39
Ratio

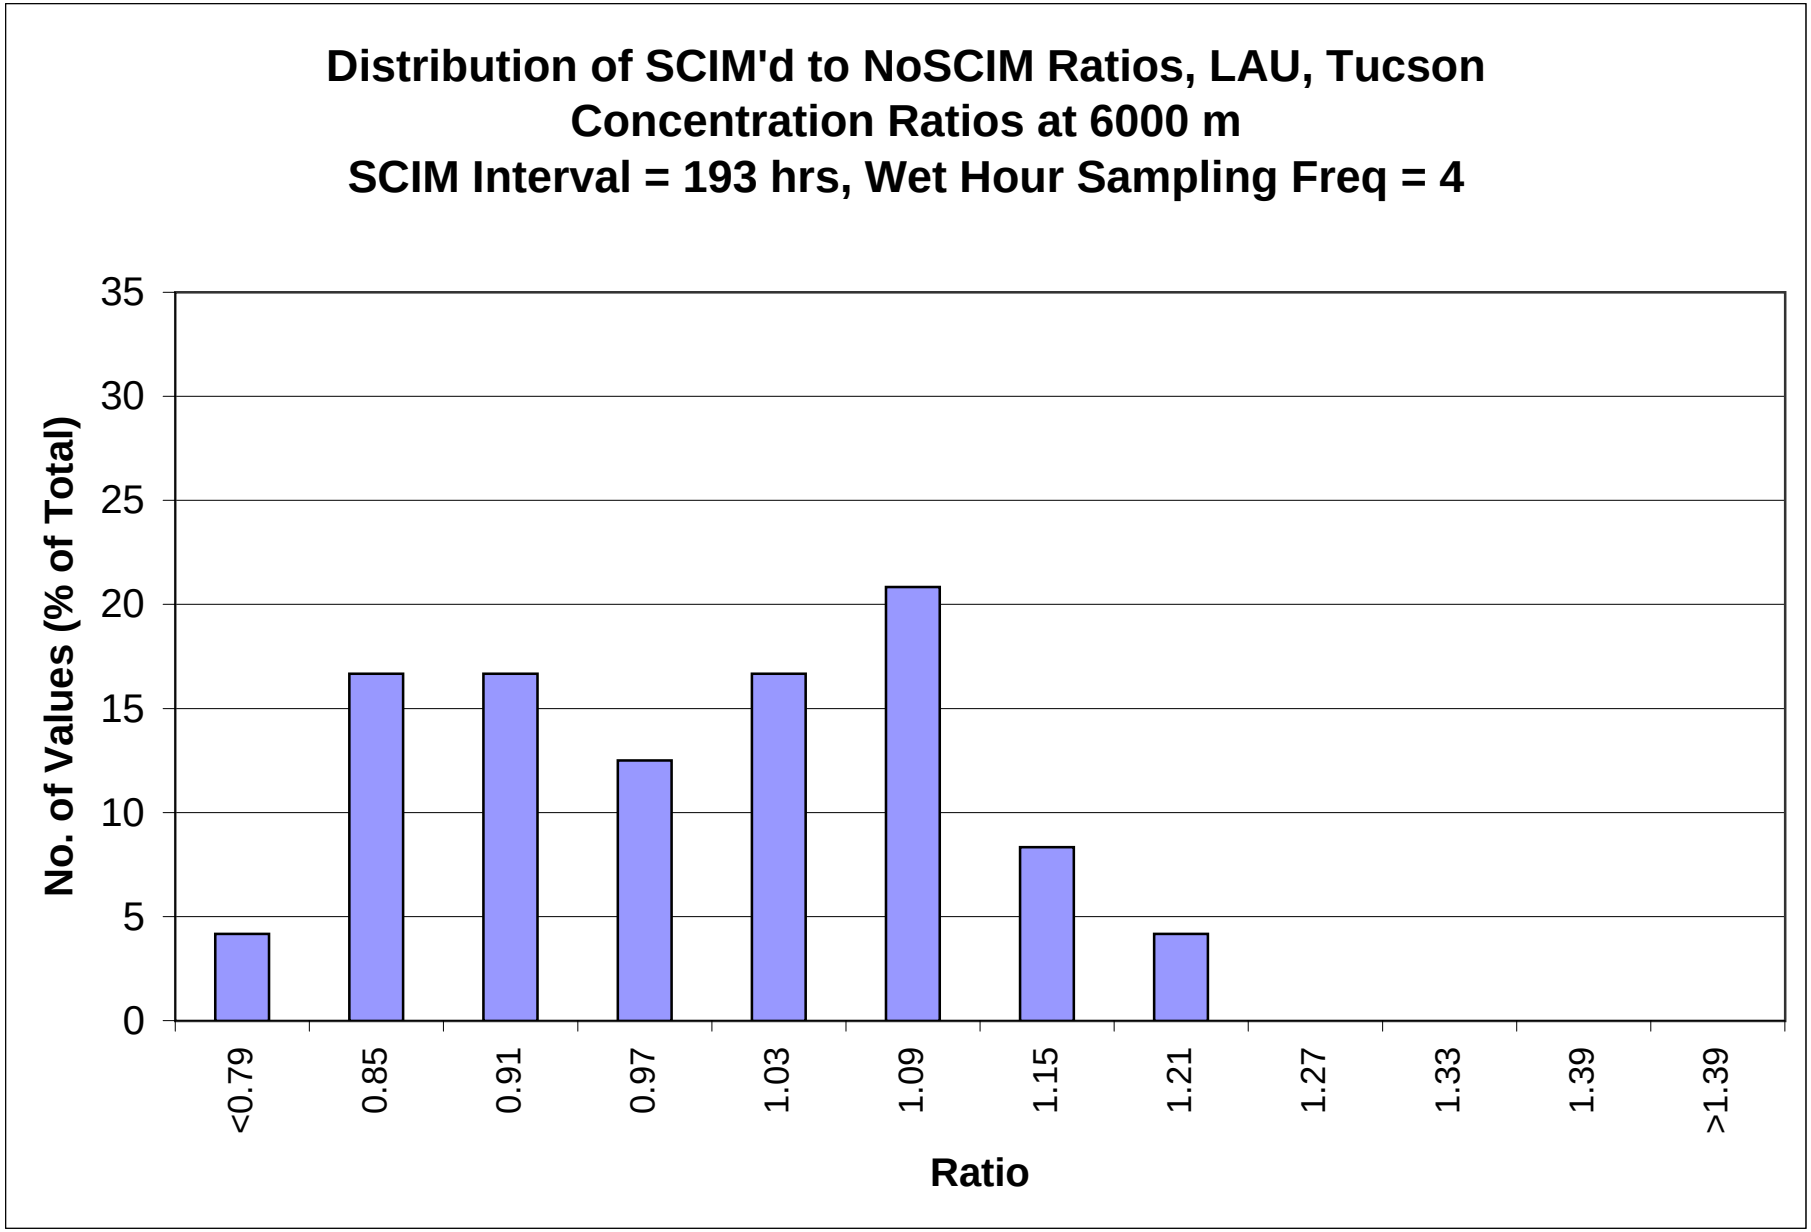
Distribution of SCIM'd to NoSCIM Ratios, LAU, Tucson
Concentration Ratios at 6000 m
SCIM Interval = 193 hrs, Wet Hour Sampling Freq = 4
No. of Values (% of Total)
35
30
25
20
15
10
5
0
<0.79
0.85
0.91
0.97
1.03
1.09
1.15
1.21
1.27
1.33
1.39
>1.39
Ratio