Primary Fill Vessel
(MP 0.0)

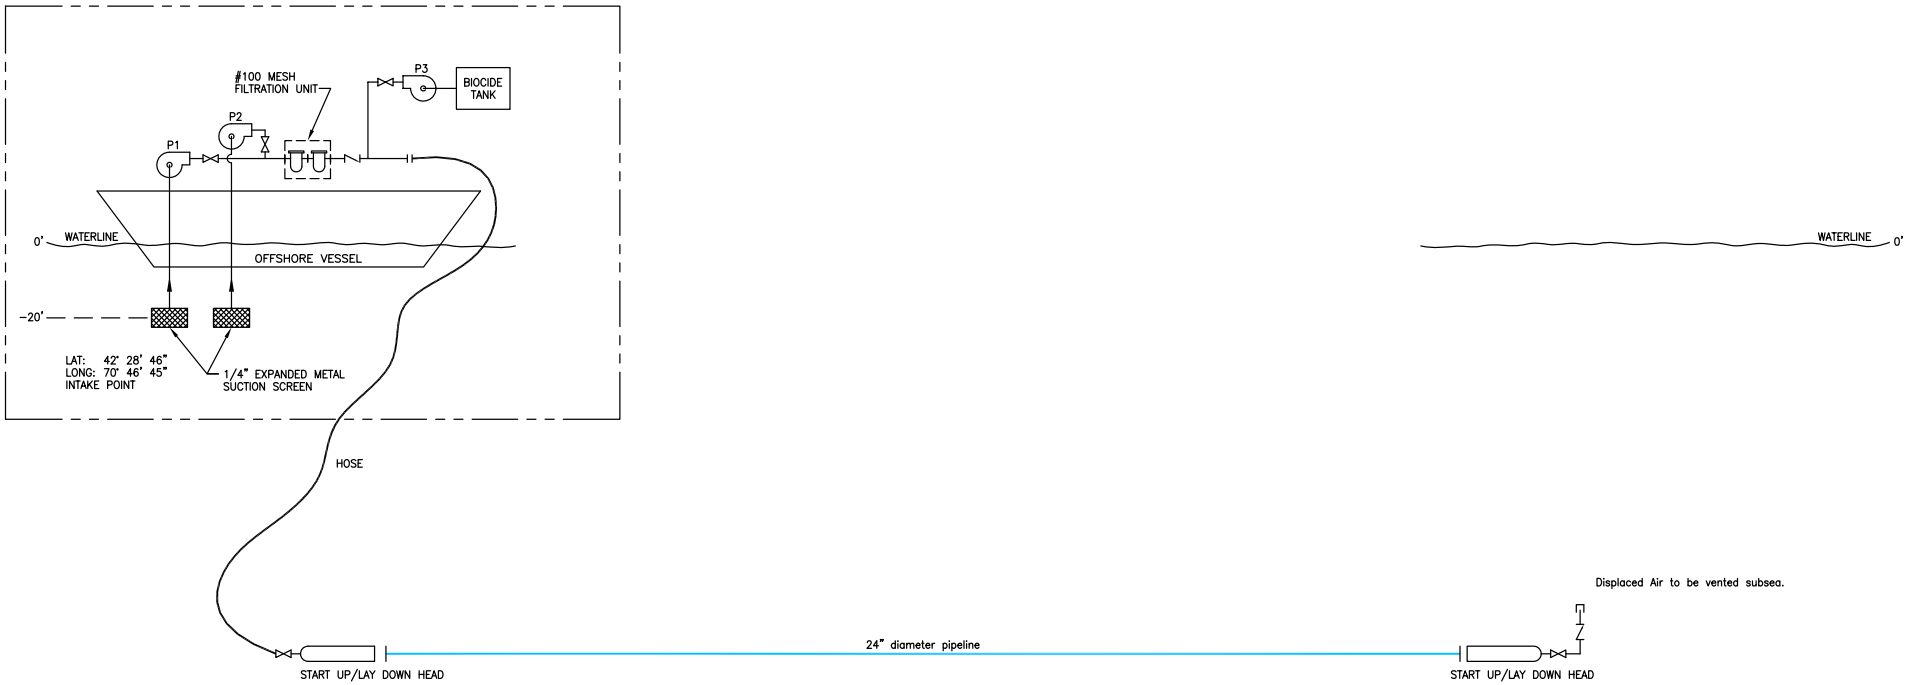

Notes:

1. The primary fill vessel may be located at either MP 0 or MP 16.1

PUMPS	
P1	6" CENTRIFUGAL PUMP (1200 GPM)
P2	6" CENTRIFUGAL PUMP (1200 GPM)
P3	POSITIVE DISPLACEMENT CHEMICAL INJECTION PUMP

NO.	REVISION	DATE	APPR.
A	ISSUED FOR PERMIT	9-25-06	–

Duke Energy Gas Transmission
Algonquin Gas Transmission, LLC
890 Winter St. Waltham, MA (617) 2544-6150

NORTHEAST GATEWAY PIPELINE
TYPICAL FLOODING OF PIPELINE
WITH BIOCIDE INJECTED SEAWATER

DRAWN BY: R.P.G | CHK'D. BY: M.G.S.
DATE: 8-24-06 | APPRV. BY:

FIGURE 2

REV A

09-25-06 9.12 04125\PERMIT 1 R.P.G.