Neutralization and Discharge Vessel (MP 0.0)

Dewatering Vessel (MP 16.1)

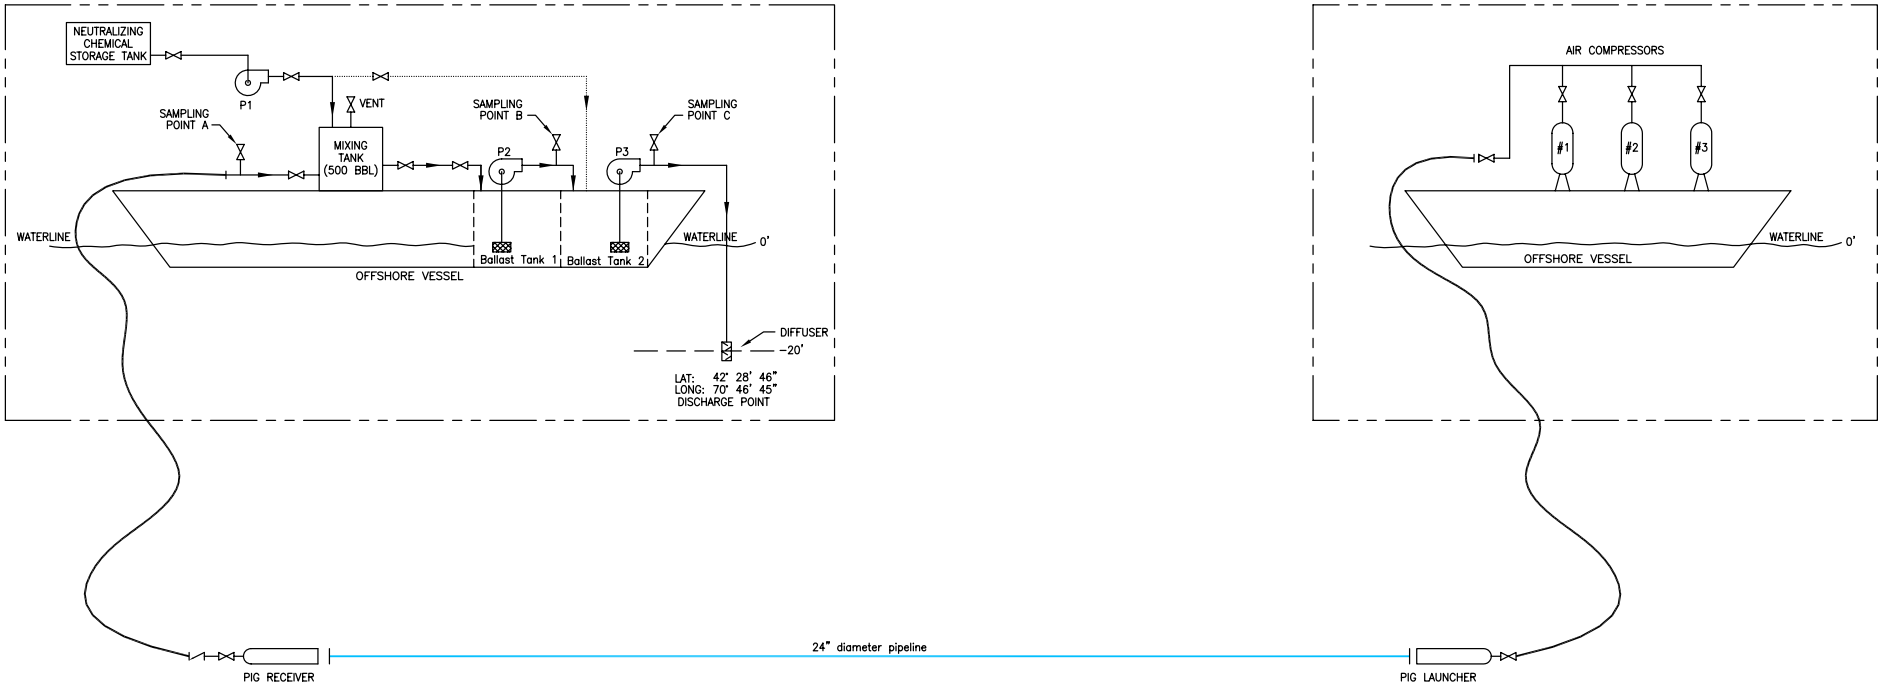

PUMPS	
P1	POSITIVE DISPLACEMENT CHEMICAL INJECTION PUMP
P2	CENTRIFUGAL PUMP (1200 to 2400 GPM)
P3	CENTRIFUGAL PUMP (1200 to 2400 GPM)

NO.	REVISION	DATE	APPR.
A	ISSUED FOR PERMIT	9-25-06	–

Duke Energy Gas Transmission
Algonquin Gas Transmission, LLC
890 Winter St, Waltham, MA (617) 264-6650

DISPLACEMENT OF BIOCIDE INJECTED SEAWATER WITH COMPRESSED AIR
NEUTRALIZATION AND DISCHARGE SCHEMATIC

DRAWN BY: R.P.G. CHK'D. BY: M.G.S.
DATE: 8-25-06 APPRV. BY:

FIGURE 4

REV A

09-25-06 8:05 04125\PERMIT 1 R.P.G.