

**THE U.S. PHASEOUT OF HCFCs:
PROJECTED SERVICING NEEDS IN THE U.S.
AIR-CONDITIONING AND REFRIGERATION SECTOR**

Prepared for

U.S. Environmental Protection Agency
Office of Air and Radiation
Stratospheric Protection Division
1200 Pennsylvania Avenue, NW
Washington, DC 20460

Prepared by

ICF International
1725 Eye Street, NW
Washington, DC 20006

FINAL REPORT, DECEMBER 2009

This report estimates the quantity of HCFC-22 (also recognized by the American Society of Heating Refrigerating and Air- Conditioning Engineers (ASHRAE) designation, R-22) needed to service air-conditioning and refrigeration equipment and the anticipated installed base of such equipment beyond 2010 in the United States. The report also discusses the uses and demand for other HCFCs. This analysis has been developed to assist in the allocation of HCFC consumption allowances. The analyses presented in this report were first made available for comment in a Notice of Data Availability (NODA, 70 FR 67172) and request for comment issued on November 4, 2005. Revisions to the analysis were made in September 2006 and a revised report was made available for comment at a stakeholder meeting held in Washington DC, at EPA Headquarters. A third draft of this report was then issued in June 2008 in support of the proposed rule "Adjustments to the Allowance System for Controlling HCFC Production, Import, and Export" (2010 allocation rule) (December 23, 2008; 73 FR 78680). This final report reflects comments received after January 7, 2009, and include a summary and analysis of the final R-22 allocations set by EPA for 2010 through 2014. A more detailed description of notable updates and additions can be found in the document, "Recalculations and Notable Revisions to the Report: The U.S. Phaseout of HCFCs: Projected Servicing Needs in the U.S. Air-Conditioning and Refrigeration Sector."

Questions concerning this report should be directed to:

Jeremy Arling
Stratospheric Protection Division
U.S. Environmental Protection Agency
1200 Pennsylvania Avenue, NW (6205J)
Washington, D.C. 20460
1-202-343-9055 (phone)
1-202-343-2338 (fax)
Arling.jeremy@epa.gov

Contents

Executive Summary	1
1. Background: The U.S. HCFC Phaseout Schedule	4
1.1 Report Objective	5
2. Methodology Overview	6
3. Overview of HCFC Use in the United States	8
3.1 Projected HCFC Demand	8
3.2 HCFCs Other than HCFC-22	9
3.2.1 HCFC Use in Refrigeration and Air-Conditioning.....	10
4. Projected R-22 Scenarios	14
4.1 R-22 Equipment Used Beyond 2010	14
4.2 Projected R-22 Servicing Needs.....	14
4.2.1 R-22 Sources.....	16
4.2.2 Meeting R-22 Service Demand	17
4.2.3 EPA's Allocations of R-22 for 2010 through 2014.....	21
4.3 Factors Affecting Projections	22
4.3.1 13 Seasonal Energy Efficiency Ratio (SEER).....	22
4.3.2 Transitioning to Alternative Refrigerants	23
4.3.3 Recovery and Reuse Practices	24
4.3.4 Recycling and Stockpiling Plans	25
4.3.5 R-22 Economics	26
4.3.6 Pre-charged Imports.....	26
5. Conclusion	27
Appendix A: Methodology Used to Calculate Projected Servicing Needs	29
A.1 EPA's Vintaging Model	29
A.2 Limitations and Caveats	35
Appendix B: HCFC Projections by End-Use	37
Appendix C: Additional "Recovery Rate" Scenarios	39
6. References	43

Executive Summary

Hydrochlorofluorocarbons (HCFCs) are a class of chemical compounds that deplete the stratospheric ozone layer, leading to overexposure to ultraviolet (UV) radiation at the earth's surface. Excessive UV radiation damages biological systems and causes malignant melanoma and other skin cancers, cataracts, and harm to certain crops and marine organisms. Reversing the course of stratospheric ozone depletion is crucial to human and environmental health worldwide. As a Party to the *Montreal Protocol on Substances that Deplete the Ozone Layer* (Montreal Protocol), the United States is subject to a cap on the consumption of HCFCs—defined as production¹ plus imports minus exports—in an international effort to protect the stratospheric ozone layer (UNEP 2000). Specifically, the United States is obligated to phase out production and consumption of HCFCs by 2030 by making graduated reductions in HCFC production and consumption by certain dates. To meet these interim reduction targets, the U.S. Environmental Protection Agency (EPA) established a schedule for the phaseout of HCFCs starting with those with the highest ozone depletion potentials (ODPs), namely HCFC-141b, HCFC-142b, and HCFC-22.² EPA phased out consumption of HCFC-141b in 2003. The next phaseout milestone occurs on January 1, 2010, when the production and import of HCFC-142b and HCFC-22 (except for use in equipment manufactured prior to January 1, 2010) will cease. Under the restrictions, between 2010 and 2020, both the production and import of HCFC-142b and HCFC-22 will still be permitted to service existing equipment.

In the United States and worldwide, the primary use of HCFC-22 is as a refrigerant, whereas the primary use of HCFC-142b is as a blowing agent in the foam industry (UNEP 2003a). While HCFC-142b is also blended with other constituents to form refrigerant blends, its use in the U.S. air-conditioning (AC) and refrigeration industry is minimal, and therefore servicing demand for HCFC-142b³ is not presented in this analysis. However, a brief section discussing the basic needs for HCFC-142b and other HCFCs is provided. Estimated consumption of R-22 in the U.S. AC and refrigeration industry totaled approximately 108,000 metric tons in 2008 and is by far the largest use of an HCFC by any U.S. industry (EPA 2007a). For this reason, and because the allowable servicing of existing equipment between 2010 and 2020 is applicable primarily to the AC and refrigeration industry, this report presents estimates of the projected quantity of R-22 needed to service AC and refrigeration equipment and the anticipated installed base of such equipment beyond 2010. In quantifying future servicing needs and evaluating how these needs can be met, the objective of this analysis is to provide a resource to assist in the allocation of production and consumption allowances.

This report examines the primary sources of R-22 to service the installed base of equipment after 2010, including (1) the amounts recovered from equipment that are subsequently recycled or reclaimed for reuse and (2) the virgin production and import quantities (i.e., consumption) limited under the Montreal Protocol that may be distributed by EPA through an allowance system.⁴ Five supply and demand scenarios were analyzed that differ by the quantity of R-22 recovered from equipment at the end-of-life and available to service other equipment still in use. Recovery scenarios representing 10, 15, 20, 50, and 75 percent are presented. For example, "Scenario 10" assumes that 10 percent of refrigerant is recovered and available for reuse at equipment end-of-life. In addition, the allocations for R-22 as issued in EPA's Final Rule are presented for comparison purposes.

In September 2007, the United States and other Parties to the Montreal Protocol agreed to strengthen the phaseout schedule for HCFCs in both developed and developing countries. One result of this agreement is that in 2010, the U.S. HCFC production and consumption must be reduced by 75 percent of their respective baselines. The 2010 production cap represents a new commitment under the Montreal

¹ Under the Montreal Protocol, production is defined as "the amount of controlled substances produced, minus the amount destroyed...and minus the amount entirely used as feedstock in the manufacture of other chemicals. The amount recycled and reused is not to be considered as production" (UNEP 2000).


² An ODP value is a measure of a chemical's relative ability to deplete stratospheric ozone. A reference level of 1.0 is assigned to CFC-11.

³ The nomenclature 'R' is typically used to designate chemical compounds used as a refrigerant. Hence, R-22 is synonymous with the use of HCFC-22 as a refrigerant, R-142b with the use of HCFC-142b as a refrigerant, etc.

⁴ The import of used R-22 as approved by EPA is another potential source; however, this source is not included in the projections of this analysis.

Protocol, whereas for the 2010 consumption cap the agreement results in an additional 10 percent of a reduction than the previous phaseout commitment. The scenarios in this report are analyzed in comparison to the adjusted 2010 reduction step.

In accordance with the Montreal Protocol commitments, in 2010 EPA can allocate consumption allowances for no more than 3,810 ODP-weighted metric tons of HCFCs. The quantity of 3,810 ODP-weighted metric tons equates to 69,273 metric tons of HCFC-22. This analysis projects that HCFC-22 demand in 2010 will be approximately 62,500 metric tons—equivalent to 3,438 ODP-weighted metric tons, and approximately 372 ODP-weighted tons below the cap in 2010. Figure ES-1 summarizes servicing demand in comparison to the U.S. HCFC consumption cap, and the total allocation amounts from 2010 to 2014 as promulgated by EPA in the 2010 HCFC Allocation final rule. The remainder of service demand not supplied by R-22 allocations, which must instead be met through recovered R-22, is also illustrated.

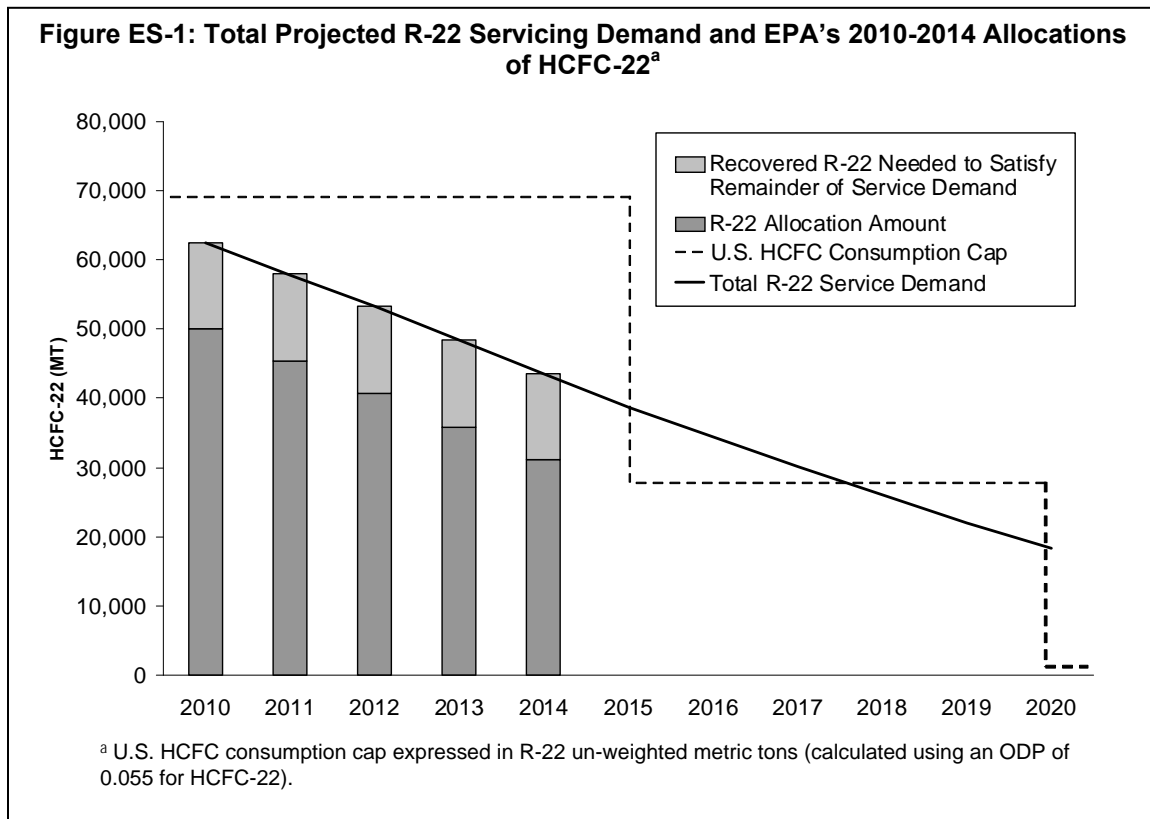

The R-22 consumption allocations set by EPA for years 2010 to 2014 decrease annually, resulting in recovered material comprising a greater proportion of the supply required to meet total demand each year. As such, the percentage of the total need to be met with reclaimed material will rise from 20 percent to 29 percent of total demand in 2014, which is intended to help facilitate the industry's ability to meet the estimated demand in 2015, of which at least 29 percent must be met with recovered material. The annual decrease in allowable virgin R-22 will enable a smooth transition for the AC and refrigeration industry as it should foster greater recovery and reclamation of R-22.

As shown in Figure ES-1, the AC and refrigeration industry could experience shortages in 2015 if only newly manufactured refrigerants will be used to meet overall demand. To that end, this analysis consists of an evaluation of the role of reused refrigerants when considering the servicing tail need for virgin refrigerants.⁵ Thus, the scenarios presented in this analysis assume a mix of recovered and newly manufactured refrigerant to satisfy future R-22 servicing needs. As with previous phaseouts (i.e., CFCs)

⁵ Recovered refrigerant may be recycled and reused in the same owner's equipment; however, if the refrigerant will be used in equipment with different ownership or sold to a new owner, it must first be reclaimed by an EPA-certified refrigerant reclaimer.

recovery of used refrigerant from converted or retired equipment returned to the supply chain is necessary to avoid supply shortfalls.

In addition to recovery practices, several other factors influence which R-22 demand scenario is more likely. For example, with approximately 150 million AC and refrigeration units projected to be in use in 2010, the sooner equipment transitions to alternative refrigerants, the better the chance for an adequate R-22 supply to satisfy the forecasted demand. This report explores the following market trends and how they may influence future R-22 servicing demand and available supply estimates, including:

- the rate of market transition to alternative refrigerants in the United States;
- R-22 cost;
- assumed equipment leak and servicing loss rates;
- levels of refrigerant recovery for reuse, reclamation, and/or banking;
- levels of imports of used R-22; and
- potential future quantities of R-22 that could be obtained from interpollutant transfers of allowances.

The analysis presented in this report uses EPA's Vintaging Model (EPA 2007a) in conjunction with industry collaboration to inform the quantitative estimates on projected servicing needs. The factors listed above influence supply and demand and are addressed in the quantitative analysis with the exception of R-22 cost, refrigerant banking, and levels of imports of used R-22.

This report provides the basis for further collaboration between EPA and the AC and refrigeration community to ensure that supplies (through reuse) are increased in order to continue to service equipment and achieve the next HCFC phaseout targets without refrigerant shortages.

1. Background: The U.S. HCFC Phaseout Schedule

Title VI of the 1990 Clean Air Act Amendments (CAAA) mandates the development and implementation of regulations to protect the stratospheric ozone layer and ensure U.S. compliance with the *Montreal Protocol on Substances that Deplete the Ozone Layer* (the Montreal Protocol). Under the Montreal Protocol, the United States and other signatories are obligated to achieve progress toward the total phaseout of the consumption and production of HCFCs, which are ozone-depleting substances (ODS) and have been widely used as refrigerants, solvents, foam blowing agents, and fire suppressants.⁶ Consumption is defined as production plus imports minus exports; production is defined as the manufacture of a controlled substance minus amounts destroyed and amounts completely used as feedstock in the manufacture of other chemicals and does not include amounts reused or recycled (UNEP 2000).

In September 2007, the nineteenth Meeting of the Parties to the Montreal Protocol was held in Montreal, Canada, marking the 20th anniversary of the signing of the Protocol. At the meeting, the Parties agreed upon a strengthened phaseout of HCFCs. The adjustments call for Article 2 countries—the Protocol’s identifying term for developed countries—to reduce HCFC production and consumption from baseline amounts by 75 percent by 2010, 90 percent by 2015, and 99.5 percent by 2020—allowing for 0.5 percent of the baseline for annual servicing over the period 2020-2030.⁷ Previously, the 2010 reduction step was 65 percent and was limited solely to consumption, not production.

Table 1-1 presents the HCFC consumption baseline and the graduated reductions (caps) to allowable HCFC consumption for the United States (and all Article 2 countries).

Table 1-1. U.S. HCFC Consumption Phaseout Schedule Under the Montreal Protocol

Date	Consumption Cap	ODP Weighted Metric Tons ^a	Quantity Expressed in R-22 Metric Tons ^b
Jan 1, 1996	Baseline set at 2.8% of the 1989 ODP-weighted CFC consumption plus 100% of the 1989 ODP-weighted HCFC consumption	15,240	277,091
Jan 1, 2004	35% reduction from the baseline	9,906	180,109
Jan 1, 2010	75% reduction from the baseline	3,810	69,273
Jan 1, 2015	90% reduction from the baseline	1,524	27,709
Jan 1, 2020	99.5% reduction from the baseline	76.2	0 ^c
Jan 1, 2030	100% reduction from the baseline	0	0

^aAn ODP-weighted metric ton takes into account each ODS’ relative contribution to ozone depletion. One metric ton equals approximately 2,204 pounds.

^bCalculated using an ODP of 0.055 for HCFC-22.

^cIn 2020, 0.5 percent of the U.S. consumption baseline remains, but the U.S. phaseout schedule prevents any allocation to R-22.

Table 1-2 details the U.S. phaseout schedule for HCFCs established under the 1990 CAAA to comply with the targets set by the Montreal Protocol (as presented in Table 1-1). The production and import of HCFC-141b, the HCFC with the highest ODP, was phased out with limited exemptions on January 1, 2003. Beginning in 2003, EPA established an allowance system to control the U.S. production and consumption (including import and export) of HCFCs and to apportion consumption allowances amongst HCFCs. An allowance is the privilege for the allowance holder to produce and/or import a quantity on an annual basis limited to the allowance granted. Production and consumption allowances for HCFC-141b (for limited exemptions), HCFC-22, and HCFC-142b were authorized and distributed (on a kilogram basis)

⁶ The production and import of other ODS used by these industries, including chlorofluorocarbons, carbon tetrachloride, and methyl chloroform, were phased out in 1996 – halons in 1994 (with limited exemptions).

⁷ Article 5 countries—the Protocol’s identifying term for developing countries—follow a later phaseout schedule than Article 2 countries and as a result of the agreement in 2007 are subject to reduction steps of 10 percent by 2015, 35 percent by 2020, 67.5 percent by 2025, and allowing for servicing at an annual average of 2.5 percent from 2030-2040.

to certain companies (EPA 2003a).⁸ Therefore, as of 2003, only those companies with allowances were allowed to produce and/or import these HCFCs.

**Table 1-2: U.S. HCFC Phaseout Schedule Mandated Under the 1990 CAAA
(to Comply with the Protocol)**

Date	Restriction
Jan 1, 2003	<ul style="list-style-type: none"> • Ban on production and import of HCFC-141b.
Jan 1, 2010	<ul style="list-style-type: none"> • Ban on production and import of HCFC-22 and HCFC-142b except for on-going servicing needs in equipment manufactured before January 1, 2010.^a
Jan 1, 2015	<ul style="list-style-type: none"> • Ban on the production, import, and introduction into interstate commerce or use of HCFCs except where the HCFCs are used as a refrigerant in equipment manufactured prior to January 1, 2020.^a
Jan 1, 2020	<ul style="list-style-type: none"> • Ban on remaining production and import of HCFC-22 and HCFC-142b.^a
Jan 1, 2030	<ul style="list-style-type: none"> • Ban on remaining production and import of all other HCFCs.^a

^aCertain additional exemptions apply, including exemptions for (1) HCFCs used in processes resulting in their transformation or destruction, or (2) pre-authorized import of HCFCs that are recovered and either recycled or reclaimed.
Source: EPA (2003a); EPA (2007b).

Beginning January 1, 2010, U.S. production and import of HCFC-141b, HCFC-142b, and HCFC-22 will be limited to use in equipment manufactured prior to January 1, 2010, or where additional exemptions apply. The final phaseout for HCFC-22 and HCFC-142b is on January 1, 2020, and for all other HCFCs on January 1, 2030. Production and consumption allowances must be granted under the allowance system. EPA evaluated the amount of HCFC-22 and HCFC-142b necessary for servicing as well as the need for other HCFCs to ensure that the permitted level for all HCFCs does not exceed the U.S.'s international obligation to reduce the production and consumption levels to 75 percent below the respective baseline levels in 2010. In addition, EPA considered the amount of HCFC-22 and HCFC-142b needed to meet servicing needs of existing equipment. The actual allocated amounts of HCFCs by chemical can be found in the final rulemaking.

1.1 Report Objective

This report presents quantitative estimates of the projected amount of (a) units of equipment using HCFC-22 beyond 2010 in the United States and (b) HCFC-22 needed to service equipment beyond 2010 in the United States. It estimates R-22 consumption needs for air-conditioning (AC) and refrigeration equipment (the largest HCFC market and the largest industry sector using HCFCs) that will be in use after 2010 and possible future scenarios to meet those needs. This final version additionally contains an analysis of EPA's allocated amount for the 2010-2014 control periods. This analysis also explores, in a limited way, demand for HCFC-142b and other HCFCs. The remainder of the report is organized as follows:

- Section 2 provides a brief overview of the methodology used to project servicing scenarios.
- Section 3 provides an overview of HCFC use in the United States, including projected demand of HCFCs, and an overview of HCFC use other than HCFC-22 in the AC and refrigeration sector.
- Section 4 provides two projected recovery scenarios and resulting R-22 consumption needs as well as an analysis of EPA's 2010-2014 allocation.
- Section 5 summarizes the key findings of the analysis.
- Appendix A presents further information on the projection methodology and its limitations.
- Appendix B provides AC and refrigeration projections by end-use.
- Appendix C provides estimates of R-22 consumption needs based on projected minimum and maximum recovery rates of R-22 for servicing equipment.

⁸ The production of one kilogram of HCFC requires the expenditure of one production allowance and one consumption allowance. The import of one kilogram of HCFC requires the expenditure of one consumption allowance. While the import of *used* HCFCs does not require the expenditure of allowances, it does require petition approval by EPA; see Section 4.2.1 for more detail.

2. Methodology Overview

EPA's Vintaging Model is the primary tool used to perform the analysis and form the basis for quantitative estimates of current and projected HCFC consumption. The Vintaging Model estimates the annual chemical emissions from industry sectors that have historically used ODS, including AC, refrigeration, foams, solvents, aerosols, and fire protection. Within these industry sectors, there are over 50 independently modeled end-uses. The model uses information on the market size and growth for each end-use, as well as a history and projections of the market transition from ODS to alternatives. As ODS are phased out, a percentage of the market share originally filled by the ODS is allocated to each of its substitutes. The model tracks emissions of annual "vintages" of new equipment that enter into operation by incorporating information on estimates of the quantity of equipment or products sold, serviced, and retired or retrofitted each year, and the quantity of the compound required to manufacture, charge, and/or maintain the equipment. EPA's Vintaging Model uses this market information to build an annual inventory of in-use stocks of equipment and the ODS and non-ODS substitutes in each end-use.

According to EPA's Vintaging Model, the AC and refrigeration industry currently represents 97 percent (by mass) of HCFC-22 consumption and 88 percent (by mass) of total HCFC consumption. Other HCFCs are explored in a limited manner (Section 3) based on the Vintaging Model and industry analysis.

Appendix A discusses the assumptions used to develop the supply and demand estimates presented in this report and the limitations and caveats inherent in the analysis. In addition to the use of EPA's Vintaging Model, during the development of the first version of this report, EPA contacted a limited number of industry experts to corroborate the findings and market dynamics affecting the servicing needs of the AC and refrigeration industry after 2010. EPA used the informal discussions to confirm or modify preliminary estimates obtained from EPA's Vintaging Model for this analysis.

The first release of this report was on November 4, 2005 when EPA made the preliminary draft version available for comment in a Notice of Data Availability (NODA, 70 FR 67172). EPA received five comments, which are available at EPA's electronic docket at www.regulations.gov (Docket ID number, EPA-HQ-OAR-2003-0130). Among the comments received, two commenters stated that the overall projected demand of R-22 for servicing AC and refrigeration equipment is reasonable; however, all commenters expressed concern regarding the projections of the supply of R-22 recovered from equipment and subsequently recycled or reclaimed for reuse that can satisfy future demand. One commenter indicated that the existing business model for R-22 recovery does not encourage the conservation efforts required to meet the 50% recovery scenario presented in the preliminary draft report, nor would the current collection and processing infrastructure support projections of the recovered supply. In response, EPA used the Vintaging Model to test whether demand might exceed supply under some circumstances.

On September 29, 2006, EPA's Stratospheric Protection Division held a meeting for HCFC stakeholders regarding the 2010 milestone in the HCFC phaseout. EPA issued a September 2006 version of this report at that time. This version contained one additional scenario of consumption needs for R-22 based on industry input on the 2005 draft report. EPA subsequently received comments on this report as well as options for a future rulemaking to allocate HCFCs for the control periods of 2010-2014. The June 2008 version of the report took into account the comments from stakeholders and provided an updated set of analyses based on the most recent Vintaging Model output. The June 2008 version of the report included the estimates of a recovery rate of 15, 20, and 75 percent in addition to updating the previous scenarios of 10 and 50 percent.

On December 23, 2008, EPA published two proposed rules, *Adjustments to the Allowance System for Controlling HCFC Production, Import, and Export* (73 FR 78680) and *Ban on the Sale or Distribution of Pre-charged Appliances* (73 FR 78705). Comments on both proposed rules were submitted during the public comment period in early 2009 in Docket ID No. EPA-HQ-OAR-2008-0496 and Docket ID No. EPA-HQ-OAR-2007-0163 respectively. The Allowance System proposed rule requested comments on the draft servicing tail analysis. This version of the report takes into account relevant comments from stakeholders. As with previous versions of this report, the analysis uses EPA's Vintaging Model in

conjunction with industry collaboration and reported HCFC consumption data to inform the quantitative estimates on projected servicing needs. The analysis employs the same Vintaging Model output as the June 2008 version.⁹ It also focuses on Scenarios 20 and 50 (additional scenarios are in Appendix C) and presents the actual allocation amounts for the 2010-2014 control periods as found in EPA's final rule.

⁹ The June 2008 version of the report used a model run developed in 2007 (EPA, 2007a) to assist in projecting future servicing demands for HCFCs. While several updates were made to the inputs of EPA's Vintaging Model since 2007, these updates were determined to have minimal impact on the HCFC projections.

3. Overview of HCFC Use in the United States

HCFCs have a variety of applications in the foam, aerosol, solvent cleaning, fire protection, and sterilization industry sectors; however, their largest presence is in the AC and refrigeration industries. Although the Montreal Protocol has identified numerous HCFCs under Article 2F, only those listed in Box 3-1 are consumed in significant quantities in the United States.

Box 3-1: Summary of Common HCFCs and their End-Use Applications

- *HCFC-141b* –historically used as a blowing agent in rigid polyurethane foams and integral skim foams and in aerosol solvent cleaning applications. Production and consumption phased out in 2003 except for exemption production for specific applications.
- *HCFC-22* - used as a refrigerant in several applications such as unitary air conditioners, cold storage, retail food refrigeration equipment, chillers, and industrial process refrigeration; see Section 4 for further information. Also used (in smaller quantities) as a blowing agent for certain foam applications and as a component of some sterilant mixtures.
- *HCFC-123* - used in centrifugal chillers and portable fire extinguishers.
- *HCFC-124* - used in some sterilant mixtures and as a component in some replacements for CFCs as a refrigerant or for halon as a fire suppressant. Replaces CFC-114 in some heat pumps and special air conditioning equipment.
- *HCFC-142b* - used as a blowing agent in extruded polystyrene boardstock. Also used in small quantities in refrigerant blends as a retrofit refrigerant for applications such as motor vehicle ACs that previously used CFC-12.

Table 3-1. HCFC Atmospheric Lifetime (Years) and Ozone Depletion Potential


HCFC	Chemical Name	CAS Number	Atmospheric Lifetime (years)	ODP ^a
HCFC-141b (CH ₃ CFCl ₂)	1,1-Dichloro-1-fluoroethane	1717-00-6	9.2	0.11
HCFC-142b (CH ₃ CF ₂ Cl)	1-Chloro-1,1-difluoroethane	75-68-3	17.9	0.065
HCFC-22 (CHF ₂ Cl)	Chlorodifluoromethane	75-45-6	12.0	0.055
HCFC-124 (CF ₃ CHFCI)	2-Chloro-1,1,1,2-tetrafluoroethane	2837-89-0	5.8	0.022
HCFC-123 (CHCl ₂ CF ₃)	1,1-Dichloro-2,2,2-trifluoroethane	306-83-2	1.3	0.02

^aODP values are taken from the Montreal Protocol (UNEP 2003b).

Section 3 is organized into two subsections. Section 3.1 provides a brief discussion of projected demand of HCFCs, including estimates in ODP-weighted metric tons. Section 3.2 presents an overview of the HCFC demand by end-use sectors for HCFCs other than HCFC-22 with a primary focus on the AC and refrigeration sector.


3.1 Projected HCFC Demand

HCFC-142b and HCFC-22 production and import will be limited beginning January 1, 2010, to use as a refrigerant in, or to provide service to, equipment manufactured prior to January 1, 2010. Servicing use of these two HCFCs is limited to the AC and refrigeration sector. Projected demand for HCFC-22 was estimated based on EPA’s Vintaging Model and is further explored in Section 4, which presents projected scenarios of the extent to which HCFC-22 demand (in 2010 and beyond) can be met through supplies of recovered refrigerant. In addition to servicing demand, there is demand associated with other HCFCs for other end-use applications not subject to the 2010 use restrictions on HCFC-142b and HCFC-22. EPA projected demand for those other HCFCs by examining estimates of current demand through various sources, including consumption data as reported by regulated entities to EPA, input from industry experts, and assumptions from EPA’s Vintaging Model on future anticipated trends (EPA 2007a; NASA 2008; U.S. HCFC Manufacturer Representatives 2008; U.S. HCFC Manufacturer Representatives 2009). Figure 3-1 demonstrates all projected HCFC demand in 2010 (ODP-weighted); as shown, HCFC-22 servicing needs constitute over 97% percent of all HCFC demand in 2010.

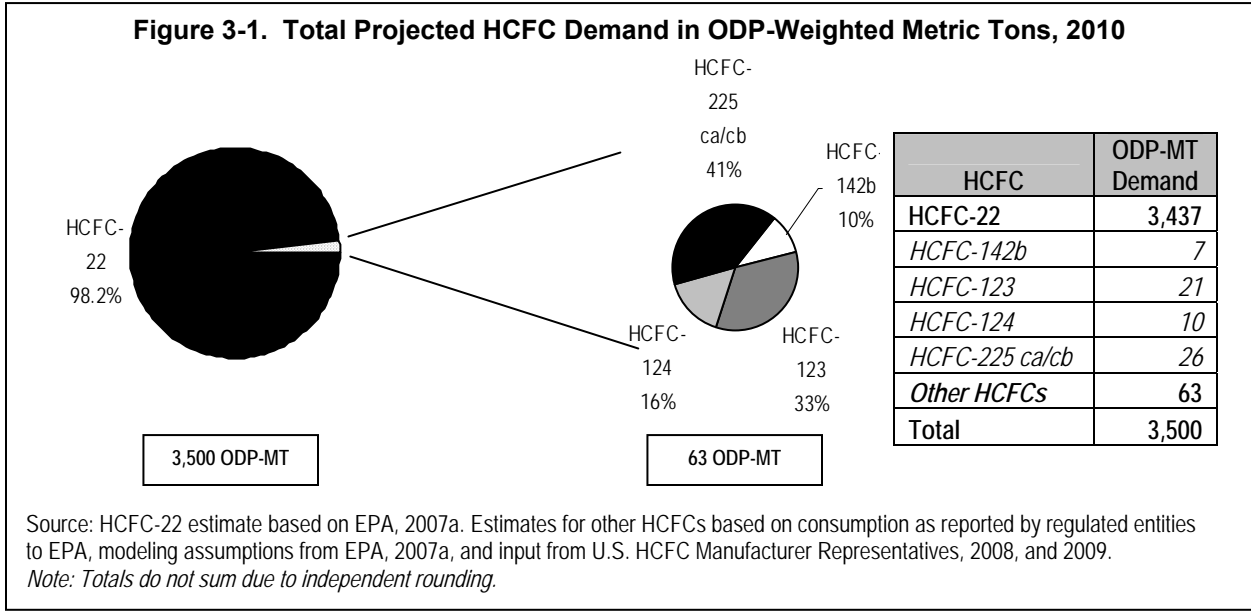

3.2 HCFCs Other than HCFC-22

As Figure 3-2 illustrates, the largest sector in 2007 using HCFCs (excluding HCFC-22) is the foam industry, followed by the refrigeration and AC, sterilants, and solvents industries. In 2010, the largest sector using HCFCs (excluding HCFC-22) is expected to be the refrigeration and AC industry (at 43%), followed by solvents industry, which includes aerosol solvents (at 41%), and the sterilants industry (16%). In comparison, the fire suppression and explosion protection sector is not projected to use significant amounts of HCFCs other than HCFC-22 in 2010 (i.e., 1%). Projections of HCFC use in the adhesives, coatings, and inks sector have not been estimated due to insufficient data available to validate any use of HCFCs, particularly HCFC-225 ca/cb in this sector.

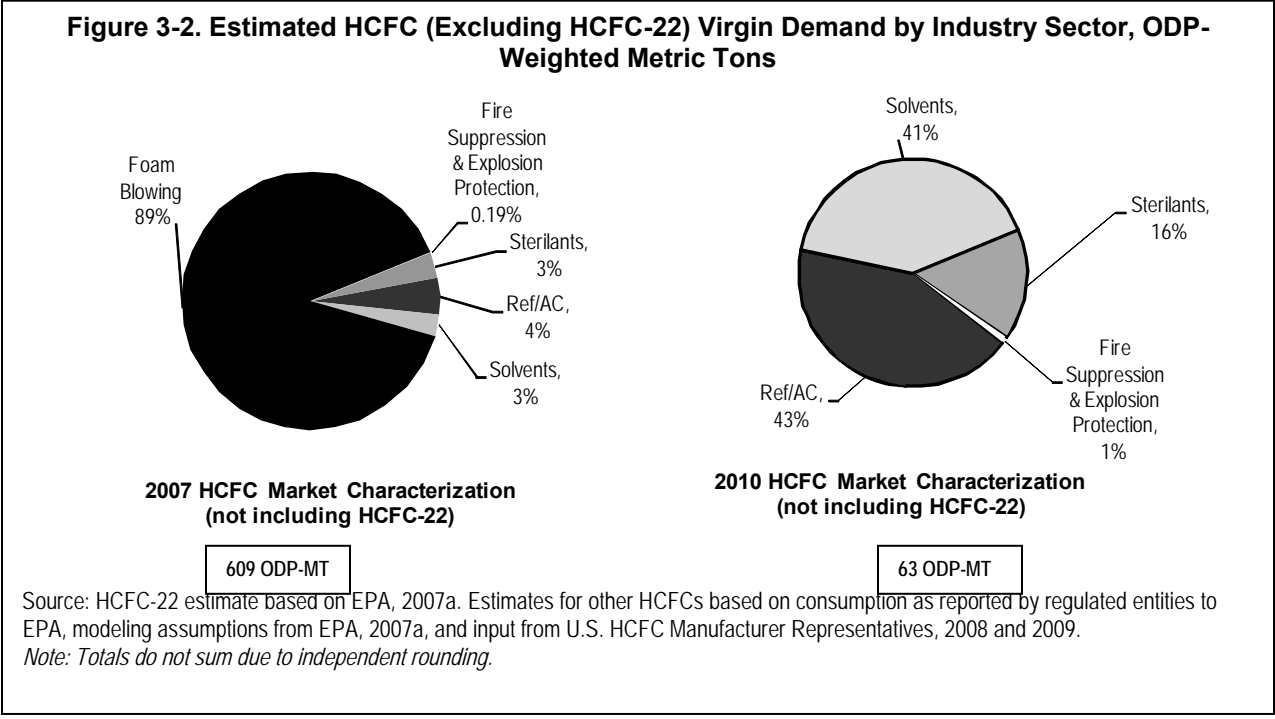

3.2.1 HCFC Use in Refrigeration and Air-Conditioning

Historically, CFCs were extensively used as refrigerants in the AC and refrigeration industries; by the 1970s, R-22 and R-502 (a blend of CFC-115 and R-22) were also well established refrigerants. On January 1, 1996, the production and import of CFC refrigerants, classified as Class I controlled (ozone-depleting) substances under the CAA Amendments of 1990, were phased out in the U.S. and other industrialized countries. HCFC refrigerants, which deplete the ozone layer to a lesser degree and are classified as Class II controlled substances under the 1990 CAAA, were found acceptable as substitutes for the controlled CFCs in some end use applications.

Air-Conditioning End-Uses

AC equipment can be categorized as either mobile or stationary.

Mobile air-conditioning systems include all forms of AC that provide cooling to passenger compartments in all types of moving vehicles. This category can be further broken down into motor vehicle air-conditioning for light-duty vehicles and other mobile air-conditioning systems.


- *Motor vehicle air-conditioning (MVAC)* includes AC in the passenger compartments of light duty vehicles—both cars and trucks (e.g., pick-up trucks, minivans, sport utility vehicles). A variety of refrigerant blends, some of them including HCFCs, are approved for use in the United States by EPA as replacements for R-12 in MVACs. However, these blends have not been endorsed by vehicle or system manufacturers for such use, thereby capturing only a small and declining share of the retrofit market, which consists mainly of R-134a. R-134a is not an ODS; therefore, the light-duty MVAC sector is not discussed further in this analysis.
- *Other mobile air-conditioning* includes AC in the passenger compartments of both buses (including school, transit, and tour buses) and trains (including heavy, light, and commuter rail, and Amtrak trains).¹⁰ Although most bus AC systems converted directly from R-12 to R-134a, the majority of the existing fleet of transit buses, tour buses, and trains continue to use R-22 in their AC systems.

Stationary air-conditioning includes a wide variety of equipment, further categorized into the following six categories.

- *Unitary air-conditioners and heat pumps* include both split systems and packaged units and are designed for air circulating, cooling, cleaning, and dehumidifying and sometimes heating in residential and small and large commercial applications.
- *Chillers* regulate the temperature and humidity in offices, hotels, shopping centers, and other large buildings. There are two major categories of chillers—centrifugal and positive displacement. Centrifugal chillers are centralized air conditioning systems typically used in larger buildings (e.g., offices, hotels, shopping centers, and other large buildings). Positive displacement chillers are smaller and may be water-cooled or air-cooled. There are three types of positive displacement chillers—1) reciprocating, 2) screw, and 3) scroll—each of which is named for the type of compressor employed.
- *Dehumidifiers* are mechanical refrigeration systems designed to remove moisture from the air by drawing air first over cold evaporator coils and then warm condenser coils, causing the moisture in the air to condense onto the cold coils. Examples include indoor pool dehumidifiers and portable units used to dehumidify basements.
- *Water and ground source heat pumps* use fluid circulated in a common piping loop as a heat source/sink to cool and heat air. Water-source heat pumps typically use water pumped from a well, lake, or stream as a heat source/sink. Direct expansion geothermal heat pumps circulate refrigerant through piping in the earth.
- *Window units*, also known as room air-conditioners, are small appliances used to condition the air in a single room.

¹⁰ For the purposes of this report, “other mobile AC” does not include ships, planes, RVs, or construction/farm equipment. In the case of boats, some R-22 is used in AC systems (UNEP 2003a), but this consumption is accounted for in this report under stationary AC equipment, such as packaged terminal units or chillers (Cold Ships 2009).

- *Packaged terminal units* are ACs or heat pumps that are mounted on the wall. They are often used in hotel rooms, dormitories, or classrooms.

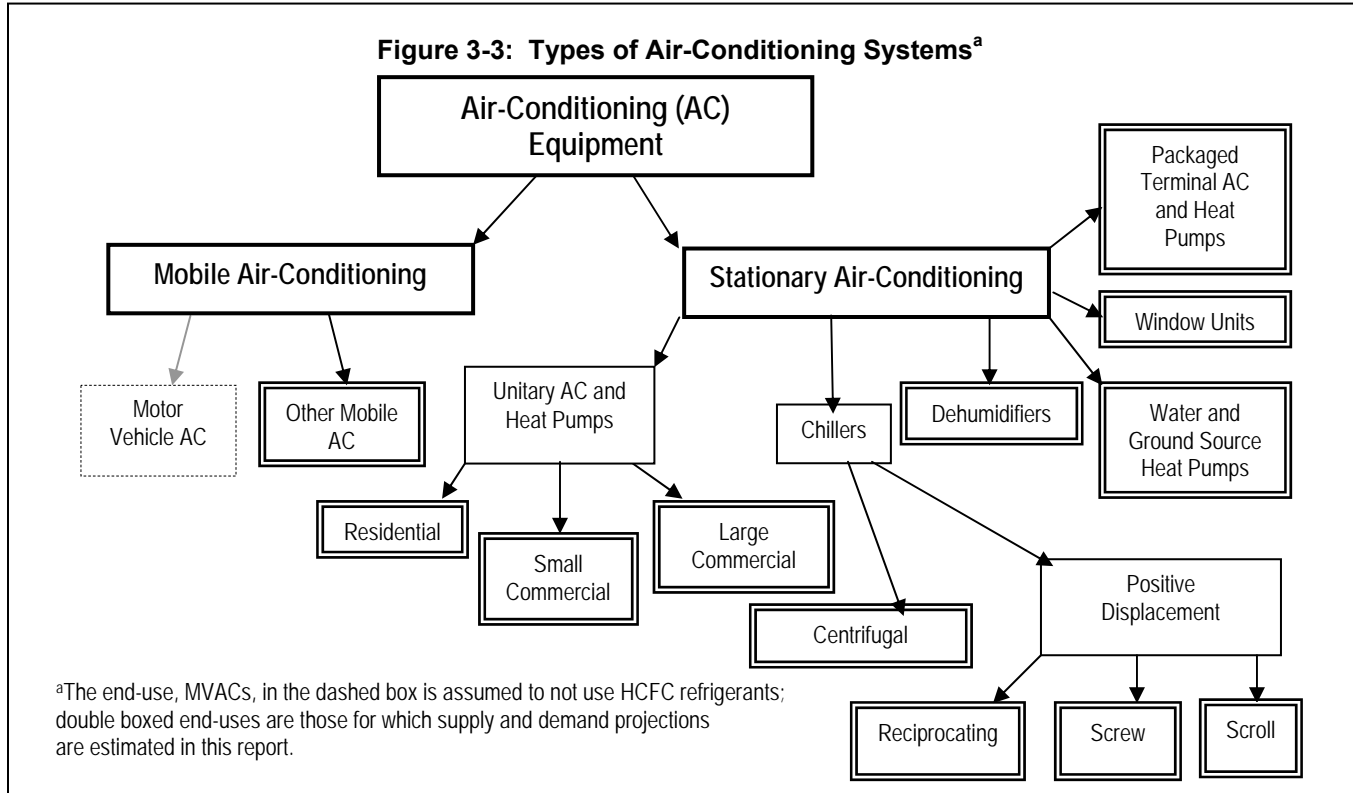

Refrigeration End-Uses

Refrigeration equipment can be broken down into four categories: domestic refrigeration, refrigerated transport, industrial process refrigeration, and commercial refrigeration.

Domestic refrigeration includes household refrigerators, household freezers, combination refrigerator/freezer units, and water coolers. For the majority of these equipment types, the refrigerants used do not typically include HCFCs or blends containing HCFCs. Older household freezers sometimes employed R-22; however, because these units are viewed as a minor part of the domestic refrigeration market, this end-use is not further analyzed in this report.

Refrigerated transport includes refrigeration used in equipment that moves products from one place to another and includes refrigerated ship holds, truck trailers (i.e., reefer trucks), railway freight cars, and other shipping containers.


Industrial process refrigeration (IPR) systems are complex, customized systems used to cool process streams in the chemical, food processing, pharmaceutical, petrochemical, and manufacturing industries. This sector also includes industrial ice machines, equipment used directly in the generation of electricity, and ice rinks.

Commercial refrigeration can be further broken down into three end-uses:

- *Cold storage warehouses* are refrigeration systems with varying designs and charge sizes. They are used to store meat, produce, dairy products, and other perishable goods before and after food processing.
- *Retail food systems* are used to refrigerate food in commercial retail establishments, such as grocery stores. These systems can be classified as either centralized or self-contained units. Centralized retail food systems, also known as remote systems, consist of a series of

compressors located in a remote machinery room, providing a cooling medium to display cabinets and cold storage rooms in other parts of the building. The most common form of centralized systems circulate refrigerant throughout the store. Alternatives to these types of systems include secondary loop and distributed systems that for the most part use HFC refrigerant blends. Self-contained retail food units, also referred to as stand-alone systems, are factory produced with all the components integrated. Examples include walk-in refrigerators/coolers/freezers, roll-in refrigerators/freezers, under-counter refrigerators/freezers, reach-in refrigerators/freezers, wine and beer coolers, ice cream machines, beverage vending machines, and a variety of stand-alone upright or horizontal display cases (e.g., beverage merchandisers, deli cases).

- *Ice makers* are factory-made units used in commercial establishments to produce ice for consumer use (e.g., in hotels, restaurants, and convenience stores). Ice makers are not further analyzed in this report because they do not typically employ HCFCs or blends containing HCFCs.

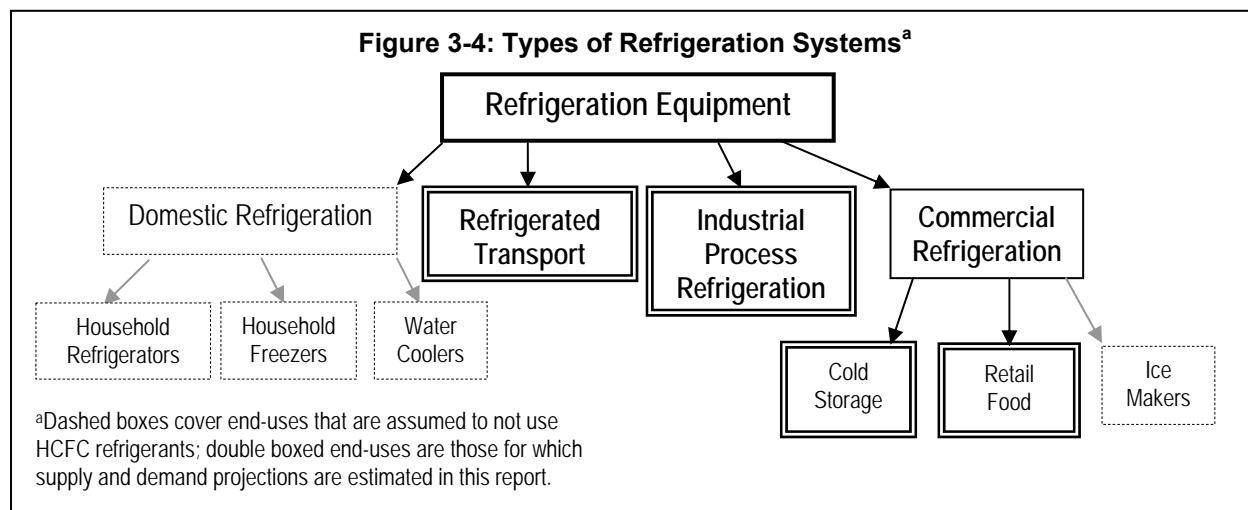

HCFC-22 represents the majority of the refrigeration and AC market, however, other HCFCs are also used by the refrigeration and air-conditioning industries. A brief discussion of the use of HCFC-142b, HCFC-123, HCFC-124, and HCFC-21 as refrigerants is provided below; in addition, Box 3-2 presents a brief summary of HCFCs uses in refrigerant blends.¹¹

The production and import of virgin HCFC-123, HCFC-124, and HCFC-21 is scheduled for phaseout in 2020 for use in new AC and refrigeration equipment, and in 2030 for use in AC and refrigeration equipment manufactured before January 1, 2020. The phaseout schedule for HCFC-142b is the same as that for HCFC-22—beginning January 1, 2010, production and import of HCFC-142b will be limited solely for use in equipment manufactured prior to January 1, 2010. The final phaseout for HCFC-142b (and HCFC-22) is on January 1, 2020, and for all HCFCs on January 1, 2030. Table

Box 3-2: Summary of HCFCs used in Refrigerant Blends

Often refrigerants are formulated with several substances, such as hydrofluorocarbons (HFCs) or hydrocarbons (e.g., propane, butane, isobutane). HCFC-22 is used as both a stand-alone refrigerant and a component of refrigerant blends. Table 3-2 presents the composition of the more common refrigerant blends containing HCFCs.

Table 3-2: Compositions of Common HCFC Refrigerant Blends

Blend	R-22	R-124	Other
R-401A	53%	34%	13% HFC-152a
R-402A	38%		60% HFC-125, 2% propane (R-290)
R-502	48.8%		51.2% CFC-115

End-uses in which these refrigerant blends containing HCFCs are currently used are presented in the table below.

Table 3-3: HCFC-Containing Refrigerant Blends by End-Use

Refrigeration Equipment Type	Refrigerant Type		
	R-401A	R-402A	R-502
Retail Food		X	X
Cold Storage			X
IPR	X		
Refrigerated Transport	X	X	X

¹¹ HCFC consumption data presented in this analysis include quantities consumed in blends by employing the percent composition of the corresponding HCFC constituent(s) of that blend. In order to accurately portray the number of units containing HCFC blends, however, blends are not disaggregated when presenting the number of units of equipment (i.e., a unit running on an HCFC-containing blend counts as one unit).

3-4 presents projected estimates of HCFC refrigerant demand (excluding HCFC-22) for the refrigeration and AC industries in five year increments from 2010 to 2020.

Table 3-4: Projected HCFC-124, HCFC-123, and HCFC-142b Demand for Refrigeration and Air-Conditioning, 2010-2020, (Metric Tons)

HCFC	2010	2015	2020
HCFC-124	<5	<5	0
HCFC-123	1,000	1000	600
HCFC-142b	100	0	0

Source: Based on consumption as reported by regulated entities to EPA, modeling assumptions from EPA, 2007a, and input from U.S. HCFC Manufacturer Representatives, 2009.

- HCFC-124** — HCFC-124 is minimally used as a refrigerant; its primary use as a refrigerant is in blends, mainly R-401A, in industrial process and transport refrigeration equipment. As a stand-alone refrigerant, it has found some niche applications that reach high condensing temperatures as well as an alternative for CFC-114 in some naval chillers. The production and import of virgin HCFC-124 is scheduled for phaseout in 2020 for use in new AC and refrigeration equipment, and in 2030 for use in existing AC and refrigeration equipment. However, its use in blends R-401A, R-401B, R-409A, R-414A, R-414B and others is constrained because those blends also contain R-22. HCFC-124 is also a component of R-416A, which does not contain any other ODS.
- HCFC-123** — HCFC-123 is used in the refrigeration and AC sector mainly in centrifugal chillers for industrial process refrigeration and commercial comfort AC. The production and import of virgin HCFC-123 is scheduled for phaseout in 2020 for use in new AC and refrigeration equipment, and in 2030 for use in AC and refrigeration equipment manufactured before January 1, 2020.
- HCFC-142b** — In addition to being used in the foam industry, HCFC-142b is also used as a refrigerant, but only as a constituent of a few refrigerant blends. While HCFC-142b refrigerant blends are approved as acceptable substitutes for CFC refrigerants in some end-uses, their use is small and declining. R-409A (composed of HCFC-22, HCFC-124, and HCFC-142b) is the most common refrigerant blend using HCFC-142b. However, sales of R-409A are rapidly declining, and are being replaced with R-404A (composed of HFC-125, HFC-134a, and HFC-143a) (U.S. HCFC Manufacturer Representatives 2008). Based on industry estimates, it is assumed that current demand for HCFC-142b as a refrigerant will continue to decrease to approximately 100 metric tons in 2010 and to zero by 2015 (U.S. HCFC Manufacturer Representatives 2008).
- HCFC-21** — HCFC-21 currently is used by NASA as a refrigerant in the cooling loops of the space shuttle fleet (NASA 2008). Research indicates that NASA is the only industrial user of HCFC-21. NASA's plan is to use the HCFC-21 until shuttle fly-out (2010) and to employ HCFC-21 alternatives in the next generation of space vehicles (NASA 2008). For this analysis, it is assumed that demand for HCFC-21 beyond 2010 is zero; however, it is conceivable that NASA may access in-house stockpiles or require small quantities of new production of the refrigerant for potential future uses.

4. Projected R-22 Scenarios

Section 4 presents projections of the number of R-22-containing units of equipment and the associated servicing needs for 2010, 2015, and 2020. R-22 scenarios were developed by investigating various trends that are expected to affect future market needs. Such trends include changes in charge sizes, the transition to alternative refrigerants, changes in refrigerant recovery and reuse practices, and R-22 economics.

- Section 4.1 summarizes the projected market size of equipment containing R-22 beyond 2010 in the United States.
- Section 4.2 estimates the quantity of both virgin (i.e., consumption as defined under the Montreal Protocol) and recovered R-22 that will be required to service existing equipment beyond 2010. This section also provides a summary and examination of the final R-22 allocations set by EPA for 2010 through 2014.
- Section 4.3 discusses the factors that may affect estimates of the installed base and servicing needs for R-22 equipment.

Appendix B presents further detail on the estimates provided in Section 4, disaggregating R-22-containing equipment and overall service demand estimates into end-use specific projections.

4.1 R-22 Equipment Used Beyond 2010

The majority of R-22 equipment that is projected to be in use (i.e., within the installed base) from 2010 onward will be used for AC applications, including window units, packaged terminal units, residential and commercial unitary AC, chillers, dehumidifiers, water and ground source heat pumps, and non-light duty mobile AC in buses, trains, etc. As presented in Table 4-1, EPA estimates that approximately 145.6 million units of all such types of AC equipment will be in use in 2010, decreasing from 2010 levels by about 41 percent by 2015, and 86 percent by 2020. EPA also estimates that in 2010 there will be approximately 3.8 million units of refrigeration equipment, including retail food, industrial process refrigeration, and transport refrigeration equipment (but not including cold storage warehouses). The installed base of refrigeration equipment is projected to decrease from 2010 levels by about 44 percent by 2015 and 75 percent by 2020. EPA developed these estimates based on the 2007 version of EPA's Vintaging Model (EPA 2007a). Appendix A provides more detail on the methodology used to develop these projections. Appendix B provides projections disaggregated by end-use.

Table 4-1: Projected Number of R-22 Units (2010-2020)^{a,b}

Equipment Type	2010	2015	2020
Total AC	145,633,300	86,049,100	20,615,300
Total Refrigeration	3,779,600	2,114,800	930,300
Total	149,412,900	88,163,900	21,545,600

^a Including units that use blends containing HCFC-22.

^b Because the estimates for cold storage warehouses are expressed in cubic feet, this equipment type is not included in this table. The projected stock of cold storage warehouse space using R-22 is 231 million ft³ in 2010, 133 million ft³ in 2015, and 61 million ft³ in 2020. Source: Based on modeling assumptions using EPA, 2007a.

4.2 Projected R-22 Servicing Needs

AC and refrigeration equipment commonly requires servicing, which may include adding refrigerant to account for refrigerant losses that occur over time.¹² While the production and import of HCFC-22 is banned for use in new equipment in 2010, it will still be permitted for servicing and maintenance purposes for equipment manufactured prior to January 1, 2010. Table 4-2 presents projected R-22 demand (including that used in blends) for servicing equipment in 2010, 2015, and 2020. These estimates were

¹² The servicing need estimates projected in this analysis include refrigerant to replace quantities that leak from operating equipment as well as *de minimis* losses that may occur while servicing operating equipment.

developed based on the EPA's Vintaging Model (EPA 2007a). Appendix A provides further detail on the methodology used to develop these projections. Appendix B provides servicing demand projections disaggregated by end-use.

As presented in Table 4-2, it is projected that in 2010, approximately 62,500 metric tons of R-22 will be required to service AC and refrigeration equipment, of which the majority—41,700 metric tons (67%)—will be used to service AC systems. EPA projects that servicing demand for R-22 in AC and refrigeration equipment will decrease to 38,800 metric tons by 2015 and 18,200 metric tons by 2020. Both the 2015 and 2020 projections of servicing demand exceed the U.S. consumption cap for virgin HCFCs for these years; however, a portion of the servicing needs can be met by using recovered refrigerant, thus decreasing the need for virgin R-22.


Table 4-2: Projected R-22 Servicing Demand (2010-2020) (Metric Tons)

Equipment Type	2010	2011	2012	2013	2014	2015	2020
Total AC	41,700	38,600	35,600	32,400	29,200	25,900	11,300
Total Refrigeration	20,800	19,300	17,600	16,000	14,400	12,800	7,000
Overall Total	62,500	57,900	53,200	48,400	43,600	38,800	18,200

Source: Based on data analysis using EPA, 2007a.
 Note: Totals do not sum due to independent rounding.

Figure 4-1 displays the breakdown of R-22 servicing demand by AC and refrigeration equipment type for 2010 and 2015. As shown, residential AC, retail food refrigeration equipment, and small commercial AC are projected to account for the majority of the R-22 demand in 2010 and in 2015.

Figure 4-1. R-22 Demand for Servicing Refrigeration and AC Equipment, by End-Use^a

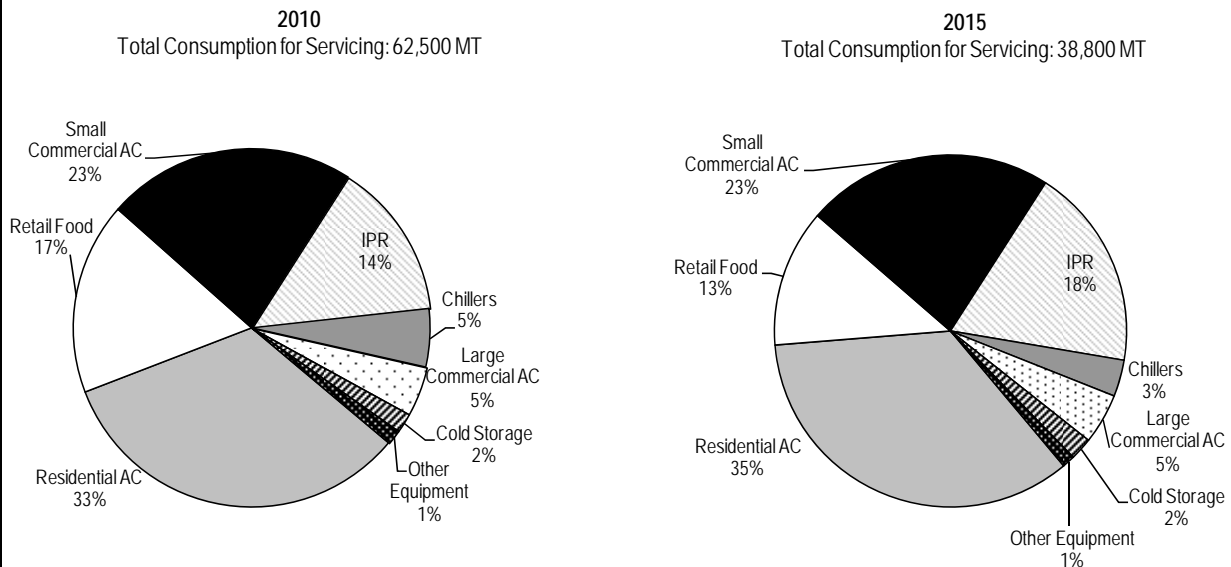

Source: EPA's Vintaging Model (VM IO file_11-12-07_ALL)

^a“Other Equipment” includes window units, packaged terminal units, water and ground source heat pumps, other mobile AC, and refrigerated transport.

4.2.1 R-22 Sources

Starting in 2010, only existing sources of R-22 and a controlled quantity of virgin R-22 (limited through allowance allocations distributed by EPA) will be available to the AC and refrigeration industry to meet servicing demand.¹³ Existing sources of R-22, which can offset the need for virgin R-22, include:

1. R-22 that is recovered and either recycled or reclaimed before reuse. Under EPA regulations at 40 CFR 82.156, refrigerants containing HCFCs must be recovered. After the recovery process, the refrigerant held in the storage container may be:
 - a. Recycled (i.e., cleaned through the use of recycling equipment) and recharged back into the equipment from which it came;
 - b. Recycled and used in other equipment of the same owner;
 - c. Reclaimed (shipped to an EPA-certified reclaimer) prior to resale to a new owner; or
 - d. Destroyed through the use of environmentally-acceptable technologies that meet the definition of destruction in 40 CFR 82.3 (i.e., liquid injection incineration, reactor cracking, gaseous/fume oxidation, rotary kiln incineration, cement kilns, and radio frequency plasma) (EPA 2003b).
2. Import of used R-22 that companies can acquire, if the import is preauthorized by EPA, through a petition process.
3. The conversion of allocations from other chemicals to R-22 as allowed under the final allocation rule.

Each of these existing sources of R-22 is described in more detail below.

Recycled R-22

Recovered R-22 is often recycled prior to being used again in equipment. The recycling process cleans the refrigerant for reuse without meeting all the requirements of reclamation, discussed further below. HCFC refrigerants are commonly recovered from a piece of equipment, adequately cleaned, and then recharged into the same piece of equipment using a recycling device (EPA 2003b).

EPA regulations allow for the recharge of used refrigerant without subsequent reclamation for refrigerants that are recovered and charged back into the same appliance or to another appliance if those appliances have the same owner. Several companies, such as supermarket chains, employ recycling plans through which the refrigerant is recovered when dismantling or converting one establishment's equipment and reused to service equipment at another facility with the same ownership. EPA does not collect data on the amount of R-22 that is recycled.

Reclaimed R-22

Refrigerants that are resold to be used in other equipment must be reclaimed to a standard level of purity based on the ARI Standard 700, to ensure sufficient purity of the reclaimed refrigerant. EPA certified reclaimers are approved to reprocess used refrigerant to at least the purity level based on the ARI 700 Standard.

Industry representatives have indicated that the current use of reclaimed HCFCs is minimal because virgin R-22 is inexpensive. In 2008, the amount of pure R-22 reclaimed by EPA-certified reclaimers totaled approximately 4,556 metric tons, or 10.05 million pounds (EPA 2009). Fewer quantities of the refrigerant blend R-502, composed of 48.8 percent R-22 and 51.2 percent CFC-115, are also being reclaimed, with only 40 metric tons, or 88,040 pounds reported for 2008 (EPA 2009).¹⁴ Reclamation data from 2000 to 2008 is presented in Table 4-3 below.

¹³ Virgin R-22 may be stockpiled; however, the extent to which this activity may occur is unknown. A discussion on stockpiling plans is covered in Section 4.3.3.

¹⁴ Feedback received from stakeholders in response to the NODA indicated that because R-502 is an azeotropic blend, it is difficult and expensive to separate R-22 from the blend, and hence such separation is very limited (National Refrigerants 2006).

Table 4-3: Reclaimed R-22 by Year (Metric Tons)

	2000	2001	2002	2003	2004	2005	2006	2007	2008
R-22	3,218	1,960	2,230	1,976	3,280	2,800	3,872	3,716	4,556
R-502	281	113	150	41	48	25	52	34	40

Source: EPA 2009.

As 2010 approaches, the price of R-22 has increased and it is expected that the reclamation of R-22 will also continue to increase. Comments received during the comment period to EPA's proposed rule, *Adjustments to the Allowance System for Controlling HCFC Production, Import, and Export* (73 FR 78680), also indicate the support for increasing reclamation. For example, distributors are increasingly offering refrigerant recovery services and the certified reclaimers community is offering more aggressive reclamation programs (HARDI 2009). Additionally, Arkema noted that they recently launched a new incentive-based national reclaim program for their distributors (Arkema 2009). A more detailed discussion on R-22 economics and recovery and reuse practices is provided in Section 4.3, "Factors Affecting Projections."

Imports of Used R-22

Unlike virgin HCFCs, used HCFCs are not subject to Montreal Protocol restrictions on consumption.¹⁵ However, in creating the allocation system for the use of HCFCs, EPA developed a shipment-by-shipment petition process for importing used HCFCs as described in 40 CFR 82.24 (EPA 2003a). The petition process ensures that HCFCs have been used (and were not newly produced) prior to import. For each shipment of used HCFC greater than five pounds, the importer needs to petition EPA at least 40 working days before the shipment is to leave the country of export. EPA reviews and verifies data in the petition and issues either an objection notice or a non-objection notice to the prospective importer.

Currently, the quantity of used R-22 imports is minimal; however, recently the Agency has received inquiries from additional companies interested in importing used R-22. The projections in this report do not specifically include the potential future quantities obtained from the import of used R-22 because this analysis indicates that there is sufficient potential to offset future demand for virgin material using domestic sources.

Interpollutant Transfers of Allowances

Another source of R-22 can result from allowance holders transferring their allowances from one HCFC to HCFC-22, which is permitted on an annual and ODP-weighted basis. Section 607 of the Clean Air Act permits year-by-year inter-pollutant transfers of production and consumption allowances. Section 607(b) requires that EPA's rules are to permit "a production allowance for a substance for any year to be transferred for a production allowance for another substance for the same year." For example, converting 100 allowances of HCFC-123 (with an ODP of 0.02) would result in 36.36 allowances of HCFC-22 (with an ODP of 0.055). Allowance holders have converted their allowances to meet market demand historically; this practice is expected to continue, however, the projections in this analysis do not quantitatively assess the potential future quantities that could be obtained from converted allocations.

4.2.2 Meeting R-22 Service Demand

Although limited production of virgin HCFC-22 will be allowed to service equipment until 2020 through production and consumption allowances, the analysis performed for this report indicates that, with industry effort, a significant portion of the demand for HCFC-22 for servicing can be met with previously used refrigerant that is recovered and then recycled or reclaimed. Increased amounts of recovered R-22 are a source made available as a result of the venting prohibition EPA has established under Section 608 of CAA (EPA 2004a). To determine the potential amounts of used refrigerant available to service

¹⁵ "Used controlled substances" are controlled substances that have been recovered from their intended use systems (which may include controlled substances that have been, or may be subsequently, recycled or reclaimed) (EPA 2003a).

equipment, EPA used its Vintaging Model to develop five theoretical scenarios to estimate: 1) the projected amount of recovered R-22 potentially available to meet projected servicing demand of other equipment still in use; 2) the subsequent remaining quantity needed to satisfy the rest of that demand; and 3) the extent to which the remaining demand can be met with allowable quantities of virgin R-22 production. This section presents two of these scenarios and Appendix C presents the other three, which represent the lower and higher recovery rates analyzed for this report. The two scenarios presented in this section are closer to the recovery rate necessary to meet demand between 2010 and 2014 under EPA's final allocation rule. In addition, this section presents an analysis of EPA's actual allocation amount and the associated necessary rate of recovered material.

In developing the scenarios using the Vintaging Model, EPA projected the amount of recovered R-22 based on the quantity available from decommissioned or retrofitted equipment. While refrigerant recovered from equipment during servicing can also be available for reuse in other equipment, this potential source is not included in these scenarios for several reasons. First, it is projected to be minimal in net terms (i.e., refrigerant recovered during service would likely be returned to the same equipment from which it was recovered). Also, according to industry sources, refrigerant recovered during service events primarily originates from commercial and industrial equipment (i.e., equipment with relatively large charges). Refrigerant is rarely recovered during the servicing of small equipment because these units tend not to be overcharged or leaking (Home Energy Center 2006, Airgas 2006). Additionally, only a small portion of all servicing events conducted on commercial and industrial equipment involve the refrigerant circuit, and when recovering refrigerant to perform repairs is necessary, often only a section of the refrigerant charge is isolated and recovered, not the entire charge.

To estimate refrigerant recovery and reuse, EPA assumed that a certain percentage of refrigerant is recovered from decommissioned or retrofitted equipment.¹⁶ It is important to note that not all refrigerant is assumed to be recovered. While EPA has regulations prohibiting intentional venting, for the purposes of this analysis it is appropriate to create scenarios that assume less than the full charge of refrigerant is recovered at equipment end-of-life. For example, in many instances, equipment is disposed of after a catastrophic failure, which might have resulted in a large or even complete loss of the refrigerant. Also, when equipment is removed from service, there can be losses associated with previous leaks and during attempts to recover the remaining refrigerant. It is also possible that owners or technicians disposing of a piece of equipment might not comply with the regulations and might vent the refrigerant.

This analysis then assumes that the entire pool of recovered refrigerant re-enters the market (see Appendix A for more details) and hence offsets the demand for virgin R-22. The two scenarios investigated can be summarized as follows:

- Scenario 20 assumes that by 2010, 20 percent of refrigerant from retired or retrofitted equipment is recovered and available for reuse in equipment (i.e., a 20 percent recovery rate). The remaining 80 percent is not available for reuse.
- Scenario 50 assumes that by 2010, 50 percent of refrigerant from retired or retrofitted equipment is recovered and available for reuse in equipment (i.e., a 50 percent recovery rate). The remaining 50 percent is not available for reuse.

Tables 4-4 and 4-5 summarize the two recovery scenarios in comparison to the phaseout caps under the Montreal Protocol and the actual U.S. HCFC consumption allocations for HCFC-22.

¹⁶ To calculate the amount recovered, the Vintaging Model assumes equipment contains a full charge at disposal and assumes a certain percent of that is recovered. It does not take into account a) refrigerant destroyed after equipment is decommissioned or b) any stockpiling of recovered refrigerant beyond a one-year timeframe. See Appendix A for further details.

Table 4-4 summarizes the projections under the first recovery scenario that assumes practices that yield a recovery rate of 20 percent. These projections are compared to the U.S. HCFC consumption cap. As shown the estimated virgin R-22 supply needed in 2010 can be adequately met with a portion of the HCFC consumption cap remaining. A 20 percent recovery rate would meet 9 percent of servicing demand in 2010, 23 percent in 2015, and 46 percent in 2020. Under this scenario, the quantity of recovered R-22 projected to be available in 2015 and 2020 plus the amount of virgin R-22 production allowable under the cap remains inadequate to meet the projected servicing demand, consequently leading to R-22 supply shortfalls beginning in 2015.

**Table 4-4: Scenario 20: 20% Recovery Rate:
 Summary of Projected R-22 Supply, Demand, and Shortfall (R-22 Metric Tons)**

	2010	2011	2012	2013	2014	2015	2020
Projected R-22 Servicing Demand Summary^a							
Total R-22 servicing demand	62,500	57,900	53,200	48,400	43,600	38,800	18,200
Modeled R-22 supplied from recovery/reuse	5,900	8,200	8,300	8,500	8,600	8,800	8,300
% of total R-22 servicing demand supplied by modeled recovery/reuse	9%	14%	16%	18%	20%	23%	46%
Modeled R-22 supplied from virgin R-22	56,600	49,700	44,900	40,000	34,900	30,000	9,900
Comparison to HCFC Consumption Cap							
Virgin R-22 supply available under cap ^b	69,273	69,273	69,273	69,273	69,273	27,709	0 ^d
Modeled R-22 supplied from virgin R-22	56,600	49,700	44,900	40,000	34,900	30,000	9,900
Additional virgin R-22 allowable under cap ^c	12,673	19,573	24,373	29,273	34,373	-2,291	-9,900

^a Based on modeling assumptions using EPA, 2007a.

^b Expressed in R-22 un-weighted metric tons (calculated using an ODP of 0.055 for HCFC-22).

^c Negative values represent a shortfall of R-22 available under the consumption cap and are in bold.

^d In 2020, a cap equal to 0.5 percent of the U.S. consumption baseline remains; however, the phaseout schedule in 2020 prevents any allocation of the remaining baseline to R-22.

Table 4-5 summarizes the projections under the second recovery scenario that assumes practices that yield a recovery rate of 50 percent from retired or converted equipment. A 50 percent recovery rate would meet 24 percent of servicing demand in 2010, 57 percent in 2015, and 100 percent in 2020. Projections under this scenario indicate that sufficient supplies of refrigerant would be available to service equipment if 50 percent of refrigerant from retired equipment is recovered and re-enters the pool of refrigerant available to meet demand.

**Table 4-5: Scenario 50: 50% Recovery Rate:
 Summary of Projected R-22 Supply, Demand, and Shortfall (R-22 Metric Tons)**

	2010	2011	2012	2013	2014	2015	2020
Projected R-22 Servicing Demand Summary^a							
Total R-22 servicing demand	62,500	57,900	53,200	48,400	43,600	38,800	18,200
Modeled R-22 supplied from recovery/reuse	14,800	20,500	20,800	21,200	21,600	22,000	18,200
% of total R-22 servicing demand supplied by modeled recovery/reuse	24%	35%	39%	44%	50%	57%	100%
Modeled R-22 supplied from virgin R-22	47,700	37,400	32,400	27,300	22,000	16,800	0
Comparison to HCFC Consumption Cap							
Virgin R-22 supply available under cap ^b	69,273	69,273	69,273	69,273	69,273	27,709	0 ^c
Modeled R-22 supplied from virgin R-22	47,700	37,400	32,400	27,300	22,000	16,800	0
Additional virgin R-22 allowable under cap	21,573	31,873	36,873	41,973	47,273	10,909	0

^a Based on modeling assumptions using EPA, 2007a.


^b Expressed in R-22 un-weighted metric tons (calculated using an ODP of 0.055 for HCFC-22).


^c In 2020, a cap equal to 0.5 percent of the U.S. consumption baseline remains; however, the phaseout schedule in 2020 prevents any allocation of the remaining baseline to R-22.

Figures 4-2a and 4-2b illustrate the projected supply of recovered refrigerant available to meet demand, as well as its subsequent importance in meeting future demand, resulting from the two recovery scenarios. Depending on the recovery practice employed, the potential exists for either a surplus or shortfall to occur in 2015 (Scenario 50 shows a surplus while Scenario 20 shows a shortfall).

As the market prepares for the 2010 milestone in the HCFC phaseout, it is important to ensure that R-22 is recovered, recycled, stockpiled, or reclaimed to maximize available R-22 supply and avoid potential shortages. Increased reuse of R-22 will be needed to satisfy future servicing needs that will not be met through virgin supplies alone. The scenario presented above that avoids shortfalls throughout 2010 to 2020 projects recovered R-22 to be approximately 14,800 metric tons in 2010, followed by 22,000 metric tons in 2015 and 18,200 metric tons in 2020 (i.e., Scenario 50). A lower recovery rate scenario also could provide a no-shortfall situation. A recovery rate scenario of 26 percent is the lowest recovery rate necessary to adequately meet demand starting in 2015. A 26 percent recovery rate will yield 29 percent of total servicing demand in 2015.

For comparison, as noted in Table 4-3, in 2008 a total of 4,556 metric tons of HCFC-22 was reclaimed, which amounts to approximately five percent of total HCFC-22 consumption in 2008 (according to consumption data as reported by regulated entities to EPA). (The actual amount of refrigerant recovered, recycled, and reused without being reclaimed is not known.) If the 2008 level of reclamation remains constant, reclaimed R-22 would fulfill only 31 percent of the modeled R-22 supplied from recovery/reuse as projected to be available under Scenario 50 in 2010, dropping to approximately 21 percent and 25 percent in 2015 and 2020, respectively (see Table 4-5). A further discussion on recovery practices is provided in Section 4.3.3.

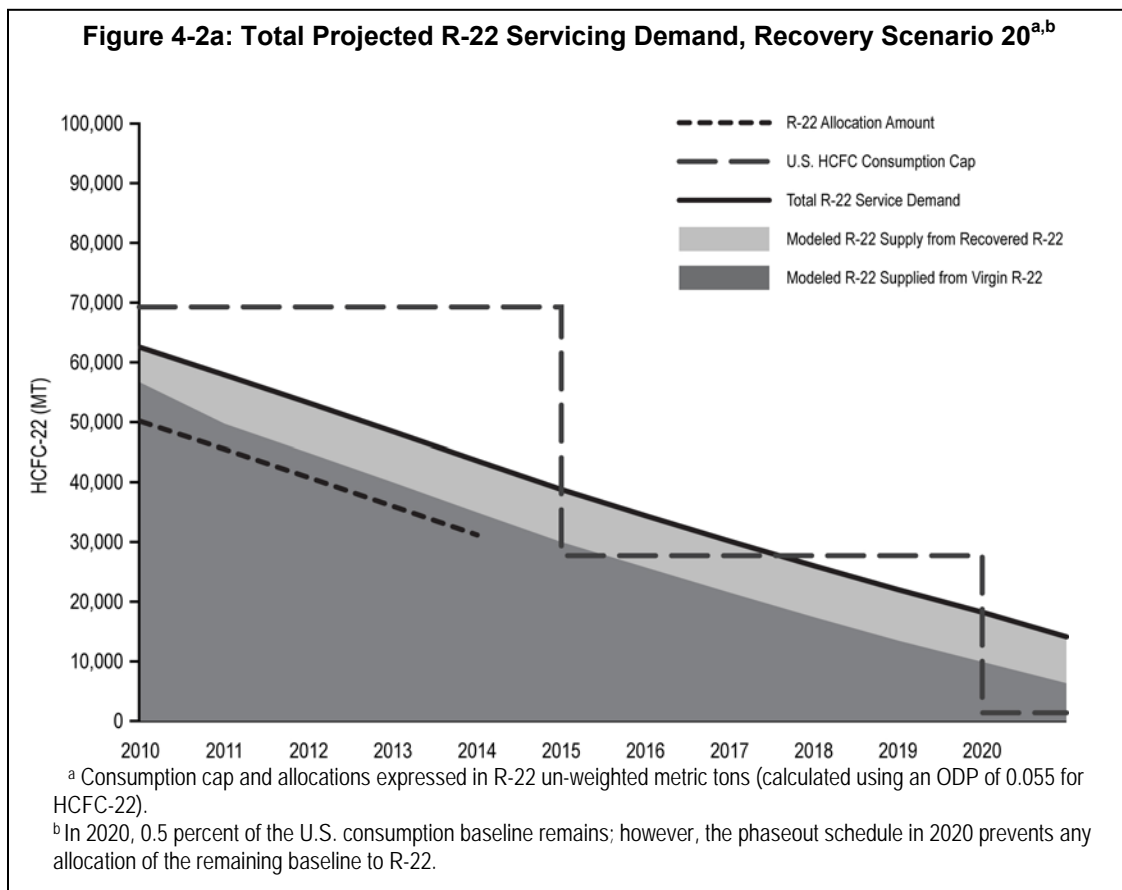

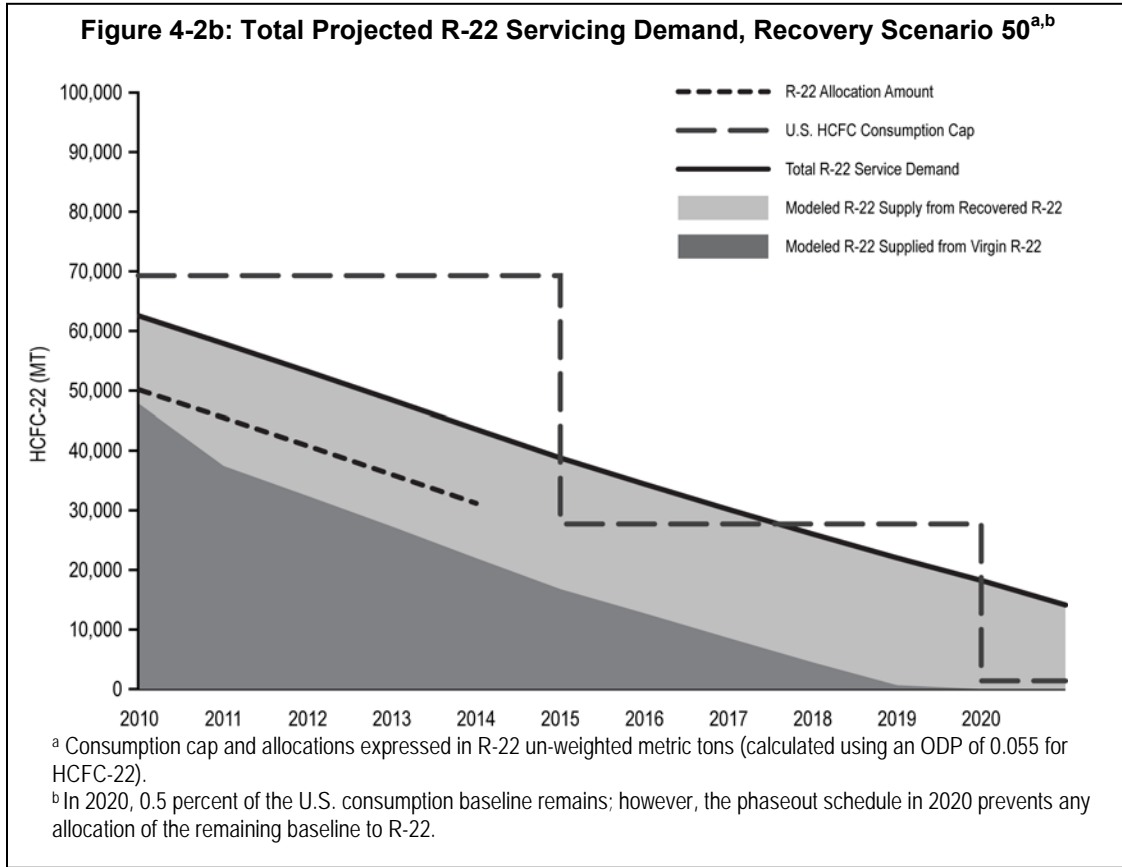

4.2.3 EPA’s Allocations of R-22 for 2010 through 2014


Based in part on the results of these scenarios, EPA has determined R-22 consumption allocations for years 2010 to 2014; the quantity allocated annually for these years is shown in Table 4-6. Although EPA has not yet allocated HCFC consumption allowances for 2015, the R-22 allocation can be no more than 27,709 metric tons. Therefore, based on estimated servicing demand, recovery can be no less than 11,091 metric tons, or, at least 29 percent of servicing demand (i.e., estimated at 38,800 metric tons) in that year. Table 4-6 also illustrates the quantity of R-22 required from recovery/reuse, which represents the difference between estimated demand and the allocation quantity for each year. This quantity of R-22 required from recovery/reuse, estimated at 12,500 metric tons annually from 2010 to 2014, represents 20 percent of the total R-22 servicing demand in 2010 growing to 29 percent in 2014. Figure 4-3 is a graphical representation of R-22 servicing demand from 2010 to 2020 and R-22 supply from 2010 to 2014 based on the allocations set by EPA.

Table 4-6: Actual R-22 Consumption Allocations (R-22 Metric Tons)

	2010	2011	2012	2013	2014	2015	2020
Total R-22 servicing demand	62,500	57,900	53,200	48,400	43,600	38,800	18,200
Total R-22 allocation amount	50,000	45,400	40,700	35,900	31,100	TBD ^a	0 ^b
R-22 required from recovery/reuse	12,500	12,500	12,500	12,500	12,500	TBD	18,200
% of total R-22 servicing demand supplied by R-22 required from recovery/reuse	20%	22%	23%	26%	29%	TBD	100%

^a TBD: to be determined. EPA has not yet issued allowances from 2015 through 2019.

^b In 2020, a cap equal to 0.5 percent of the U.S. consumption baseline remains; however, the phaseout schedule in 2020 prevents any allocation of the remaining baseline to R-22.

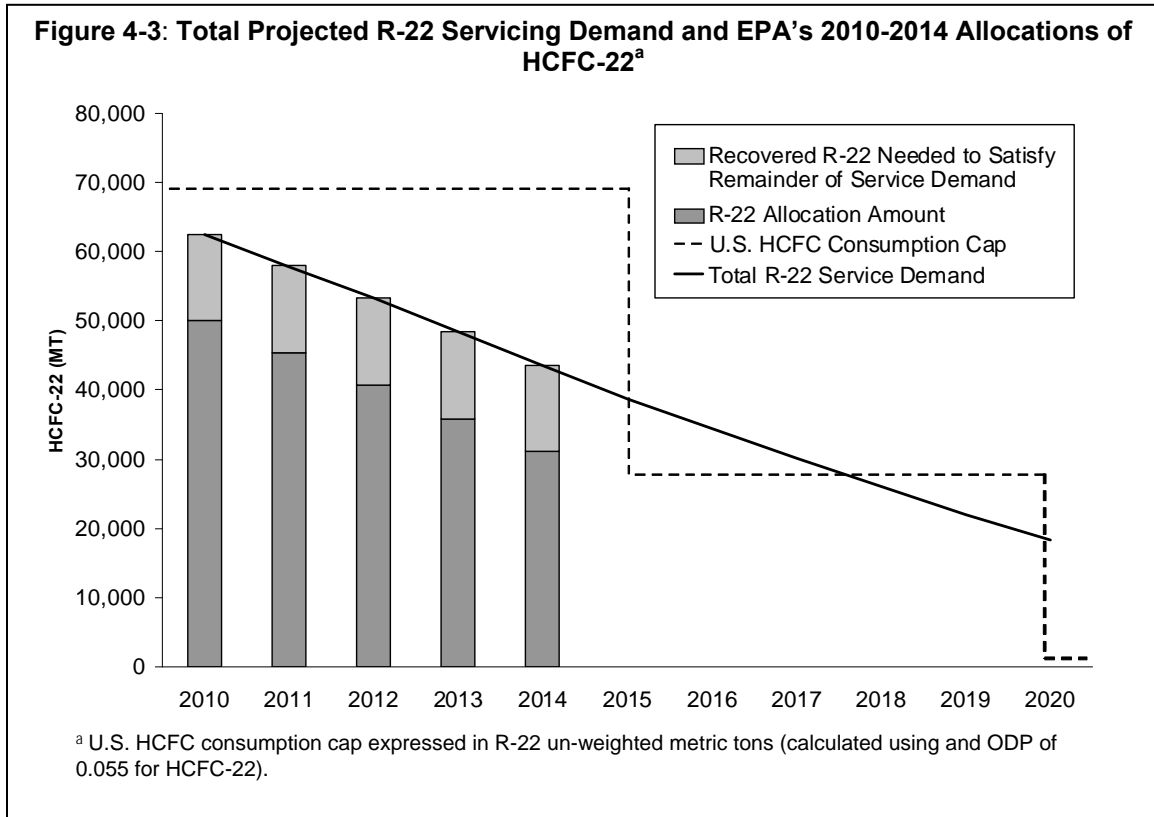

4.3 Factors Affecting Projections

Several market dynamics affect the projections of future servicing needs for R-22. Certain equipment specification requirements, the transition to alternative refrigerants, the stockpiling of refrigerant as well as equipment manufactured with HCFCs for sale after the phaseout, and the import of equipment pre-charged with HCFC refrigerant can all potentially alter the projected servicing scenarios. Each of these issues is discussed further below.

4.3.1 13 Seasonal Energy Efficiency Ratio (SEER)

In 2001, the U.S. Department of Energy (DOE) set a stricter seasonal energy efficiency ratio (SEER) standard for residential unitary ACs and heat pumps. The minimum efficiency standard of residential unitary ACs and heat pumps was raised by 30 percent to a 13 SEER for all such units manufactured for sale on or after January 23, 2006 (DOE 2001; DOE 2004).

Residential AC equipment generally requires a larger charge size to meet this standard because efficiency improvements are often achieved by increasing the size of the evaporator and condenser, which in turn requires an increase in refrigerant charge. The average central AC unit sold in 2004 was approximately 11.5 SEER, with an average charge size of around 3.4 kilograms (7.5 pounds) (ARI 2005).¹⁷ In 2007, sales indicated that approximately five out of every six AC units sold to homeowners were 13 SEER through June of 2007 (with the remainder 14 SEER or higher) (Skaer 2007).

Consequently, the amount of R-22 contained in new residential AC systems starting in 2006 has increased, resulting in an increase in projected servicing demand (assuming that service and leak losses, as a percentage of the equipment charge, do not change as a result). The projections provided in this

¹⁷ Typical factory charges for cooling only equipment are around three kilograms (6.6 pounds); however, the average unit considered accounts for heat pumps, which have a higher charge size and make up between 15 to 25 percent of the residential AC and heat pump market (ARI 2005; Carrier Corporation 2005a).

analysis incorporate the additional R-22 that is expected to be needed to service higher efficiency residential AC equipment after 2010 (see Appendix A for more details).

4.3.2 Transitioning to Alternative Refrigerants

A wide range of alternative refrigerants found acceptable under EPA's SNAP program are available in the AC and refrigeration sector. Hydrofluorocarbons (HFCs) and HFC-based alternatives, including R-134a, R-410A (composed of HFC-32/HFC-125), R-407C (composed of HFC-32/HFC-125/HFC-134a), R-404A (composed of HFC-125/HFC-143a/HFC-134a), and R-507A (composed of HFC-125/HFC-143a), are currently used in a variety of refrigeration and AC equipment. The pace of transition to equipment using these alternatives has varied by industry and type of equipment. Several AC and refrigeration equipment manufacturers have indicated that they have discontinued production of new equipment that uses R-22. (Hill Phoenix 2009; Hussmann 2009; Kysor/Warren 2009; Johnson Controls 2009).¹⁸ These actions are consistent with the actions found in the mid-1990s, when the refrigeration and AC industries phased out CFC refrigerants from new production chillers, refrigerators, motor vehicle air conditioners, and other products two or more years before the 1996 CFC consumption phaseout.

HFC alternatives to R-22 are greenhouse gases (GHGs) with high global warming potentials. A factor adding to the uncertainty that may have affected decisions by entities regarding the timing of their transition away from R-22 is whether the future refrigerant market may be affected by potential restrictions on HFCs either through adoption of domestic or international commitments to reduce production, consumption and/or emissions. For example, in 2009 the U.S. House of Representatives passed legislation that included controls on HFCs though, at the time of this report, although the U.S. Senate has yet to taken action. The Federated States of Micronesia (FSM) and Mauritius introduced a proposal to amend the Montreal Protocol to include controls on HFC production and consumption. The United States, Mexico, and Canada submitted a proposal that builds on the FSM and Mauritius proposal to be taken up by the Parties in November 2009. It remains to be seen what the details of any future HFC controls may be and how they would further delay or accelerate a transition away from existing equipment containing HCFC-22 and refrigerant blends containing HCFC-22 and/or HCFC-142b.

In projecting servicing needs, this analysis accounts for delayed transition trends that maintain production of new HCFC-22 equipment until December 31, 2009, discussed in further detail below. Additionally, Appendix A contains the specific transitions used in the modeling for this analysis.

Air-Conditioning Industry

R-134a, R-410A, and R-407C are replacing R-22 in new stationary and mobile AC equipment. Some mobile AC equipment has been using alternatives since the early 1990s, with some buses and trains using R-134a, and some heavy rail cars using R-407C (WMATA 2005; Amtrak 2005; Motorcoach Training 2005; Greyhound 2005; Carrier Corporation 2005b). Stationary AC equipment using R-410A has been commercially available since 1996 (HARDI 2004), and is expected to dominate the U.S. residential market in the future (EPA 2004b).

Despite the availability of alternatives, more than 90 percent of residential AC split-systems sold in 2004 were charged with R-22 (Honeywell 2005). According to a survey conducted by Emerson Climate Technologies in November 2007, 40 percent of the contractors and distributors said they would wait until 2010 to convert their sales to equipment containing alternative refrigerant (Emerson 2007). The consumer preference is for the refrigerant that costs less; in the years leading up to 2010, R-22 has been cheaper than alternatives. However, the economics is changing and R-410A pricing is beginning to match that of R-22. Most residential AC equipment purchasers now prefer to buy equipment using R-410A for equipment. For customers wishing to buy higher efficiency equipment, that is, greater than 13 SEER, R-410A is often the only option (Johnson Controls 2009).

¹⁸ Some manufacturers continue to manufacture R-22 outdoor units in 2009 to satisfy the replacement market in which only the outdoor units need to be replaced versus the entire system (Johnson Controls 2009).

To be conservative, the projections in this analysis are based on slower transitions to alternatives. For example, new sales of residential AC systems are modeled such that only 10 percent of the market adopts alternatives by the end of 2008 and the remainder of the market transitions completely by the end of 2009 (see Appendix A for more details). A more quickly paced adoption of alternatives by the AC-manufacturer and end-user community will have the effect of lowering the overall servicing demand of R-22 charged equipment post-2010 and lessen the risk of potential shortfalls as projected in Scenario 20 of this analysis.

Refrigeration Industry

Industry experts have indicated that retail food refrigeration end-uses are transitioning to alternatives more quickly than AC end-uses; the projections in this analysis are based on modeling that reflects this industry's input. Based on industry feedback, R-22 is currently the leading refrigerant in the U.S. supermarket industry representing about 35-40% of refrigerants used in existing stores (Verisae 2009). In comparison, the Vintaging Model currently assumes that 48% of supermarket systems installed in the U.S. use HCFC-22. Although the life expectancy of commercial refrigeration equipment is around 20 years, supermarkets tend to remodel every 7 to 10 years, which offers supermarkets the opportunity to install new equipment that uses an alternative more often than the typical equipment lifetime would imply (Hill Phoenix 2005). It is estimated that only 5% of new refrigeration systems installed in 2009 are charged with R-22 (Hill Phoenix 2009; Hussmann 2009; Kysor/Warren 2009). Advanced refrigeration technologies (e.g., distributed systems and secondary loop systems) represent an estimated 40% of new equipment sales and are always charged with HFC refrigerants (Hill Phoenix 2009; Hussmann 2009). The current trend in the supermarket industry is to use HFC refrigerant blends, particularly R-404A and R-507A. It is expected that the industry will continue to rely on HFC refrigerants but will trend toward blends with lower GWPs, such as R-407A and R-407C (Verisae 2009).

4.3.3 Recovery and Reuse Practices

As indicated in the total projected R-22 servicing demand scenarios presented in Section 4.2, recovered R-22 that is recycled, stockpiled, or reclaimed must increase to satisfy future servicing needs that cannot be met through virgin supplies alone. According to the scenarios presented in this section and the overall findings of this analysis:

- In 2010, the amount of recovered refrigerant is projected to range from 5,900 to 14,800 metric tons, depending on the percentage of total available refrigerant from retired or converted equipment that is recovered and reused;
- In 2015, when no more than 27,709 metric tons of virgin R-22 production and import is allowed under the cap, overall servicing demand is estimated to be 38,800 metric tons, therefore requiring at least 11,091 metric tons of recovered R-22. Scenario 50 projects sufficient amounts of recovered material (i.e., 22,000 metric tons) to meet this demand, whereas, the projected quantities under Scenario 20 does not (i.e., 8,800 metric tons, or approximately 20 percent lower than needed to prevent a shortfall).¹⁹
- In 2020, Scenario 50 projects sufficient supplies of recovered R-22 to meet projected 2020 servicing demand (i.e., 18,200 metric tons). Conversely, the estimated projections of 8,300 metric tons of recovered R-22 under Scenario 20 will not be enough to meet total projected demand, as no virgin manufacture is allowed under the cap.
- The R-22 consumption allocations set by EPA for years 2010 to 2014 decrease annually, maintaining the supply of recovered HCFCs at a constant level, and resulting in recovered material comprising a greater proportion of the supply required to meet total demand each year. As such, the percentage of the total need to be met with reclaimed material will rise from 20 percent to 29 percent of total demand in 2014, which is intended to help facilitate meeting the estimated demand in 2015, of which at least 29% must be met with recovered material. The annual decrease in allowable virgin R-22 will

¹⁹ Note that these numbers are calculated assuming the entire cap is allocated to HCFC-22 production, which is unlikely to occur due to the needs for continued production of other HCFCs. For example, a portion of the cap in 2010-2014 is allocated to other HCFCs.

enable a smooth transition for the AC and refrigeration industry as it should foster greater recovery and reclamation of R-22.

Although there is the potential for supply shortages after 2010, thorough maintenance practices during the lifetime of equipment, recovery practices at the time of equipment disposal or decommissioning, and the full penetration of reclaim and reuse practices can greatly reduce the likelihood of future shortfalls.

The use of recovery procedures during the lifetime of equipment and at the time of decommissioning reduces potential losses to a future supply of recovered refrigerant. End-users of AC and refrigeration equipment must have equipment installed by trained technicians. They must also have their equipment properly maintained to reduce incidences of major leaks. Service technicians must take efforts to isolate components or recover refrigerants prior to service as venting (releasing) HCFC (and CFC and HFC) refrigerant when making repairs is illegal. Service practices that involve locating and repairing leaks in lieu of "topping off" leaking systems further ensure future supplies of used refrigerant. As with servicing procedures, the venting of refrigerant during decommissioning is illegal. The AC and refrigeration community, including end-users, service technicians, and all affected stakeholders, must position itself for future phaseouts of HCFCs by using proper recovery techniques and complying with regulations that are in place to promote the growth of recoverable and reusable R-22.

Furthermore, the practice of reusing recovered and reclaimed R-22, while currently minimal (less than 4,600 metric tons of HCFC-22 was reclaimed in 2008), can increase future supplies once fully realized. Should current reclamation levels of R-22 not increase significantly, a sufficient supply of reusable refrigerant will *not* be available to meet servicing demand projections. To reach the projected supply of recovered refrigerant necessary to meet demand, a three to five-fold increase in current (as of 2008) reclamation levels is required.²⁰

While there is expressed concern from stakeholders in the AC and refrigeration community that the current business model for R-22 reclamation and related infrastructure will not support projected demand, the annual step-down of R-22 allocations from 2010 to 2014 will help foster growth in the reclamation industry and help establish recovery and reclamation of R-22 as a standard operating procedure. With future supply of material being less than demand, this type of growth in this market is an essential component in the AC and refrigeration industry strategy to prepare for the HCFC phaseout.

4.3.4 Recycling and Stockpiling Plans

With proper storage tanks, a reserve of recovered R-22 can be collected, stored, and accessed to service equipment owned by the same company years later, when R-22 is expected to be less affordable and less available. A report released in 1995 by the Food Marketing Institute (FMI) included a survey issued to supermarket operators on the use of refrigerant management plans (RMPs) as a strategy to ensure an adequate supply of CFC refrigerants for use after the December 31, 1995, CFC production phaseout. Of those surveyed, 52 percent were banking recovered CFC refrigerant, an activity adopted primarily by store operators with 11 or more stores (FMI 1995).

Although the extent to which such refrigerant management plans for HCFCs are currently in place is unknown, it is possible that the AC and refrigeration industry will increasingly adopt such plans and bank refrigerant in preparation for the HCFC phaseout, especially those that own a large number of stores. In addition to supermarkets, businesses that operate chillers, industrial process refrigeration, and/or multiple AC units, as well as other multi-facility operations, have the opportunity to internally bank refrigerant to meet future servicing needs.

While refrigerant banking is a strategy that companies may pursue, the lack of data has limited the projections in this report from quantifying stockpiles from refrigerant management plans. The banking of refrigerant may affect the results of this analysis by increasing future availability of recovered and

²⁰ This increase assumes that the demand projected by the Vintaging Model would be met solely by reclaimed refrigerant. Sources other than reclaimed refrigerant could also meet this demand, including recovery, recycling and direct reuse of refrigerant in the owner's equipment (without reclamation), stockpiled refrigerant, and potential supply of refrigerant from used imports.

reusable refrigerant. Stockpiling refrigerant ensures additional supply for a given user for later years, but there is some concern refrigerant will not be stockpiled due to occupying floorspace needed for more profitable inventory (Dyslin 2006). Furthermore, a large end-user stockpiling R-22, which may otherwise re-enter the market after being reclaimed, could result in the premature shortage of reusable refrigerant for other R-22 users (see Appendix A for more information).

Stockpiling of virgin R-22 also may be pursued, particularly prior to 2020 when production is entirely phased out; however, it is premature to state the extent to which this option will be technically and economically viable. As such, projections on future inventories of virgin stockpiles are not explored further in this analysis.

4.3.5 R-22 Economics

Another factor that affects the projections of R-22 servicing supply and demand is the cost of virgin and reclaimed R-22. The relatively low cost of virgin R-22 in the market for the past several years has weakened demand for reclaimed refrigerant, which is more expensive. Over time, as the supply of virgin R-22 decreases, it is expected that the demand for recovered and reclaimed refrigerant as well as R-22 alternatives will increase. To that end, reclaimers of R-22 and manufacturers of R-22 alternatives will experience economies of scale and their prices will fall, causing a shift in pricing structures. However, spot shortages of R-22 may occur, as was seen with the phaseout of CFC-12.

As a result of the increase in demand for this refrigerant, along with other economic factors, R-22 pricing has continued to increase. Market signals, such as this one, will likely encourage an increase in the demand for reclamation and the transition to alternative refrigerants.

4.3.6 Pre-charged Imports

AC equipment pre-charged with HCFCs is currently imported into the United States predominantly from Korea, Brazil, and China. In recent years, there has been a shift to overseas manufacturing; the number of imports of AC equipment into the United States is on the rise (UNEP 2003a; U.S. Census Bureau 2009). Central AC systems from foreign manufacturers such as Samsung, LG, and Haier are entering the U.S. market. Additionally, some U.S. manufacturers are starting to relocate plants to Mexico and other countries (Honeywell 2005), while others import equipment from international manufacturers that is then sold under their labels (HARDI 2005).

Effective January 1, 2010, domestic manufacturers of AC and refrigeration appliances will not be able to charge newly manufactured appliances with newly produced or imported HCFC-22 or HCFC-142b, and thus will not be introducing appliances containing these newly produced substances into interstate commerce. However, this regulatory provision does not lead to similar results for AC and refrigeration equipment that has been “pre-charged” with refrigerant before entering the United States. Should R-22 pre-charged units continue to enter the United States after 2010—with estimates indicating that an average annual total of pre-charged R-22 imports could range from 9.6 million to 12.5 million units—it would have the effect of increasing the overall servicing demand of R-22 charged equipment post-2010, adding further concern to the risk of potential shortfalls as projected in Scenario 20 of this analysis (and Scenarios 10 and 15, as provided in Appendix C).²¹

To that end, EPA is finalizing a January 1, 2010, ban prohibiting the sale or distribution of pre-charged units imported after that date. Further details regarding the ban on import of appliances pre-charged with HCFCs is available in EPA’s Final Rule and in EPA’s docket, at Docket ID No. EPA–HQ–OAR–2007–0163.

²¹ This analysis was conducted under the assumption that a ban on imported pre-charged imports would become effective beginning in 2010.

5. Conclusion

On January 1, 2010, production and import of HCFC-142b and HCFC-22 will be phased out except for on-going service needs for equipment manufactured on or before December 31, 2009. To support development of the allocation levels of HCFC-142b and HCFC-22 that will allow the U.S. to comply with the Montreal Protocol's 2010, 2015, and 2020 reduction steps, this report provides projections on the quantity of R-22 needed for servicing AC and refrigeration equipment manufactured on or before December 31, 2009.

Under the projected scenarios developed in this analysis, the AC and refrigeration industry is facing the potential risk of a shortage of R-22 starting in 2010 if practices to recover and reuse refrigerant are not increased. The findings indicate significant variance in the projected supply of recovered refrigerant available to meet demand depending on the future recovery and reuse of refrigerant. Only under scenarios with higher refrigerant recovery and reuse are supplies projected to satisfy future R-22 servicing needs using both recovered refrigerant and limited amounts of virgin refrigerant. Results from this analysis show that given the final R-22 allocation of 50,000 metric tons in 2010, in order to meet projected servicing demand, the remaining 12,500 metric tons (i.e., 20 percent of total demand) must be supplied by recovered R-22 to avoid a shortfall. Furthermore, by 2015, a year in which allocations are yet to be determined, a minimum of a 26 percent recovery rate yielding 29 percent of total demand is necessary to avoid a shortfall in demand.

The total projected HCFC-22 servicing demand in 2010, 2015, and 2020 compared to a 100% allocation of the HCFC consumption cap are summarized below along with concluding points on the implications of the two recovery and reuse scenarios as well as EPA's actual allocation for 2010.

- In 2010, a projected servicing demand of 62,500 metric tons of R-22, or about 90 percent of the 2010 consumption cap, is estimated. The total R-22 allocation amount for 2010 equals 50,000 metric tons, meaning that the R-22 required to meet the remaining service demand is 12,500 metric tons. Under Scenario 20, it is projected that not all of the servicing demand that remains after the allocated amount of 50,000 metric tons can be met through the recovered supply of R-22 (as shown in Table 5-1 with an estimated shortfall of 6,600 metric tons).

Table 5-1: Comparison of R-22 Servicing Demand Projections (Metric Tons) and Necessary Supply Projections by Source (Metric Tons and Percent), 2010

2010	Scenario 20: 20% Recovery Rate	Scenario 50: 50% Recovery Rate
Cap ^a	69,273	
Demand	62,500	
Total R-22 allocation amount	50,000	
Necessary Supply		
Recovered	5,900 (9%)	14,800 (24%)
Virgin	56,600 (91%)	47,600 (76%)
Shortfall	6,600 (11%)	0 (0%)

^a HCFC consumption cap expressed in R-22 metric tons to represent an allocation of 100 percent of the cap assigned to R-22.

Source: Based on modeling assumptions using EPA, 2007a.

- In 2015, a projected servicing demand of 38,800 metric tons of R-22 is estimated, which is over the 2015 consumption cap (expressed in R-22 un-weighted metric tons) by 40 percent (i.e., 2,291 metric tons) under Scenario 20. The total R-22 allocation amount between 2015 and 2019 will be determined in a future EPA rulemaking. Under a scenario of higher recovery and reuse (Scenario 50), Table 5-2 indicates that supplies from recovered R-22 can satisfy enough of the demand such that a shortage of refrigerant supply does not occur if the entire cap is allocated to R-22. However, in the 20% recovery rate scenario, a shortfall of 2,291 metric tons is projected.

Table 5-2: Comparison of R-22 Servicing Demand Projections (Metric Tons) and Necessary Supply Projections by Source (Metric Tons and Percent), 2015

2015	Scenario 20: 20% Recovery Rate	Scenario 50: 50% Recovery Rate
Cap ^a	27,709	
Demand	38,800	
Total Allocation Amount	TBD	
Necessary Supply		
Recovered	8,800 (23%)	22,000 (57%)
Virgin	30,000 (77%)	16,800 (43%)
Shortfall	2,291 (6%)	0 (0%)

^a HCFC consumption cap expressed in R-22 metric tons to represent an allocation of 100 percent of the cap assigned to R-22.

Source: Based on modeling assumptions using EPA, 2007a.

- In 2020, only 0.5 percent of the U.S. consumption baseline remains; however, the phaseout schedule prevents any allocation of the remaining baseline to R-22. A projected servicing demand of 18,200 metric tons of R-22 is estimated (Table 5-3). For consistency purposes, the HCFC consumption cap is expressed in R-22 metric tons in Table 5-3 to illustrate that the necessary supply of virgin R-22 under Scenario 20 is greater than the 2020 HCFC consumption cap. Under Scenario 20, only 46 percent of servicing demand is projected to be met with recovered refrigerant, leading to a shortfall of 9,900 metric tons of R-22. Under Scenario 50, this demand is projected to be met entirely with recovered refrigerant.

Table 5-3: Comparison of R-22 Servicing Demand Projections (Metric Tons) and Necessary Supply Projections by Source (Metric Tons and Percent), 2020

2020	Scenario 20: 20% Recovery Rate	Scenario 50: 50% Recovery Rate
Cap ^a	1,385	
Demand	18,200	
Total Allocation Amount ^b	0	
Necessary Supply		
Recovered	8,300 (46%)	18,200 (100%)
Virgin	9,900 (54%)	0 (0%)
Shortfall	9,900 (54%)	0 (0%)

^a HCFC consumption cap expressed in R-22 metric tons.

^b In 2020, 0.5 percent of the U.S. consumption baseline remains; however, the phaseout schedule in 2020 prevents any allocation of the remaining baseline to R-22.

Source: Based on modeling assumptions using EPA, 2007a.

Projections of future HCFC refrigerant supply and demand range depending on various market trends as addressed in this report. These projections provide the information necessary for taking initial steps in determining post 2010 servicing needs for R-22 equipment and ensuring that supplies are available by alerting the AC and refrigeration community of the critical need to adequately prepare for future HCFC phaseout dates. Continued collaboration with the AC and refrigeration community is needed to ensure that servicing demand for HCFC-based systems can be met in 2010 and beyond.

Appendix A: Methodology Used to Calculate Projected Servicing Needs

This appendix outlines the methodology used to calculate the projected servicing needs of AC and refrigeration equipment using R-22. This appendix contains three sections:

- Section A.1 provides an overview of EPA's Vintaging Model (EPA 2007a), which was used to establish the estimates of units of equipment using R-22 and R-22 servicing demand beyond 2010.
- Section A.2 discusses the limitations to the servicing projections presented in this report.

A.1 EPA's Vintaging Model

EPA's Vintaging Model was developed as a tool for estimating the annual chemical emissions from industrial sectors that have historically used ODS in their products. Emissions are estimated from the following end-use sectors: 1) Air-Conditioning and Refrigeration; 2) Foams; 3) Aerosols; 4) Solvents; 5) Fire-Extinguishing; and 6) Sterilants. Within these sectors, there are over 60 independently modeled end-uses. The model requires information on the market growth for each of the end-uses, as well as a history and projection of the market transition from ODS to alternatives. As ODS are phased out, a percentage of the market share originally filled by the ODS is allocated to substitutes.

The model, named for its method of tracking the emissions of annual "vintages" of new equipment that enter into service, is a "bottom-up" model. This means it models the consumption of controlled ozone-depleting substances and their substitutes based on:

- 1) Estimates of the quantity of equipment or products sold, serviced, and retired or retrofitted each year, and
- 2) The quantity of the chemical required to manufacture and/or maintain the equipment.

The model makes use of this market information to build an inventory of in-use stocks of equipment and quantities of ODS/ODS substitutes in each of the end-uses.

Emissions are estimated by applying annual leak rates, service emission rates,

Box A-1: Developing and Maintaining EPA's Vintaging Model

The Vintaging Model synthesizes data from a variety of sources, including:

- EPA's ODS Tracking System and submissions to the SNAP program both maintained by the U.S. EPA Stratospheric Protection Division;
- Published literature from the United Nations Environment Programme (UNEP) Technical Options Committees, the Alternative Fluorocarbons Environmental Acceptability Study (AFEAS), and those provided in industry-related and EPA conference proceedings; and
- Numerous representatives at companies and trade associations, such as the Alliance for Responsible Atmospheric Policy, the Air-Conditioning Heating and Refrigeration Institute (AHRI), the Association of Home Appliance Manufacturers (AHAM), and the Alliance of Automobile Manufacturers.

In some instances the unpublished information that EPA uses in the model is classified as Confidential Business Information (CBI). The annual emissions inventories of chemicals are aggregated in such a way that CBI cannot be inferred.

The Vintaging Model is continually updated to improve assumptions and modeling techniques and refine inputs based on information received from these sources. EPA shares the revised assumptions and results of model improvements with industry through publications such as this one as well as through presentations, such as those given at the April 2007 Spring Meetings of AHRI.

In both 2006 and 2007, the model was updated based on information obtained from industry as part of the research effort for this analysis. HCFC-22 projections of servicing needs for the AC and refrigeration end-uses presented in this report represent model output based on a model run developed in 2007 (EPA 2007a). While several updates were made to the inputs of EPA's Vintaging Model since 2007, these updates were mainly with respect to assumptions on ODS alternatives, and, hence, output from a more recent model run would only minimally alter HCFC-22 projections as presented in this report, if at all.

and disposal emission rates to consumption data for each vintage of equipment. Emissions from AC and refrigeration equipment are split into two categories: emissions during equipment lifetime and disposal emissions. The first category includes the amount of compound leaked during equipment operation and the amount of compound emitted during service. Consumption required to service or refill equipment is driven by the demand to replace such losses, and therefore, emissions during the lifetime of equipment are equal to consumption for servicing (since it is assumed that all leaked refrigerant is eventually replaced). Emissions, and therefore, consumption from leakage and servicing can be expressed as follows:

$$Es_j = (I_a + I_s) \times \sum Qc_{j-i+1} \text{ for } i=1 \rightarrow k$$

Where:

- Es = Emissions from Equipment Serviced. Emissions in year j from normal leakage and servicing of equipment.
- Ia = Annual Leak Rate. Average annual leak rate during normal equipment operation (expressed as a percentage of total chemical charge).
- Is = Service Leak Rate. Average leakage during equipment servicing (expressed as a percentage of total chemical charge).
- Qc = Quantity of Chemical in New Equipment. Total amount of a specific chemical used to charge new equipment in a given year by weight.
- i = Counter, runs from 1 to lifetime (k).
- j = Year of emission.
- k = Lifetime. The average lifetime of the equipment.

The assumptions used in this calculation range by equipment, refrigerant, and vintage, reflecting that as new technologies replace older ones, improvements in their leak, service, and disposal emission rates are assumed to occur.

For the purpose of this analysis, the following data from EPA's Vintaging Model were compiled and summarized for the AC and refrigeration sector:

- 1) Consumption for Servicing, which is equal to the demand to service (i.e., refill) existing equipment. These data are back-calculated using service and leak emissions because the quantity emitted during the lifetime of equipment drives the demand to replace such losses. These estimates are further distinguished between consumption of virgin and recycled/reclaimed chemical. The model assumes that a certain percentage of refrigerant, which varies by end-use, is recovered from discarded equipment. The model then assumes a "best-case" scenario in which all recovered and re-usable refrigerant re-enters the market. See Section A.2 for further discussion on this "recovery pool."
- 2) Number of Units of Equipment, which is equal to, for "year X", the number of units existing in "year X-1" plus the number of new units produced in "year X" minus the number of units disposed in "year X".

For example:

$$\text{No. of Units in 1999} = \text{No. of Units in 1998} + \text{New Units in 1999} - \text{Units Disposed in 1999}$$

Estimates from EPA's Vintaging Model are often cross-checked with actual historical data from EPA's ODS Tracking System, which tracks actual ODS production and consumption (including import and export) by U.S. companies. The Model's virgin manufacture parameter is considered to be most comparable to the Montreal Protocol's definition of consumption (i.e., production plus imports minus exports). In EPA's Vintaging Model, the Virgin Manufacture parameter is calculated to be any need for consumption (either for new equipment or servicing) that cannot be met through recycled or recovered material; no distinction is made in the Vintaging Model between whether that need is met through domestic manufacturing or imports. As shown in Figure A-1, estimates from the model generally align to actual consumption from 1993 to 2008.

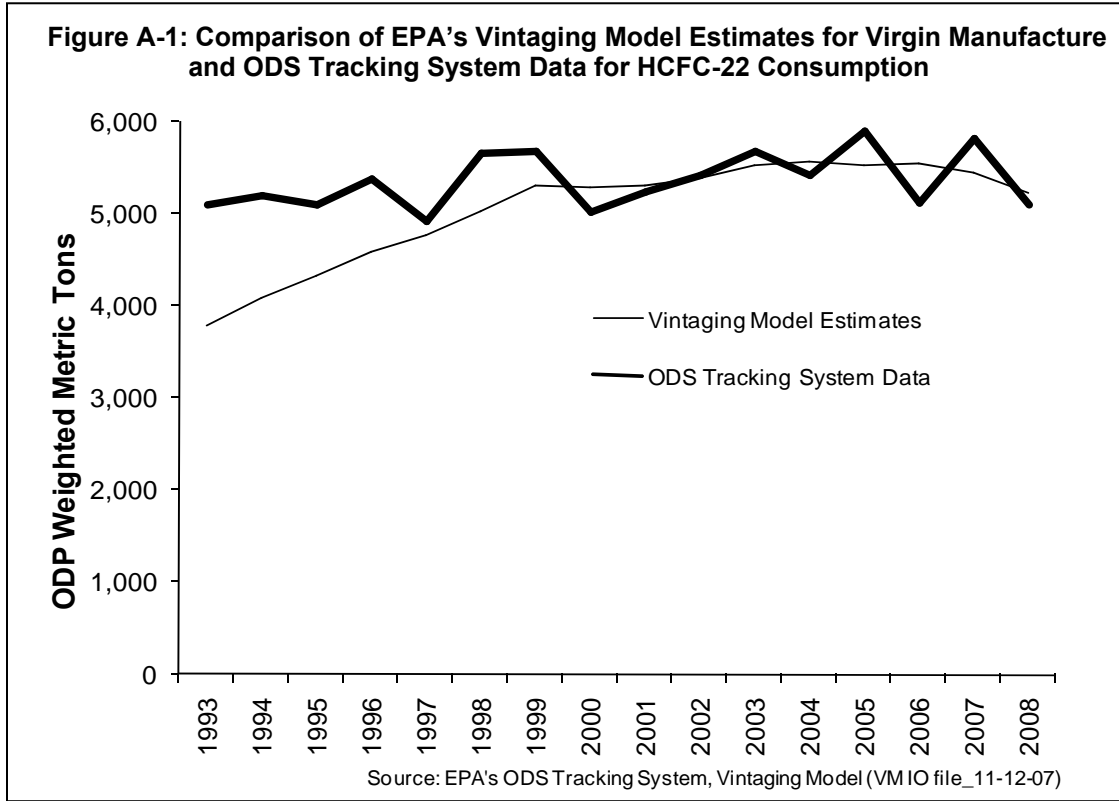


Table A-1 presents the input assumptions used to develop the projections in this report. The loss rates represent the percent of the total charge that leaks in a given year plus the amount, on an annual basis, emitted at service, expressed as a percentage of total chemical charge. Because the amount lost from leaks and servicing is annualized, equipment is assumed to reach the end of its lifetime with a full charge.²² EPA's Vintaging Model then applies a "recovery rate," which refers to the percent of total charge of the equipment that is recovered and reused at the time of disposal. These recovery rates represent averages, intended to capture the range of possible practices occurring at disposal.

Growth rate assumptions are also provided in Table A-1. The growth rates refer to the growth of the equipment market for each end-use as a whole and are not specific to the refrigerant. When the transition to different equipment and different refrigerants occur, the input assumptions are adjusted to account for these changes.

²² For the majority of equipment types, the assumption that equipment contains a full charge at the end of life is theoretically applicable. To ensure proper and continual functioning of equipment, homeowners and businesses typically have their air-conditioning and refrigeration systems serviced regularly. Technicians will check these systems for leaks using proper techniques and if a loss of refrigerant is found, will refill the system to ensure it is functioning efficiently after repairing any leaking seals or damaged components. Note that this assumption may not be appropriate for smaller equipment types such as window units but is applied consistently for modeling purposes.

Table A-1: Input Assumptions, Years 2005 to 2020

Current Refrigerant	Equipment Type and Original ODS Refrigerant	Charge Size ^a	Loss Rate	Growth Rate ^b	Recovery Rate	Lifetime (Years)
AC Equipment						
R-22	HCFC-22 Residential Unitary A/C (2005-2006)	3	12%	1.9%	35%	15
R-22	HCFC-22 Residential Unitary A/C (2006-2020)	5	12%	1.9%	35%	15
R-22	R-22 Small Commercial Unitary AC	8	11%	2.5%	40%	15
R-22	R-22 Large Commercial Unitary AC	15	10%	2.5%	40%	15
R-22	R-22 Water & Ground Source Heat Pumps	4	5%	2.5%	57%	20
R-22	R-22 Dehumidifiers	0	1%	0.2%	50%	11
R-22	R-22 Packaged Terminal Units	1	5%	2.5%	35%	12
R-22	R-22 Window Units	1	1%	5.0%	50%	12
R-22	R-12 School & Tour Buses	5	10%	2.6%	50%	12
R-22	R-22 Transit Buses	8	44%	2.6%	50%	12
R-22	R-22 Trains	22	44%	2.6%	50%	5
R-22	R-11 Centrifugal Chillers	700	5%	0.5%	80%	25
R-22	R-12 Centrifugal Chillers	721	5%	0.5%	80%	27
R-22	Reciprocating Chillers	230	1%	0.2%	80%	20
R-22	Screw Chillers	300	1%	0.5%	80%	20
R-22	Scroll Chillers	240	1%	0.5%	80%	20
R-22	R-500 Chillers	926	5%	0.5%	80%	27
Refrigeration Equipment						
R-22	R-12 Cold Storage	<0.01	20%	2.5%	80%	20
R-22	R-22 Cold Storage	<0.01	20%	2.5%	80%	20
R-22	R-502 Cold Storage	<0.01	20%	2.5%	80%	20
R-502	R-502 Cold Storage	<0.01	25%	2.5%	80%	20
R-22	CFC-12 Large Retail Food	1,800	30%	1.7%	80%	15
R-502	CFC-12 Large Retail Food	1,800	33%	1.7%	80%	15
R-502	R-502 Large Retail Food	1,800	33%	1.7%	80%	15
R-22	R-502 Large Retail Food	1,800	30%	1.7%	80%	15
R-22	HCFC-22 Medium Retail Food	3	8%	1.7%	80%	20
R-22	R-12 Small Retail Food	1	8%	1.7%	35%	20
R-22	R-12 Transport	8	28%	2.5%	35%	12
R-402A	R-12 Transport	8	28%	2.5%	35%	12
R-401A	R-502 Transport	8	28%	2.5%	10%	12
R-502	R-502 Transport	8	33%	2.5%	10%	12
R-22	R-11 Industrial Process Refrigeration	952	10%	2.5%	80%	25
R-22	R-12 Industrial Process Refrigeration	992	10%	2.5%	80%	25
R-401A	R-12 Industrial Process Refrigeration	850	5%	2.5%	90%	25
R-22	R-22 Industrial Process Refrigeration	9,100	12%	2.5%	80%	25

Source: VM IO File_11-12-2007

^a Charge size presented in kilograms. Cold storage charge size presented in kilograms/cubic foot.

^b The growth rate applies to new consumption/virgin manufacture for products entering the market. For example, in the window units market, any year's consumption for new equipment is five percent greater than the previous year's consumption.

Table A-2 presents the assumptions used to model the transition from R-22 to alternatives for each end use. Only those end-uses that have been using R-22, or have in whole or in part transitioned to use R-22, are shown. The first column of the table presents the R-22 equipment types by the refrigerants that

they originally used. The second column presents the refrigerants that enter the market and are used in new equipment in place of R-22.²³ These refrigerants begin to enter the new-equipment market in the year presented in the third column and fully penetrate this market by the date presented in the fourth column. The final column indicates the percent of the R-22 new-equipment market that the given substitute refrigerant replaces by the transition end date. All transitions are assumed to occur linearly between the transition start and end dates. By combining multiple transitions to different refrigerants and over different time periods, the Vintaging Model mimics actual, non-linear transitions that may occur.

Table A-2: Transition to Alternatives Assumptions of EPA's Vintaging Model for R-22 Refrigeration and AC Equipment^a

1	2	3	4	5
R-22 Equipment Type and Original ODS Refrigerant	Substitute	Start Date	End Date	Market Penetration of Substitute ^b
HCFC-22 Residential Unitary AC	R-407C	2006	2009	1%
		2009	2010	5%
	R-410A	2001	2005	5%
		2006	2009	8%
HCFC-22 Small Commercial Unitary AC	R-410A	2009	2010	81%
		1996	2000	3%
		2001	2005	18%
		2006	2009	8%
HCFC-22 Large Commercial Unitary AC	R-407C	2006	2009	1%
		2009	2010	5%
	R-410A	2001	2005	5%
		2006	2009	9%
HCFC-22 Water & Ground Source Heat Pumps	R-407C	2000	2006	5%
		2006	2009	3%
		2009	2010	23%
	R-410A	2001	2006	5%
		2006	2009	5%
		2009	2010	41%
	R-134a	2000	2009	2%
		2009	2010	18%
HCFC-22 Dehumidifiers	R-134a	1997	1997	89%
	R-410A	2007	2010	11%
HCFC-22 Packaged Terminal Units	R-410A	2006	2009	10%
		2009	2010	90%
HCFC-22 Window Units	R-407C	2003	2009	3%
		2009	2010	35%
	R-410A	2003	2009	7%
		2009	2010	55%
CFC-12 Tour Buses	R-134a	2006	2007	100%
HCFC-22 Transit Buses	R-134a	1995	2009	100%
HCFC-22 Trains	R-134a	2002	2009	50%
	R-407	2002	2009	50%

²³ These transition assumptions are for new equipment only; they do not imply that the original equipment was retrofitted to the alternative refrigerants.

1	2	3	4	5
R-22 Equipment Type and Original ODS Refrigerant	Substitute	Start Date	End Date	Market Penetration of Substitute ^b
CFC-12 Cold Storage	R-404A	1996	2010	75%
	R-507A	1996	2010	25%
HCFC-22 Cold Storage	R-404A	1996	2009	8%
		2009	2010	68%
	R-507A	1996	2009	3%
		2009	2010	23%
R-502 Cold Storage	R-404A	1996	2010	38%
	R-507A	1996	2010	12%
	Other	1996	2010	50%
CFC-11 Industrial Process Refrigeration	R-134a	1995	2010	100%
CFC-12 Industrial Process Refrigeration	R-134a	1995	2010	15%
	R-404A	1995	2010	50%
	R-410A	1999	2010	20%
	R-507A	1995	2010	15%
HCFC-22 Industrial Process Refrigeration	R-134a	1995	2009	2%
		2009	2010	14%
	R-404A	1995	2009	5%
		2009	2010	45%
	R-410A	1999	2009	2%
		2009	2010	18%
	R-507A	1995	2009	2%
		2009	2010	14%
CFC-12 Retail Food	R-404A	2000	2009	8%
	R-507A	2000	2009	3%
	R-134a	1993	1995	90%
HCFC-22 Retail Food	R-404A	1995	2000	18%
		2000	2005	32%
		2005	2010	18%
	R-507A	1995	2000	8%
		2000	2005	14%
		2005	2010	12%
R-502 Retail Food	R-404A	1995	2000	18%
		2000	2005	32%
		2005	2010	18%
	R-507A	1995	2000	8%
		2000	2005	14%
		2005	2010	12%
CFC-12 Transport	R-134a	1995	1999	100%
R-502 Transport ^c	R-134a	1993	1995	55%
	R-404A	1993	1995	45%
HCFC-22 Screw Chillers	R-134a	2000	2009	9%
		2009	2010	81%
	R-407C	2000	2009	1%
		2009	2010	9%
HCFC-22 Scroll Chillers	R-134a	2000	2009	9%

1	2	3	4	5
R-22 Equipment Type and Original ODS Refrigerant	Substitute	Start Date	End Date	Market Penetration of Substitute ^b
		2009	2010	81%
	R-407C	2000	2009	1%
		2009	2010	9%
CFC-12 Reciprocating Chillers	R-410A	2010	2020	40%
CFC-11 Centrifugal Chillers	R-134a	2000	2010	100%
CFC-12 Centrifugal Chillers	R-134a	2000	2010	100%
R-500 Chillers	R-134a	2000	2010	100%

Source: VM IO File_11-12-2007

^a Interim transitions (e.g., from a CFC to HCFC-22 to HFCs) are not shown. For example, the retail food new-equipment market that originally used R-12 first transitioned from R-12 to R-502 and then to R-22. Then, between 1995 and 2010, 67 percent of the R-22 new-equipment market is assumed to transition to R-404A and the remaining 33 percent to R-507A.

^bThe market penetration of the substitute represents the percent of the R-22 new-equipment market that is replaced by the substitute refrigerant.

^cThe R-502 transport refrigeration market transitions directly to R-134a and R-404A. There is no interim transition to R-22.

A.2 Limitations and Caveats

This analysis utilized the best data available from various sources. Nonetheless, when making projections several assumptions are required. The following caveats should be noted.

Recycled or Reclaimed Refrigerant

EPA's Vintaging Model was used to determine the quantities of R-22 from existing (recycled or reclaimed) sources that can meet post-2010 servicing needs and the remaining quantities required through virgin manufacture. For a given year, the model assumes that a certain percentage of refrigerant, which varies by end-use, is recovered from discarded equipment, while the remainder is emitted.²⁴ The model aggregates the quantities recovered but does not distinguish the "pool" of refrigerant between quantities that are reclaimed versus those that are recycled. The model then assumes that the entire pool of recovered refrigerant re-enters the market within the same year. Any additional demand for refrigerant above that which is assumed to be met by recovered refrigerant is calculated to be virgin manufacture. The recovery pool and the remaining virgin manufacture are evaluated only at the most aggregate level, across all end-uses, and not at the end-use level, as the model does not differentiate between virgin and recycled refrigerant when calculating demand for each end-use. This model attribute reflects a more realistic scenario in that reclaimers are not likely to only sell back to the end-use market sector from which the used refrigerant originated; rather, reclaimed refrigerant can be retailed to the overall AC and refrigeration industry.

Under this modeled approach, the model does not consider the quantity of refrigerant that companies send off for destruction after equipment is decommissioned. Although the quantities of destroyed refrigerant are very small, they are *not* subtracted from the recovered pool, so the quantity available for reuse may be slightly overestimated in the model. Additionally, the model does not account for any stockpiling of recovered refrigerant beyond a one-year timeframe, as discussed in Section 4.3. To the extent that stockpiling has occurred over the last few years, the quantity of recovered refrigerant modeled as re-entering the market may be overestimated in earlier years (i.e., when refrigerant is banked), and the quantity modeled as re-entering the market in later years may be underestimated (i.e., when the accumulated stockpile is accessed as a source).

²⁴ In the base model, the percentage recovered at disposal varies by end-use; however, for the recovery scenarios presented in this report (e.g. Scenario 20 and Scenario 50), this variable was set at a constant percent.

Pre-Charged Appliance Components

Part of the policy-setting process is the determination allowing the sale and distribution after January 1, 2010, of R-22 pre-charged appliance components (e.g., condensing units, line sets, expansion valves) that are manufactured before January 1, 2010, and used for the purpose of servicing existing (installed pre-2010) appliances. Existing R-22 equipment remaining in the installed base may be serviced with components that were made and pre-charged before 2010. The model assumes that some refrigerant is required at service, but does not distinguish whether this refrigerant comes within pre-charged components or is added from bulk quantities (e.g. cylinders).

The Vintaging Model assumes that components will continue to be available for usual repairs of existing equipment; average lifetimes for R-22 equipment assumed in the Vintaging model account for variations in the useful life of equipment caused by early retirement, extended use, or the use of replacement parts during servicing. Hence, the analysis presented in this report reflects a situation where the sale and distribution of either a) pre-charged appliance components, or b) uncharged appliance components and refrigerant from bulk quantities is available for repair of the installed based in 2010 and beyond. If the analysis were to reflect otherwise, the average lifetimes of equipment would have to be truncated to account for early retirement associated with the lack of availability of appliance components (and/or refrigerant) for basic repair jobs.

Date of Sale versus Date of Installation of HCFC-22 Units

It is feasible and potentially common for some AC and refrigeration appliances to be purchased in one year and installed in another year. Such would be the case, for example, for units designated for construction projects that have received building code approval and entered into a binding contract in one year but are completed in some future year. The Vintaging Model relies on shipment data of newly sold AC and refrigeration equipment to help estimate new units entering the market for a given year. Adjustments to shipment data to reflect the date of installation are not made—shipment data is the closest and best proxy to installation for the purposes of modeling. Thus, the model assumes the year of installation to be the same as the year of shipment. Any equipment modeled as “shipped” in 2009, for example, is therefore already inclusive of equipment installed post 2010. Upon installation, equipment lifetime and servicing demand begin to be modeled.

It is assumed in the model that the entire fleet of 2009 units within a given end-use are being retired in the same year, whereas, in reality some of these units may instead be installed a year or two after shipment, starting their lifetime and servicing demand a year or two after the shipment date, and hence, retiring a year or two after the retirement of the rest of the fleet. Therefore, the model is not accurately reflecting the actual start and end date for servicing demand for this subset of equipment. Instead, the model uses an average lifetime for each unique equipment type. This average is intended to account for units that are used for a few years as well as those that are used well beyond their assumed useful life. Given the use of an average lifetime in the model, variations of a year or two between shipment and installation date should fall within “normal” fluctuations in lifetime seen in actual equipment use. Additionally, residential and smaller commercial refrigeration and AC appliances have lifetimes of 15 years or shorter. Thus, any such equipment entering the market after 2005 is assumed to remain in service beyond 2020, when all HCFC-22 consumption will be phased out in the United States. Likewise, equipment entering the market in 2010 or 2011 would be assumed to be in service well beyond the 2020 milestone.

Appendix B: HCFC Projections by End-Use

This Appendix provides estimates of the projected installed base of R-22 equipment by end-use and the projected quantities of R-22 needed to service AC and refrigeration equipment. Descriptions of end-uses are provided in Section 3 of the report. For the purpose of this analysis, data on HCFC blend consumption for servicing are divided among the corresponding HCFC constituent(s) of that blend, according to the nominal percent composition. However, to accurately portray the number of units containing R-22, blends are not disaggregated when presenting the number of units of equipment (i.e., a unit running on a blend containing HCFC-22 counts as one unit).

Table B-1 presents the number of units of equipment using R-22 (or a blend containing R-22) that are estimated to be in use in 2007, 2010, 2015, and 2020. These estimates were developed based on EPA's Vintaging Model, which takes into account recent input from industry representatives (EPA 2007a). Sections 3.1 and 3.2 provide an overview of these AC and refrigeration end-uses.

Table B-1: Estimated Number of R-22 Units Installed^a

Equipment Type	2007	2010	2015	2020
Window Units	75,031,300	74,178,600	41,559,500	4,102,700
Packaged Terminal Units	2,719,200	2,478,800	1,355,100	123,100
Residential Unitary AC	51,500,000	46,884,600	29,197,700	10,709,100
Small Commercial Unitary AC	18,821,200	17,097,500	10,666,800	4,291,400
Large Commercial Unitary AC	1,982,200	1,849,900	1,208,600	505,200
Chillers	417,500	443,900	326,300	202,800
Dehumidifiers	1,453,300	1,282,100	670,200	0
Water & Ground Source Heat Pumps	1,445,700	1,392,000	1,058,200	681,000
Other Mobile AC (Bus & Train AC)	44,900	25,900	6,700	0
Subtotal AC	153,415,300	145,633,300	86,049,100	20,615,300
Retail Food	4,452,900	3,770,900	2,107,300	924,700
Refrigerated Transport	4,900	0	0	0
Industrial Process Refrigeration	8,500	8,700	7,500	5,600
Subtotal Refrigeration	4,466,300	3,779,600	2,114,800	930,300
Total	157,881,600	149,412,900	88,163,900	21,545,600

^aCold Storage is not shown in this table because the model estimates this end-use based on cubic feet of storage, rather than number of units.

Table B-2 presents the metric tons of R-22 estimated to be needed to service AC and refrigeration equipment in 2007, 2010, 2015, and 2020.

Table B-2: Projected R-22 Servicing Demand (Metric Tons)

Equipment Type	2007	2010	2015	2020
Window Units	300	300	100	<50
Packaged Terminal Units	100	100	<50	<50
Residential Unitary AC	21,700	20,700	13,500	6,100
Small Commercial Unitary AC	15,600	14,100	8,800	3,500
Large Commercial Unitary AC	3,000	2,800	1,800	800
Chillers	3,300	3,300	1,300	700
Dehumidifiers	<50	<50	<50	0
Water & Ground Source Heat Pumps	300	300	200	100
Other Mobile AC (Bus & Train AC)	200	100	<50	0
Total AC	44,500	41,700	25,900	11,300
Cold Storage	1,100	1,100	800	600
Retail Food	14,300	10,900	4,900	1,100
Refrigerated Transport	<50	0	0	0
Industrial Process Refrigeration	8,800	8,900	7,200	5,400
Total Refrigeration	24,200	20,800	12,800	7,000
Total	68,700	62,500	38,800	18,200

Note: Totals do not sum due to independent rounding.

Appendix C: Additional “Recovery Rate” Scenarios

This report closely examines two scenarios of the potential amounts of used and recovered refrigerant available to service equipment—Scenarios 20 and 50, which assume that 20 and 50 percent, respectively, of refrigerant from retired or retrofitted equipment is recovered and reused in equipment while the remainder is not available for reuse. Appendix C includes three additional scenarios, representing the lower and higher recovery rates of 10 and 15 and 75 percent, respectively.

Tables C-1 through C-3 summarize the lower (Scenarios 10 and 15) and higher (Scenario 75) scenarios in comparison to the U.S. HCFC consumption cap and the actual U.S. HCFC consumption allocations for HCFC-22 in 2010. As shown in Tables C-1 and C-2, the projection of recovered supply under a 10% and 15% recovery rate scenario is insufficient to meet demand in 2015 and 2020 leading to shortfalls.

**Table C-1: Scenario 10: 10% Recovery Rate:
 Summary of Projected R-22 Supply, Demand, and Surplus (R-22 Metric Tons)**

	2010	2011	2012	2013	2014	2015	2020
Projected R-22 Servicing Demand Summary^a							
Total R-22 servicing demand	62,500	57,900	53,200	48,400	43,600	38,800	18,200
Modeled R-22 supplied from recovery/reuse	3,000	4,100	4,200	4,200	4,300	4,400	4,200
% of total R-22 servicing demand supplied by anticipated recovery/reuse	5%	7%	8%	9%	10%	11%	23%
Modeled R-22 supplied from virgin R-22	59,500	53,800	49,000	44,200	39,300	34,400	14,100
Comparison to HCFC Consumption Cap							
Virgin R-22 supply available under cap ^b	69,273	69,273	69,273	69,273	69,273	27,709	0 ^d
Modeled R-22 supplied from virgin R-22	59,500	53,800	49,000	44,200	39,300	34,400	14,100
Additional virgin R-22 allowable under cap ^c	9,773	15,473	20,273	25,073	29,973	-6,691	-14,100

^a Based on modeling assumptions using EPA, 2007a.

^b Expressed in R-22 un-weighted metric tons (calculated using an ODP of 0.055 for HCFC-22).

^c Negative values represent a shortfall of R-22 available under the consumption cap and are in bold.

^d In 2020, a cap equal to 0.5 percent of the U.S. consumption baseline remains; however, the phaseout schedule in 2020 prevents any allocation of the remaining baseline to R-22.

**Table C-2: Scenario 15: 15% Recovery Rate:
 Summary of Projected R-22 Supply, Demand, and Surplus (R-22 Metric Tons)**

	2010	2011	2012	2013	2014	2015	2020
Projected R-22 Servicing Demand Summary^a							
Total R-22 servicing demand	62,500	57,900	53,200	48,400	43,600	38,800	18,200
Modeled R-22 supplied from recovery/reuse	4,400	6,100	6,200	6,300	6,500	6,600	6,200
% of total R-22 servicing demand supplied by anticipated recovery/reuse	7%	11%	12%	13%	15%	17%	34%
Modeled R-22 supplied from virgin R-22	58,100	51,700	47,000	42,100	37,100	32,200	12,000
Comparison to HCFC Consumption Cap							
Virgin R-22 supply available under cap ^b	69,273	69,273	69,273	69,273	69,273	27,709	0 ^d
Modeled R-22 supplied from virgin R-22	58,100	51,700	47,000	42,100	37,100	32,200	12,000
Additional virgin R-22 allowable under cap ^c	11,173	17,573	22,273	27,173	32,173	-4,491	-12,000

^a Based on modeling assumptions using EPA, 2007a.

^b Expressed in R-22 un-weighted metric tons (calculated using an ODP of 0.055 for HCFC-22).

^c Negative values represent a shortfall of R-22 available under the consumption cap and are in bold.

^d In 2020, a cap equal to 0.5 percent of the U.S. consumption baseline remains; however, the phaseout schedule in 2020 prevents any allocation of the remaining baseline to R-22.

As shown in Table C-3, the projection of recovered supply under a 75% recovery rate scenario illustrates that industry should have adequate supply if 75 percent of refrigerant from retired or converted equipment is recovered and re-enters the pool of refrigerant available to meet demand.

Table C-3: Scenario 75: 75% Recovery Rate: Summary of Projected R-22 Supply, Demand, and Surplus (R-22 Metric Tons)


	2010	2011	2012	2013	2014	2015	2020
Projected R-22 Servicing Demand Summary^a							
Total R-22 servicing demand	62,500	57,900	53,200	48,400	43,600	38,800	18,200
Modeled R-22 supplied from recovery/reuse	22,200	30,700	31,200	31,700	32,400	33,000	31,200
% of total R-22 servicing demand supplied by anticipated recovery/reuse	36%	53%	59%	65%	74%	85%	>100%
Modeled R-22 supplied from virgin R-22	40,300	27,200	22,000	16,700	11,200	5,800	0
Comparison to HCFC Consumption Cap							
Virgin R-22 supply available under cap ^b	69,273	69,273	69,273	69,273	69,273	27,709	0 ^c
Modeled R-22 supplied from virgin R-22	40,300	27,200	22,000	16,700	11,200	5,800	0
Additional virgin R-22 allowable under cap	28,973	42,073	47,273	52,573	58,073	21,909	0

^a Based on modeling assumptions using EPA, 2007a.

^b Expressed in R-22 un-weighted metric tons (calculated using an ODP of 0.055 for HCFC-22).

^c In 2020, a cap equal to 0.5 percent of the U.S. consumption baseline remains; however, the phaseout schedule in 2020 prevents any allocation of the remaining baseline to R-22.

Figures C-1 through C-3 illustrate the information provided in Tables C-1 through and C-3.

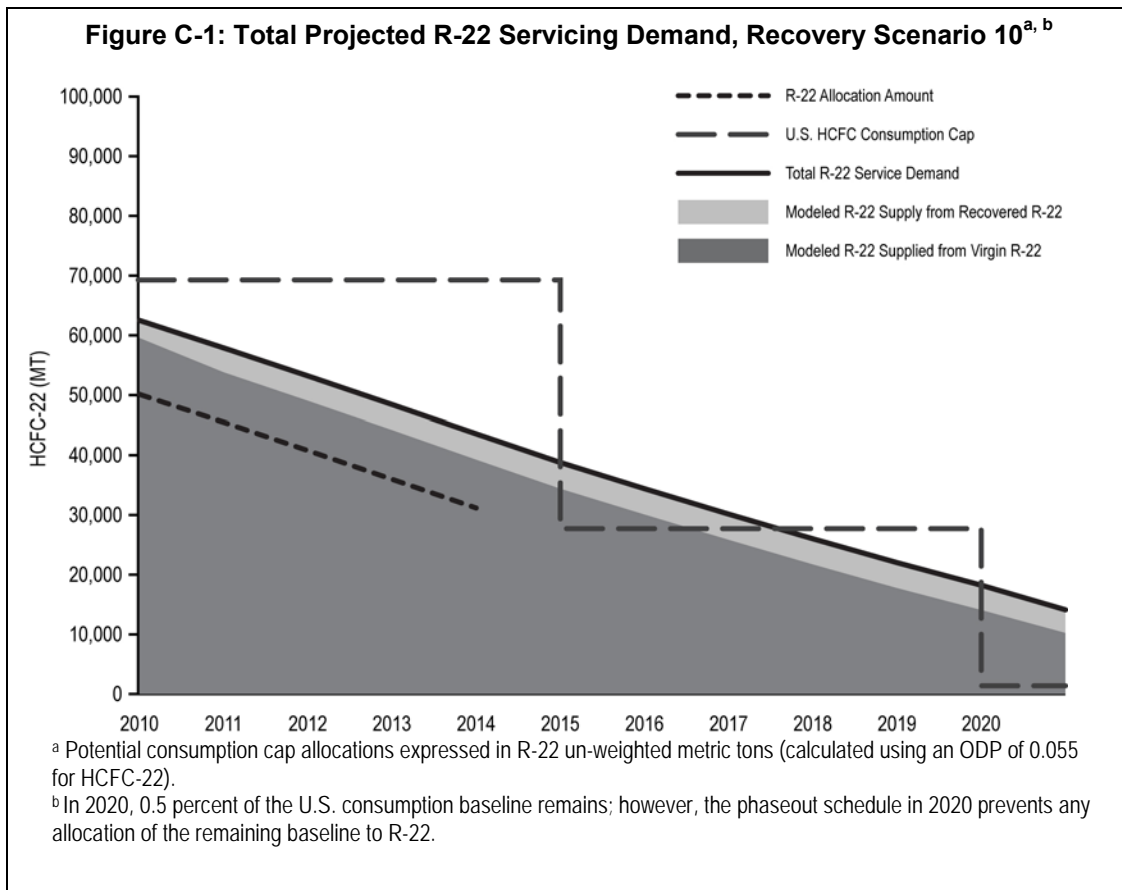

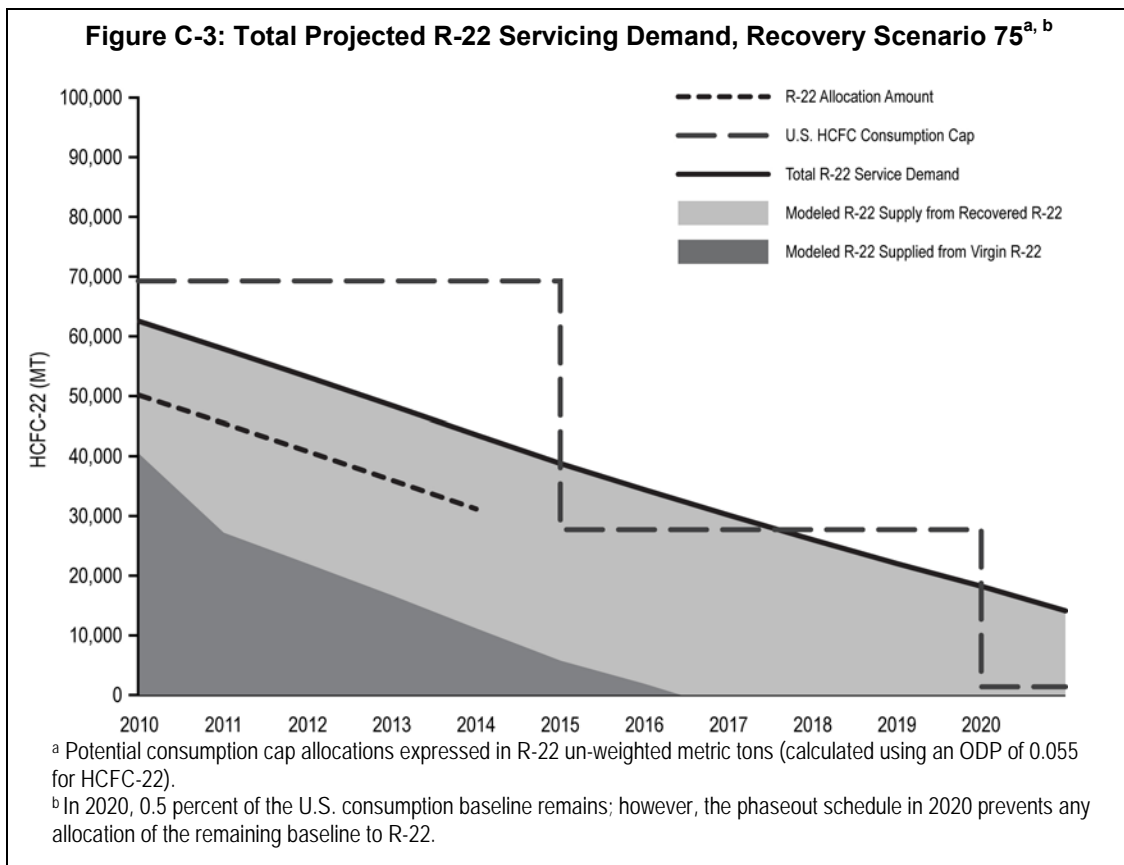
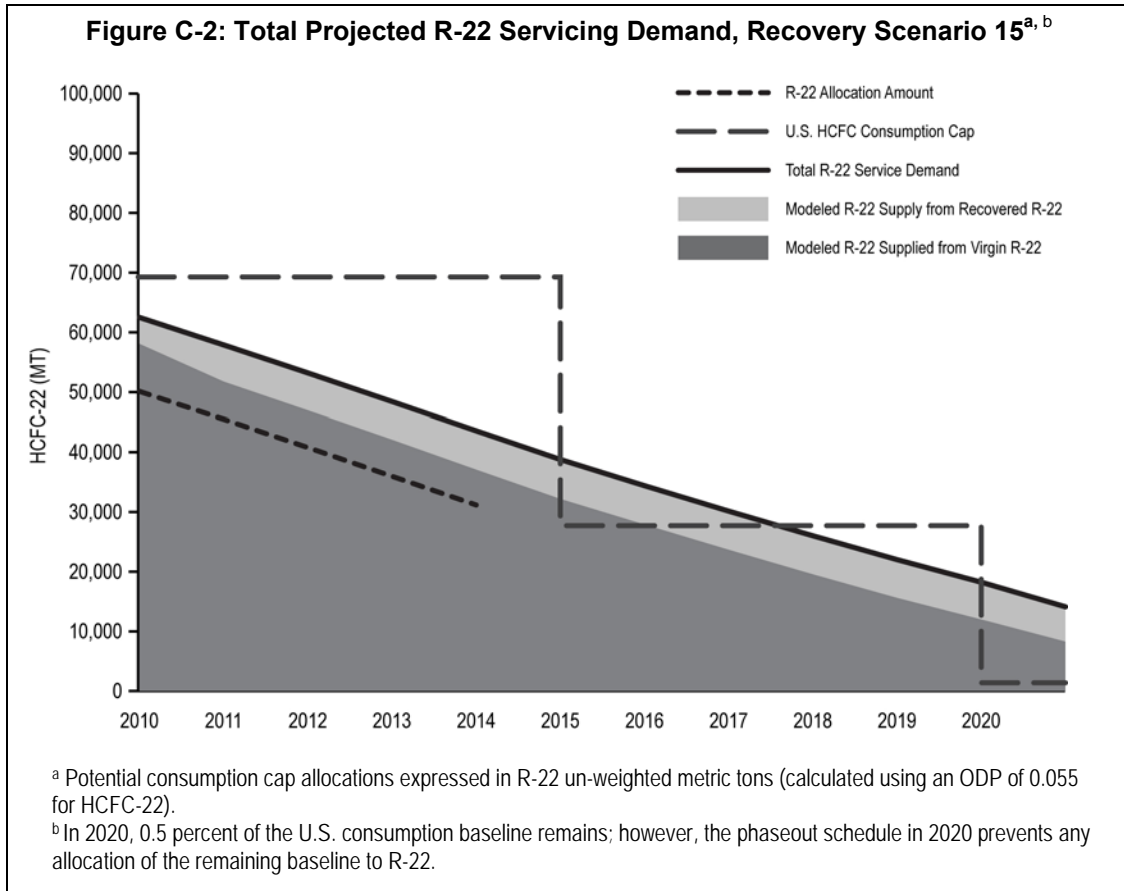


Table C-4 provides a summary of all five scenarios presented in this report to illustrate how recovered and virgin projected servicing supplies range with respect to meeting demand based on the different rates of recovery analyzed.

Table C-4: Comparison of HCFC-22 Servicing Demand Projections (Metric Tons) and Necessary Supply Projections by Source (Metric Tons and Percent), 2010, 2015, 2020

Year	Cap ^a	Demand	Recovery Rate Scenarios	Necessary Supply		
				Recovered	Virgin	Shortfall
2010	69,273	62,500	Scenario 10	3,000 (5%)	59,500 (95%)	0 (0%)
			Scenario 15	4,400 (7%)	58,100 (93%)	0 (0%)
			Scenario 20	5,900 (9%)	56,600 (91%)	0 (0%)
			Scenario 50	14,800 (24%)	47,700 (76%)	0 (0%)
			Scenario 75	22,300 (36%)	40,200 (64%)	0 (0%)
2015	27,709	38,800	Scenario 10	4,400 (11%)	34,400 (89%)	6,690 (17%)
			Scenario 15	6,600 (17%)	32,200 (83%)	4,490 (12%)
			Scenario 20	8,800 (23%)	30,000 (77%)	2,290 (6%)
			Scenario 50	22,000 (57%)	16,800 (43%)	0 (0%)
			Scenario 75	33,000 (85%)	5,700 (15%)	0 (0%)
2020	0	18,200	Scenario 10	4,200 (23%)	14,100 (77%)	14,100 (77%)
			Scenario 15	6,200 (34%)	12,000 (66%)	12,000 (66%)
			Scenario 20	8,300 (46%)	9,900 (54%)	9,900 (54%)
			Scenario 50	18,200 (100%)	0 (0%)	0 (0%)
			Scenario 75	31,200 (>100%)	0 (0%)	0 (0%)

^a HCFC consumption cap expressed in R-22 metric tons to represent an allocation of 100 percent of the cap assigned to R-22. In 2020, 0.5 percent of the U.S. consumption baseline remains; however, the phaseout schedule in 2020 prevents any allocation of the remaining baseline to R-22.

Source: Based on modeling assumptions using EPA, 2007a.

6. References

- Airgas. 2006. Personal communication between Lauren Flinn, ICF International, and Bob Mueller, Director, Utility & CPI Industries, Airgas. August 2006.
- The Alliance for Responsible Atmospheric Policy. 2006. Comment submitted in response to EPA's Notice of Data Availability (NODA, 70 FR 67172), November 4, 2005. EDocket ID Number, OAR-2003-0130, Document ID No. 0172, 0174, January 19, 2006, January 26, 2006.
- Amtrak. 2005. Email correspondence between Iliriana Mushkolaj, ICF Consulting and Madina Alharazim, Amtrak. July 2005.
- ARI. 2005. Personal communication and transcribed correspondence between Lauren Flinn, ICF Consulting and Karim Amrane, Air-Conditioning and Refrigeration Institute (ARI). March to June 2005.
- Arkema. 2009. Comment submitted in response to EPA's Notice of Data Availability (NODA, 40 FR Part 82). December 23, 2008. EDocket ID Number, OAR-2008-0496, Document ID No. 0111.1, March, 9, 2009.
- Carrier Corporation. 2005a. Personal communication and transcribed correspondence between Lauren Flinn, ICF Consulting and Fred Keller, Carrier Corporation. June 2005.
- Carrier Corporation. 2005b. Personal communication between Iliriana Mushkolaj, ICF Consulting and Chris Repice, Carrier Corporation. June 2005.
- Cold Ships. 2009. Personal communication between Lauren Flinn, ICF International and Gerald Donovan, Cold Ships. October, 2009.
- DOE. 2004. Department of Energy Press Release. "Energy Department Will Enforce 13 SEER Air Conditioner Standard." Number R-04-064. April 2, 2004.
- DOE. 2001. Federal Register. "Consumer products; energy conservation program: Central air conditioners and central air conditioning heat pumps—Energy conservation standards; Final Rule." Volume 66, Number 14. January 22, 2001. 10 CFR, Part 430. Available at http://frwebgate.access.gpo.gov/cgi-bin/getdoc.cgi?dbname=2001_register&docid=01-1790-filed
- Dymlin, John. *Refrigerants in Flux*. 2006. RSES Journal. June 2006.
- Emerson, 2007. *Emerson Survey Gauges Industry Readiness for 2010 Phaseout of R-22 Equipment*. November, 29, 2007. Available at: http://www.emersonclimate.com/NEWS/News/CC_002238.htm
- EPA. 2009. Summary of Refrigerant Reclamation 2000-2008. Available at <http://www.epa.gov/ozone/title6/608/reclamation/recsum.pdf>. Accessed July 2009.
- EPA. 2007a. *U.S. EPA Vintaging Model*. Version VM IO file 11-12-07_ALL.
- EPA. 2007b. HCFC Phaseout Schedule. Available at <http://www.epa.gov/ozone/title6/phaseout/hcfc.html>. Accessed December 2007.
- EPA. 2004a. Federal Register. "Protection of Stratospheric Ozone: Refrigerant Recycling: Substitute Refrigerants; Final Rule." Volume 69, Number 49. March 12, 2004. 40 CFR, Part 82. Available online at <http://www.epa.gov/ozone/title6/608/regulations/69fr11946.pdf>.
- EPA. 2004b. "Analysis of Costs to Abate International Ozone-Depleting Substance Substitute Emissions." Office of Air and Radiation, U.S. Environmental Protection Agency, Report No. EPA 430-R-04-006. Washington, DC, June 2004.

EPA. 2003a. Federal Register. "Protection of Stratospheric Ozone: Allowance System for Controlling HCFC Production, Import and Export." Volume 68, Number 13. January 23, 2003. 40 CFR, Part 82. Available at <http://www.epa.gov/ozone/title6/phaseout/68fr2819.pdf>.

EPA. 2003b. "Regulatory Impact Analysis: The Substitutes Recycling Rule (Section 608 of the Clean Air Act Amendments of 1990)." September 16, 2003. U.S. EPA, Global Programs Division, Office of Air and Radiation.

FMI. 1995. *Guidelines for the Use of Alternative Refrigerants in the Supermarket*. The Education and Research Departments, Food Marketing Institute. Released September 1995.

Greyhound. 2005. Personal communication between Iliriana Mushkolaj, ICF Consulting and Mario Nava, Greyhound. June 2005.

HARDI. 2009. Comment submitted in response to EPA's Notice of Data Availability (NODA, 40 FR Part 82). December 23, 2008. EDocket ID Number, OAR-2008-0496, Document ID No. 0117.1, March, 9, 2009.

HARDI. 2005. Personal communication and transcribed correspondence between Lauren Flinn, ICF Consulting and Bud Healy, Heating, Airconditioning & Refrigeration Distributors International (HARDI). February 2005.

HARDI. 2004. *The Status of Refrigerant 410A For New A/C Equipment*. Heating, Air-conditioning, & Refrigeration Distributors International (HARDI), Refrigeration Systems Council Report to Industry. March 15, 2004.

Hill Phoenix. 2009. Personal communication between Emily Herzog, ICF International and Scott Martin, Hill Phoenix. May 2009.

Hill Phoenix. 2005. Personal communication and transcribed correspondence between Lauren Flinn, ICF Consulting and Scott Martin, Hill Phoenix. February and June 2005.

Home Energy Center. 2006. Personal communication between Charlotte Coultrap-Bagg, ICF International and Steve Woolery, Home Energy Center. August 23, 2006.

Honeywell. 2005. Personal communication and transcribed correspondence between Mollie Averyt, ICF Consulting and David Metcalf and Steven Bernhardt, Honeywell. February 2005.

Hussmann/Ingresoll Rand. 2009. Personal communication between Julia Forge, ICF International, and Bryan Ware, Hussman/Ingresoll Rand. July 2009.

Johnson Controls, 2009. Personal communication between Lauren Flinn, ICF International and Chris Forth, Johnson Controls.

Kysor/Warren. 2009. Personal communication between Emily Herzog, ICF International, and Travis Lumpkin, Kysor/Warren. May 2009.

Motorcoach Training. 2005. Personal communication and transcribed correspondence between Lauren Flinn, ICF Consulting and Joe Pemberton, Motorcoach Training. June to July 2005.

NASA. 2008. Personal communication and transcribed correspondence between Lauren Smith, ICF International, and David Wallace, NASA. March 2008.

National Refrigerants, Inc. 2006. Comments submitted in response to EPA's Notice of Data Availability (NODA, 70 FR 67172), November 4, 2005. EDocket ID Number, OAR-2003-0130, Document ID No. 0170, 0170.1, January 2, 2006.

Skaer, Mark. 2007. *Average SEERs Rise in Residential Sector*. Air Conditioning, Heating & Refrigeration News. September 10, 2007.

UNEP. 2003a. Report of the Technology and Economic Assessment Panel of the Montreal Protocol, TEAP HCFC Task Force, May 2003. Ozone Secretariat, United Nations Environment Programme. Available online at: http://ozone.unep.org/teap/Reports/Other_Task_Force/HCFC03R1.pdf.

UNEP. 2003b. *Handbook for the International Treaties for the Protection of the Ozone Layer. Sixth Edition*. United Nations Environment Programme, Ozone Secretariat. Available online at <http://www.unep.org/ozone/Handbook2003.shtml>.

UNEP. 2000. *The Montreal Protocol on Substances that Deplete the Ozone Layer*. Ozone Secretariat. United Nations Environment Programme. Available online at <http://ozone.unep.org/pdfs/Montreal-Protocol2000.pdf>.

US Census Bureau. 2009. U.S. International Trade Commission (USITC) Data Web. Accessed August 2009 from <<http://dataweb.usitc.gov>>.

U.S. HCFC Manufacturer Representatives. 2009. Personal communications between ICF International and HCFC manufacturers, including Halon Alternatives Research Corporation (HARC) and Honeywell. January-July 2009.

U.S. HCFC Manufacturer Representatives. 2008. Personal communications between ICF International and HCFC manufacturers, including AGC Chemicals, Honeywell, DuPont, Kivlan, Solvay, and York. February – March, 2008.

Verisae. 2009. Personal communication between Emily Herzog, ICF International, and Ted Gartland, Verisae. May 2009.

WMATA. 2005. Email correspondence between Lauren Flinn, ICF Consulting and Joan Lelacheur, Washington Metro Area Transit Authority. June 2005.