

Permit No.: AK-002146-6

United States Environmental Protection Agency
Region 10
1200 Sixth Avenue
Seattle, Washington 98101

**AUTHORIZATION TO DISCHARGE
UNDER THE
NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM**

In compliance with the provisions of the Clean Water Act, 33 U.S.C. §1251 et seq., as amended by the Water Quality Act of 1987, P.L. 100-4, the "Act", the

**The City of Wrangell
Wastewater Treatment Plant**

is authorized to discharge from a facility located at **Wrangell, Alaska** (latitude: 56° 27' 10"; longitude: 132° 22' 40")

to receiving waters named **Zimovia Strait**,

in accordance with the discharge point, specific limitations, monitoring requirements, management practices and other conditions set forth herein.

This permit shall become effective January 7, 2002.

This permit and the authorization to discharge shall expire at midnight, January 8, 2007.

Signed this 4th day of December 2001.



Randall F. Smith, Director
Office of Water, Region 10
U.S. Environmental Protection Agency

TABLE OF CONTENTS

I.	SPECIFIC LIMITATIONS AND REQUIREMENTS	3
A.	Effluent Limitations	3
B.	Monitoring Requirements	3
C.	Non-industrial Source Control Program	7
D.	Operation and Maintenance Plan	8
E.	Design Criteria Requirement	9
II.	MONITORING, RECORDING, AND REPORTING REQUIREMENTS	9
A.	Representative Sampling	9
B.	Monitoring Procedures	9
C.	Reporting of Monitoring Results	9
D.	Additional Monitoring by the Permittee	10
E.	Records Contents	10
F.	Retention of Records	10
G.	Twenty-four Hour Notice of Noncompliance Reporting	11
H.	Other Noncompliance Reporting	12
I.	Inspection and Entry	12
III.	COMPLIANCE RESPONSIBILITIES	12
A.	Duty to Comply	12
B.	Penalties for Violations of Permit Conditions	12
C.	Need to Halt or Reduce Activity not a Defense	13
D.	Duty to Mitigate	13
E.	Proper Operation and Maintenance	13
F.	Removed Substances	14
G.	Bypass of Treatment Facilities	14
H.	Upset Conditions	15
IV.	GENERAL REQUIREMENTS	15
A.	Notice of New Introduction of Pollutants	15
B.	Control of Undesirable Pollutants	16
C.	Planned Changes	16
D.	Anticipated Noncompliance	16
E.	Permit Actions	16
F.	Duty to Reapply	17
G.	Duty to Provide Information	17
H.	Other Information	17
I.	Signatory Requirement	17
J.	Certification	18
K.	Availability of Reports	18
L.	Property Rights	18
M.	Severability	18
N.	Transfers	18
O.	State Laws	19
P.	Reopener Provision	19
V.	DEFINITIONS	19
	APPENDIX A	21

I. SPECIFIC LIMITATIONS AND REQUIREMENTS

A. Effluent Limitations

1. During the effective period of this permit, the permittee is authorized to discharge from outfall 001, subject to the restrictions set forth herein. This permit does not authorize the discharge of any waste streams, including spills and other unintentional or non-routine discharges of pollutants, that are not part of the normal operation of the facility as disclosed in the permit application, or any pollutants that are not ordinarily present in such waste streams.
2. There shall be no discharge of floating solids, visible foam, or oily wastes which produce a sheen on the surface of the receiving water.
3. The pH shall not be less than 6.5 standard units nor greater than 8.5 standard units.
4. Dissolved Oxygen shall not be less than 2.0 mg/L nor greater than 17.0 mg/L.
5. The following effluent limits shall apply at all times:

Effluent Parameter	Unit of Measurement	Monthly Average	Maximum Daily
Flow	million gallons/day	0.6	3.6
Five day Biochemical Oxygen Demand (BOD ₅)	mg/L	120*	200
	lbs/day	601	1001
Total Suspended Solids (TSS)	mg/L	140*	200
	lbs/day	701	1001
Fecal Coliform Bacteria	colonies/100 mL	1.0 x 10 ⁵	1.5 x 10 ⁶
Total Residual Chlorine**	mg/L	---	0.1

* The average monthly percent removal shall be greater than or equal to 30%

** This limit will only apply if chlorination is used for disinfection.

B. Monitoring Requirements

1. Annual Reporting

In addition to the monthly Discharge Monitoring Report (DMR) required under Part II.C. of this permit, an annual written report, covering the previous calendar year, shall be submitted to Environmental Protection Agency (EPA) by **January 15** of each year. The annual report shall contain summaries of the receiving water quality monitoring data, and

any sediment analyses or bioaccumulation results if required in the previous year. In addition to summarizing the data, the permittee shall also evaluate and interpret data in relation to the magnitude and ecological significance of observed changes in the parameters measured. Potential changes in water quality, sediment chemistry, and biological parameters over time and with distance from the outfall, shall be addressed. All reports will address compliance with water quality standards by using appropriate descriptive and statistical methods to test for and to describe any impacts of the effluent on water quality.

2. Influent and Effluent Monitoring Requirements

During the effective period of this permit, the following monitoring requirements shall apply:

Table 2. INFLUENT/EFFLUENT MONITORING REQUIREMENTS			
Effluent Parameter¹	Sample Location	Sample Frequency	Sample Type
Flow, mgd	effluent	continuous	recorder
Five day Biochemical Oxygen Demand (BOD ₅), mg/L	influent & effluent ²	1/week ³	24-hour composite
Total Suspended Solids (TSS), mg/L	influent & effluent ²	1/week ⁴	24-hour composite
pH, s.u. ⁵	effluent	1/week	grab
Fecal Coliform Bacteria, colonies/100ml	effluent	1/month	grab
Total Ammonia as N, mg/L	effluent	1/quarter	24-hour composite
Temperature, °C	effluent	1/week	grab
Dissolved Oxygen (DO), mg/L	effluent	1/week	grab
Total Residual Chlorine ⁶	effluent	1/month	grab
Notes:			
1 If the discharge concentration falls below the method detection limit (MDL), the permittee shall report the effluent concentration as "less than (numerical MDL)" on the DMR. Actual analytical results shall be reported on the DMR when the results are greater than the MDL. For averaging, samples below the MDL shall be assumed equal to zero. The permittee shall report the number of non-detects for the month in the "comments section" of the DMR.			
2 Influent and effluent sampling is required. Samples shall be collected during the same 24-hour period. The percent removal for BOD ₅ and TSS shall be reported on each monthly DMR.			
3 Sampling for BOD reverts to monthly after the new treatment plant achieves 12 consecutive months at full compliance with BOD effluent limitations and percent removals.			
4 Sampling for TSS reverts to monthly after the new treatment plant achieves 12 consecutive months at full compliance with TSS effluent limitations and percent removals.			
5 The permittee shall report the number of pH excursions during the month with the DMR for that month.			
6 Monitoring is required only if chlorination is used for disinfection.			

Influent and effluent monitoring results shall be reported monthly as specified in Part II.C. (Reporting of Monitoring Results). Quarterly reporting of ammonia shall be included in the DMRs for April, July, October and January (none due in January 2002).

3. Receiving Water Quality Monitoring Requirements

The permittee shall implement the receiving water quality monitoring program as described below. The primary objectives of this program are: a) to assess compliance with the water quality standards and the criteria in Section 301(h) of the Act; b) to assess whether changes in permit conditions are warranted; and c) to provide data for evaluating the reissuance of this permit.

Sampling stations shall be established using an electronic navigational aid to ensure that the same sampling stations are occupied during subsequent sampling events. In addition, efforts shall be made to prevent the sampling vessel from drifting off the sampling site.

Table 3 Ambient Monitoring Requirements			
Parameter.	Station Location¹	Depth	Monitoring Frequency
Turbidity, nephelometric turbidity units (NTU)	1000 feet NW of ZID 1000 feet SE of ZID <5m NW of ZID boundary <5m SE of ZID boundary	surface, mid-depth, and bottom	Annually in August or September
Secchi Disk Depth	1000 feet NW of ZID 1000 feet SE of ZID <5m NW of ZID boundary <5m SE of ZID boundary	surface waters only	Annually in August or September
Dissolved oxygen, mg/L	1000 feet NW of ZID 1000 feet SE of ZID <5m NW of ZID boundary <5m SE of ZID boundary	surface, mid-depth, and bottom	Annually in August or September
pH, s.u.	1000 feet NW of ZID 1000 feet SE of ZID <5m NW of ZID boundary <5m SE of ZID boundary	surface, mid-depth, and bottom	Annually in August or September
Salinity, ppt	1000 feet NW of ZID 1000 feet SE of ZID <5m NW of ZID boundary <5m SE of ZID boundary	every 3 m (w/one station at outfall depth)	Annually in August or September
Temperature, °C	1000 feet NW of ZID 1000 feet SE of ZID <5m NW of ZID boundary <5m SE of ZID boundary	every 3 m (w/one station at outfall depth)	Annually in August or September

Parameter	Station Location ¹	Depth	Monitoring Frequency
Total Ammonia as N, mg/L	1000 feet NW of ZID 1000 feet SE of ZID <5m NW of ZID boundary <5m SE of ZID boundary	surface waters only (above 1.0 m)	Annually in August or September
Fecal coliform, #/100ml	NW of outfall at MZ boundary SE of outfall at MZ boundary <5m NW of ZID boundary <5m SE of ZID boundary	surface waters only (above 15-30 cm)	April, June, August, November ²
Fecal coliform, #/100ml	At low tide or when a minus tide coincides with peak daily flow: Station 1: 1.5 m from shore along length of outfall Stations 2 & 3: 91 m to either side of station 1. Stations 4 & 5: where 1600m MZ touches the shoreline Area A: 1.5 m from shore (See map in Appendix A)	surface waters only (above 15-30 cm)	Monthly May through August for the life of the permit
<p>Notes:</p> <p>¹ Reference stations should be located at sites where water depth is equivalent to the outfall depth.</p> <p>² Monitoring may be decreased after two years to once per year (in August or September) if the results indicate that discharge has not caused Water Quality Standards (WQS) to be exceeded outside the mixing zone.</p>			

Sampling shall be done according to the above schedule and submitted in the Annual Report.

4. Biological Monitoring for Benthic Infauna and Sediment Analyses

Sediment analyses for total volatile solids (TVS) and a benthic survey shall be conducted at least once during the life of this permit. The sampling shall be coordinated, to the extent practicable, with the sampling times for the water quality monitoring program and may be conducted during maintenance dives. Samples shall be collected from the following five stations:

- the southeastern and northwestern boundary of the ZID,
- inside the ZID near the middle of the diffuser,
- and two reference stations at least 1000 feet northwest and southeast of the outfall.

One benthic sample and two TVS samples shall be collected at each station.

If sediment samples are collected from gravel or cobble substrates, analyses for TVS shall be done on the finer size fractions (silt and clay fractions, combined).

Benthic samples shall be stored. Analyses may be required if the EPA determines that substantial changes have occurred in TVS content of the sediments around the outfall. The stored samples for benthic community analysis shall be inspected every two to three months and any alcohol which has evaporated from the jars shall be replaced.

Data analyses for TVS shall be presented in the annual written report as mean values and standard deviations by stations.

5. Monitoring Program Plan including Quality Assurance Requirements

- a. Within **120 days of the effective date of this permit**, the permittee shall complete and implement a Monitoring Program Plan that includes a Quality Assurance/Quality Control (QA/QC) program.

This plan shall address the details of:

- all monitoring procedures (e.g., methods to insure adequate preservation of composite samples, methods of station location and relocation, identification of sampling equipment),
 - monitoring objectives,
 - specific QA/QC procedures including the method detection limits and precision requirements that will insure that program objectives are met,
 - how data will be used to evaluate the monitoring objectives,
 - name(s), address(es), and telephone number(s) of the laboratories, used by or proposed to be used by the permittee, and
 - other activities designed to achieve data quality goals for the monitoring programs.
- b. The document, *Guidance for Preparation of Quality Assurance Project Plans*, EPA, Region 10, Quality and Data Management Program, QA/G-5, may be used as a reference guide in preparing the QA/QC program. This document is available at www.epa.gov/r10earth/offices/oea/qaindex.htm.
- c. The permittee shall amend the Monitoring Program Plan whenever there is a modification in the sample collection, sample analysis, or other conditions or requirements of the plan.
- d. Copies of the Monitoring Program Plan shall be kept on site and shall be made available to EPA and ADEC upon request.

C. Non-industrial Source Control Program

Section 301(h) regulations require that the permittee implement a public education program designed to minimize the entrance of nonindustrial toxic

pollutants and pesticides into its POTW. Elements of the public education program shall include:

- development and dispersement of information containing non-hazardous alternatives to hazardous household products and pesticides;
- proper and free disposal of hazardous wastes in local newspapers including disposal guidelines specifying what toxic pollutants can and cannot be discharged to the sewer system; and
- Signs shall be placed on the shoreline near the fecal coliform mixing zone and the outfall line. The signs shall state that primary treated domestic wastewater is being discharged, that mixing zones exist, and certain activities, such as the harvesting of shellfish for raw consumption and bathing, should not take place within the mixing zone. The sign shall also have the name and owner of the facility, approximate location and size of the mixing zone and give a facility contact phone number for additional information a sign placed on the shoreline, near the mixing zone and outfall line that states that primary treated domestic wastewater is being discharged, that mixing zones do exist and that certain activities should not take place within the mixing zones. The signs shall also include the approximate location and size of the mixing zones and give a facility. An outfall sign must also be placed at the beach designated as a shellfish collection area. The sign shall state that the consumption of raw shellfish is not advised along with the advice of steaming shellfish for 4 - 9 minutes, discarding shellfish that do not open after steaming.

An annual report on the nonindustrial source control program shall be submitted by **January 15th** of the following year. This report shall summarize the actions taken, and their effectiveness, to control nonindustrial sources of toxic pollutants and pesticides.

D. Operation and Maintenance Plan

1. Within **180 days after the effective date** of this permit, the permittee shall review/develop and implement its operation and maintenance (O&M) plan and ensure that it includes appropriate best management practices (BMPs); the plan must be reviewed annually thereafter. BMPs include measures that prevent or minimize the potential for the release of pollutants to the Zimovia Strait. The O&M Plan shall be retained on site and made available to EPA and ADEC upon request.
2. The permittee shall develop a description of pollution prevention measures and controls appropriate for the facility. The appropriateness and priorities of controls in the O&M Plan shall reflect identified potential sources of pollutants at the facility. The description of BMPs shall address, to the extent practicable, the following minimum components:

- Spill prevention and control;
- Optimization of chemical usage;
- Preventive maintenance program;
- Minimization of pollutant inputs from industrial users;
- Research, develop and implement a public information and education program to control the introduction of household hazardous materials to the sewer system; and
- Water conservation.

E. Design Criteria Requirement

The design flow criteria for the permitted facility is 0.6 mgd. Each month, the permittee shall compute an annual average value for flow entering or exiting the facility based on the previous twelve months data. If the average annual value exceeds 85% of the design criteria value, the permittee shall notify EPA and develop a facility plan and schedule within **one year from the date of first reaching the annual average flow of 0.51 mgd**. The plan must include the permittee's strategy for continuing to maintain compliance with effluent limits and will be made available to the Director, ADEC or an authorized representative upon request.

II. MONITORING, RECORDING, AND REPORTING REQUIREMENTS

- A. Representative Sampling. Samples taken in compliance with the monitoring requirements established under Part I shall be collected from the effluent stream prior to discharge into the receiving waters. Samples and measurements shall be representative of the volume and nature of the monitored discharge. In order to ensure that the effluent limits set forth in this permit are not violated at times other than when routine samples are taken, the permittee shall collect additional samples whenever any discharge occurs that may reasonably be expected to cause or contribute to a violation that is unlikely to be detected by a routine sample. The permittee shall analyze the additional samples for those parameters limited in Part I.A. of this permit that are likely to be affected by the discharge.

The permittee shall collect such additional samples as soon as the spill, discharge, or bypassed effluent reaches the outfall. The samples shall be analyzed in accordance with paragraph II.B ("Monitoring Procedures"). The permittee shall report all additional monitoring in accordance with paragraph II.D ("Additional Monitoring by the Permittee").

- B. Monitoring Procedures. Monitoring must be conducted according to test procedures approved under 40 CFR 136, unless other test procedures have been specified in this permit or alternate methods have been approved by the EPA Water Office Director.
- C. Reporting of Monitoring Results. Monitoring results shall be summarized each month on the DMR form. The reports shall be submitted monthly and are to

be postmarked by the 15th day of the following month. Legible copies of these, and all other reports, shall be signed and certified in accordance with the requirements of Part IV.I. Signatory Requirements, and submitted to the Director, Office of Water and the State agency at the following addresses:

original to: United States Environmental Protection Agency
Region 10
NPDES Compliance Unit
1200 Sixth Avenue, OW-133
Seattle, Washington 98101
(206) 553-1280 fax

copy to: Alaska Department of Environmental Conservation
Division of Air and Water Quality
410 Willoughby Avenue, Suite 303
Juneau, Alaska 99709
(907) 465-5300
fax: 465-5274
May be submitted via scanned (.pdf, .bmp or .tif) document to:
wq_permit@envircon.state.ak.us

- D. Additional Monitoring by the Permittee. If the permittee monitors any pollutant more frequently than required by this permit, using test procedures approved under 40 CFR 136 or as specified in this permit, the permittee must include the results of this monitoring in the calculation and reporting of the data submitted in the DMR.

Upon request by the Director, the permittee must submit results of any other sampling, regardless of the test method used.

- E. Records Contents. Records of monitoring information shall include:

1. The date, exact place, and time of sampling or measurements,
2. The individual(s) who performed the sampling or measurements,
3. The date(s) analyses were performed,
4. The individual(s) who performed the analyses,
5. The analytical techniques or methods used, and
6. The results of such analyses.

- F. Retention of Records. The permittee shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by this permit, and records of all data used to complete the

application for this permit, for a period of at least **three years** from the date of the sample, measurement, report, or application. This period may be extended by request of the Director at any time. Data collected on-site, copies of DMRs, and a copy of this NPDES permit must be maintained on-site during the duration of activity at the permitted location.

G. Twenty-four Hour Notice of Noncompliance Reporting

1. The permittee must report the following occurrences of noncompliance by telephone within 24 hours from the time the permittee becomes aware of the circumstances:
 - a. any noncompliance that may endanger health or the environment;
 - b. any unanticipated bypass that exceeds any effluent limitation in the permit (See Permit Part III.G., "Bypass of Treatment Facilities");
 - c. any upset that exceeds any effluent limitation in the permit (See Permit Part III.H., "Upset Conditions");
 - d. any violation of a maximum daily discharge limitation for any of the pollutants in Table 2 of Permit Part I.A. requiring 24-hour reporting; or
 - e. any sanitary sewer overflow prior to the treatment works, whether or not such overflow endangers health or the environment or exceeds any effluent limitation in the permit.
2. The permittee must also provide a written submission within five days of the time that the permittee becomes aware of any event required to be reported under Permit Part II.G.1., above. The written submission must contain:
 - a. a description of the noncompliance (including location) and its cause;
 - b. the period of noncompliance, including exact dates and times;
 - c. the estimated time noncompliance is expected to continue if it has not been corrected;
 - d. steps taken or planned to reduce, eliminate, and prevent recurrence of the noncompliance; and
 - e. if the noncompliance involves an overflow prior to the treatment works, an estimate of the quantity (in gallons) of untreated flow.

3. The Director may waive the written report on a case-by-case basis if the oral report has been received within 24 hours by the NPDES Compliance Hotline in Seattle, Washington, by telephone, (206) 553-1846.
 4. Reports must be submitted to the addresses in Permit Part II.C. ("Reporting of Monitoring Results").
- H. Other Noncompliance Reporting. Instances of noncompliance not required to be reported within 24 hours shall be reported at the time that monitoring reports for Part II.C. are submitted. The reports shall contain the information listed in Part II.E.
- I. Inspection and Entry. The permittee shall allow the Director or an authorized representative (including an authorized contractor acting as a representative of the Administrator), upon the presentation of credentials and other documents as may be required by law, to:
1. Enter upon the permittee's premises where a regulated facility or activity is located or conducted, or where records must be kept under the conditions of this permit,
 2. Have access to and copy, at reasonable times, any records that must be kept under the conditions of this permit,
 3. Inspect at reasonable times any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under this permit, and
 4. Sample or monitor at reasonable times, for the purpose of assuring permit compliance or as otherwise authorized by the Act, any substances or parameters at any location.

III. COMPLIANCE RESPONSIBILITIES

- A. Duty to Comply. The permittee must comply with all conditions of this permit. Any permit noncompliance constitutes a violation of the Act and is grounds for: enforcement action; permit termination, revocation and re-issuance, or modification; or denial of a permit renewal application. The permittee shall give advance notice to the Director and ADEC of any planned changes in the permitted facility or activity which may result in noncompliance with permit requirements.
- B. Penalties for Violations of Permit Conditions
1. Civil and Administrative Penalties. Any person who violates a permit condition implementing Sections 301, 302, 306, 307, 308, 318, or 405 of the Act shall be subject to a civil or administrative penalty, not to exceed

the maximum amounts authorized by Sections 309(d) and 309(g) of the Act and the Federal Civil Penalties Inflation Adjustment Act (28 U.S.C. § 2461 note) as amended by the Debt Collection Improvement Act (31 U.S.C. § 3701 note).

2. Criminal Penalties

- a. Negligent Violations. Any person who negligently violates a permit condition implementing Sections 301, 302, 306, 307, 308, 318, or 405 of the Act shall, upon conviction, be punished by a fine and/or imprisonment as specified in Section 309(c)(1) of the Act.
 - b. Knowing Violations. Any person who knowingly violates a permit condition implementing Sections 301, 302, 306, 307, 308, 318, or 405 of the Act shall, upon conviction, be punished by a fine and/or imprisonment as specified in Section 309(c)(2) of the Act.
 - c. Knowing Endangerment. Any person who knowingly violates a permit condition implementing Sections 301, 302, 303, 306, 307, 308, 318, or 405 of the Act, and who knows at that time that he thereby places another person in imminent danger of death or serious bodily injury, shall, upon conviction, be subject to a fine and/or imprisonment as specified in Section 309(c)(3) of the Act.
 - d. False Statements. Any person who knowingly makes any false material statement, representation, or certification in any application, record, report, plan, or other document filed or required to be maintained under this Act or who knowingly falsifies, tampers with, or renders inaccurate any monitoring device or method required to be maintained under this Act, shall, upon conviction, be punished by a fine and/or imprisonment as specified in Section 309(c)(4) of the Act.
- C. Need to Halt or Reduce Activity not a Defense. It shall not be a defense for a permittee in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.
- D. Duty to Mitigate. The permittee shall take all reasonable steps to minimize, or prevent, any discharge, or sludge use or disposal, in violation of this permit which has a reasonable likelihood of adversely affecting human health or the environment.
- E. Proper Operation and Maintenance. The permittee shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed, or used, by the permittee to achieve compliance with the conditions of this permit. Proper operation and maintenance also includes adequate laboratory controls and quality assurance procedures. This provision requires the operation of back-up or

auxiliary facilities or similar systems which are installed by a permittee only when the operation is necessary to achieve compliance with the conditions of the permit.

- F. Removed Substances. Collected screenings, grit, solids, sludges, filter backwash, or other pollutants removed in the course of treatment or control of waste waters shall be disposed of in a manner such as to prevent any pollutant from such materials from entering navigable waters.
- G. Bypass of Treatment Facilities
1. Bypass not exceeding limitations. The permittee may allow any bypass to occur which does not cause effluent limitations to be exceeded, but only if it also is for essential maintenance to assure efficient operation. These bypasses are not subject to the provisions of paragraphs 2 and 3 of this section.
 2. Notice
 - a. Anticipated Bypass. If the permittee knows in advance of the need for a bypass, it shall submit prior notice, if possible, at least **10 days** before the date of the bypass.
 - b. Unanticipated Bypass. The permittee shall submit notice of an unanticipated bypass as required under Part II.G. Twenty-four Hour Notice of Noncompliance Reporting.
 3. Prohibition of Bypass
 - a. Bypass is prohibited and the Director may take enforcement action against a permittee for a bypass, unless:
 - (1) The bypass was unavoidable to prevent loss of life, personal injury, or severe property damage;
 - (2) There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgement to prevent a bypass which occurred during normal periods of equipment downtime or preventive maintenance; and
 - (3) The permittee submitted notices as required under paragraph 2 of this section.

- b. The Director may approve an anticipated bypass, after considering its adverse effects, if the Director determined that it will meet the three conditions listed above in paragraph 3.a. of this section.

H. Upset Conditions

1. Effect of an upset. An upset constitutes an affirmative defense to an action brought for noncompliance with such technology-based permit effluent limitations if the requirements of paragraph 2 of this section are met. No determination made during administrative review of claims that noncompliance was caused by upset, and before an action for noncompliance, is final administrative action subject to judicial review.
2. Necessary upset demonstration conditions. A permittee who wishes to establish the affirmative defense of upset shall demonstrate, through properly signed, contemporaneous operating logs, or other relevant evidence that:
 - a. An upset occurred and that the permittee can identify the cause(s) of the upset,
 - b. The permitted facility was at the time being properly operated,
 - c. The permittee submitted notice of the upset as required under Part II.G. Twenty-four Hour Notice of Noncompliance Reporting, and
 - d. The permittee complied with any remedial measures required under Part III.D. Duty to Mitigate.
3. Burden of proof. In any enforcement proceeding, the permittee seeking to establish the occurrence of an upset has the burden of proof.

IV. GENERAL REQUIREMENTS

A. Notice of New Introduction of Pollutants

1. The permittee shall provide adequate notice to the Director, Office of Water, and ADEC of:
 - a. Any new introduction of pollutants into the treatment works from an indirect discharger which would be subject to Sections 301 or 306 of the Act if it were directly discharging those pollutants, and
 - b. Any substantial change in the volume or character of pollutants being introduced into the treatment works by a source introducing pollutants into the treatment works at the time of issuance of the permit.

2. For the purposes of this section, adequate notice shall include information on:
 - a. The quality and quantity of effluent to be introduced into such treatment works, and
 - b. Any anticipated impact of the change on the quantity or quality of effluent to be discharged from such publicly owned treatment works.
- B. Control of Undesirable Pollutants. Under no circumstances shall the permittee allow introduction of the following wastes into the waste treatment system:
 1. Wastes which will create a fire or explosion hazard in the treatment works;
 2. Wastes which will cause corrosive structural damage to the treatment works, but in no case, wastes with a pH lower than 5.0, unless the treatment works is designed to accommodate such wastes;
 3. Solid or viscous substances in amounts which cause obstructions to the flow in sewers, or interference with the proper operation of the treatment works;
 4. Waste waters at a flow rate and/or pollutant discharge rate which is excessive over relatively short time periods so that there is a treatment process upset and subsequent loss of treatment efficiency; and
 5. Any pollutant, including oxygen demanding pollutants (e.g., BOD, etc.) released in a discharge of such volume or strength as to cause interference in the treatment works.
- C. Planned Changes. The permittee shall give notice to the Director and ADEC as soon as possible of any planned physical alterations or additions to the permitted facility. Notice is required only when the alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants which are not subject to effluent limitations in the permit. Notice is also required when the alteration or addition results in a significant change in the permittee's sludge use or disposal practices, including notification of additional use or disposal sites not reported during the permit application process.
- D. Anticipated Noncompliance. The permittee shall give advance notice to the Director and ADEC of any planned changes in the permitted facility or activity which may result in noncompliance with permit requirements.
- E. Permit Actions. This permit may be modified, revoked and reissued, or terminated for cause. The filing of a request by the permittee for a permit modification, revocation and reissuance, termination, or a notification of

planned changes or anticipated noncompliance, does not stay any permit condition.

- F. **Duty to Reapply.** If the permittee wishes to continue an activity regulated by this permit after the expiration date of this permit, the permittee must apply for and obtain a new permit. The application should be submitted at least **180 days before the expiration date** of this permit. The application shall include an updated industrial user survey and priority pollutant scan.
- G. **Duty to Provide Information.** The permittee shall furnish to the Director, within a reasonable time, any information which the Director may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit, or to determine compliance with this permit. The permittee shall also furnish to the Director, upon request, copies of records required to be kept by this permit.
- H. **Other Information.** When the permittee becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or any report to the Director or ADEC, it shall promptly submit such facts or information.
- I. **Signatory Requirement.** All applications, reports or information submitted to the Director and ADEC shall be signed and certified.
 - 1. All permit applications shall be signed as follows:
 - a. For a corporation: by a responsible corporate officer.
 - b. For a partnership or sole proprietorship: by a general partner or the proprietor, respectively.
 - c. For a municipality, state, federal, or other public agency: by either a principal executive officer or ranking elected official.
 - 2. All reports required by the permit and other information requested by the Director or ADEC shall be signed by a person described above or by a duly authorized representative of that person. A person is a duly authorized representative only if:
 - a. The authorization is made in writing by a person described above and submitted to the Director and ADEC, and
 - b. The authorization specifies either an individual or a position having responsibility for the overall operation of the regulated facility or activity, such as the position of plant manager, operator of a well or a well field, superintendent, position of equivalent responsibility, or an individual or position having overall responsibility for environmental matters for the organization.

3. Changes to authorization. If an authorization under Part IV.I.2 is no longer accurate because a different individual or position has responsibility for the overall operation of the facility, a new authorization satisfying the requirements of Part IV.I.2. must be submitted to the Regional Administrator and ADEC prior to or together with any reports, information, or applications to be signed by an authorized representative.

J. Certification. Any person signing a document under this section shall make the following certification:

"I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations."

K. Availability or Reports. Except for data determined to be confidential under 40 CFR 2, all reports prepared in accordance with the terms of this permit shall be available for public inspection at the offices of the Director. As required by the Act, permit applications, permits, and effluent data shall not be considered confidential.

L. Property Rights. The issuance of this permit does not convey any property rights of any sort, or any exclusive privileges, nor does it authorize any injury to private infringement of federal, state, or local laws or regulations.

M. Severability. The provisions of this permit are severable, and if any provision of this permit, or the application of any provision of this permit to any circumstance, is held invalid, the application of such provision to other circumstances, and the remainder of this permit, shall not be affected thereby.

N. Transfers. This permit may be automatically transferred to a new permittee if:

1. The current permittee notifies the Director at least **30 days** in advance of the proposed transfer date,
2. The notice includes a written agreement between the existing and new permittee's containing a specific date for transfer of permit responsibility, coverage, and liability between them, and
3. The Director does not notify the existing permittee and the proposed new permittee of his or her intent to modify, or revoke and reissue the permit.

If this notice is not received, the transfer is effective on the date specified in the agreement mentioned in paragraph 2 above.

- O. State Laws. Nothing in this permit shall be construed to preclude the institution of any legal action or relieve the permittee from any responsibilities, liabilities, or penalties established pursuant to any applicable state law or regulation under authority preserved by Section 510 of the Act.
- P. Reopener Provision. This permit is subject to modification, revocation and reissuance, or termination at the request of any interested person (including the permittee) or upon EPA initiative. However, permits may only be modified, revoked or reissued, or terminated for the reasons specified in 40 CFR Parts 122.62, 122.63 or 122.64, and 40 CFR Part 124.5. This includes new information which was not available at the time of permit issuance and would have justified the application of different permit conditions at the time of issuance and includes, but is not limited to, future monitoring results. All requests for permit modification must be addressed to the EPA in writing and shall contain facts or reasons supporting the request.

V. DEFINITIONS

"Average monthly discharge limitation" means the highest allowable average of "daily discharges" over a calendar month, calculated as the sum of all "daily discharges" measured during a calendar month divided by the number of "daily discharges" measured during that month.

"Average weekly discharge limitation" means the highest allowable average of "daily discharges" over a calendar week, calculated as the sum of all "daily discharges" measured during a calendar week divided by the number of "daily discharges" measured during that week.

"Biosolids" means any sludge or material derived from sludge that can be beneficially used. Beneficial use includes, but is not limited to, land application to agricultural land, forest land, a reclamation site or sale or give away to the public for home lawn and garden use.

"Daily discharge" means the discharge of a pollutant measured during a calendar day or any 24-hour period that reasonably represents the calendar day for purposes of sampling. For pollutants with limitations expressed in units of mass, the "daily discharge" is calculated as the total mass of the pollutant discharged over the day. For pollutants with limitations expressed in other units of measurement, the "daily discharge" is calculated as the average measurement of the pollutant over the day.

A *"Grab"* sample is a single sample or measurement taken at a specific time or over as short a period of time as is feasible.

"Maximum daily discharge limitation" means the highest allowable "daily discharge".

"*Method detection limit (MDL)*" is the minimum concentration of an analyte that can be measured and reported with 99 percent confidence that the analyte concentration is greater than zero as determined by a specific laboratory method (40 CFR 136).

"*Mixing Zone*" is the volume contained within a 1,600 meter radial distance from the outfall.

"*Pathogen*" means an organism that is capable of producing an infection or disease in a susceptible host.

"*Pollutant*," for the purposes of this permit, is an organic substance, an inorganic substance, a combination of organic and inorganic substances, or pathogenic organisms that, after discharge and upon exposure, ingestion, inhalation, or assimilation into an organism either directly from the environment or indirectly by ingestion through the food-chain, could, on the basis of information available to the Administrator of the EPA, cause death, disease, behavioral abnormalities, cancer, genetic mutations, physiological malfunctions (including malfunction in reproduction), or physical deformations in either organisms or offspring of the organisms.

"*Sewage sludge*" means solid, semi-solid, or liquid residue generated during the treatment of domestic sewage and/or a combination of domestic sewage and industrial waste of a liquid nature in a Treatment works. Sewage sludge includes, but is not limited to, domestic septage; scum or solids removed in primary, secondary, or advanced wastewater treatment processes; and a material derived from sewage sludge. Sewage sludge does not include ash generated during the incineration of sewage sludge or grit and screenings generated during preliminary treatment of domestic sewage in a Treatment Works. These must be disposed of in accordance with 40 CFR 258.


A "*24-hour composite*" sample shall mean a flow-proportioned mixture of not less than eight discrete aliquots. Each aliquot shall be a grab sample of not less than 100 mL and shall be collected and stored in accordance with procedures prescribed in the most recent edition of *Standard Methods for the Examination of Water and Wastewater*.

"*Toxic pollutants*" are those substances listed in 40 CFR 401.15.

"*Upset*" means an exceptional incident in which there is unintentional and temporary noncompliance with technology-based permit effluent limitations because of factors beyond the reasonable control of the permittee. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation.

The "*ZID*" is the Zone of Initial Dilution. The ZID is defined by the volume of water centered over the outfall diffuser with a radius of 100 feet.

APPENDIX A

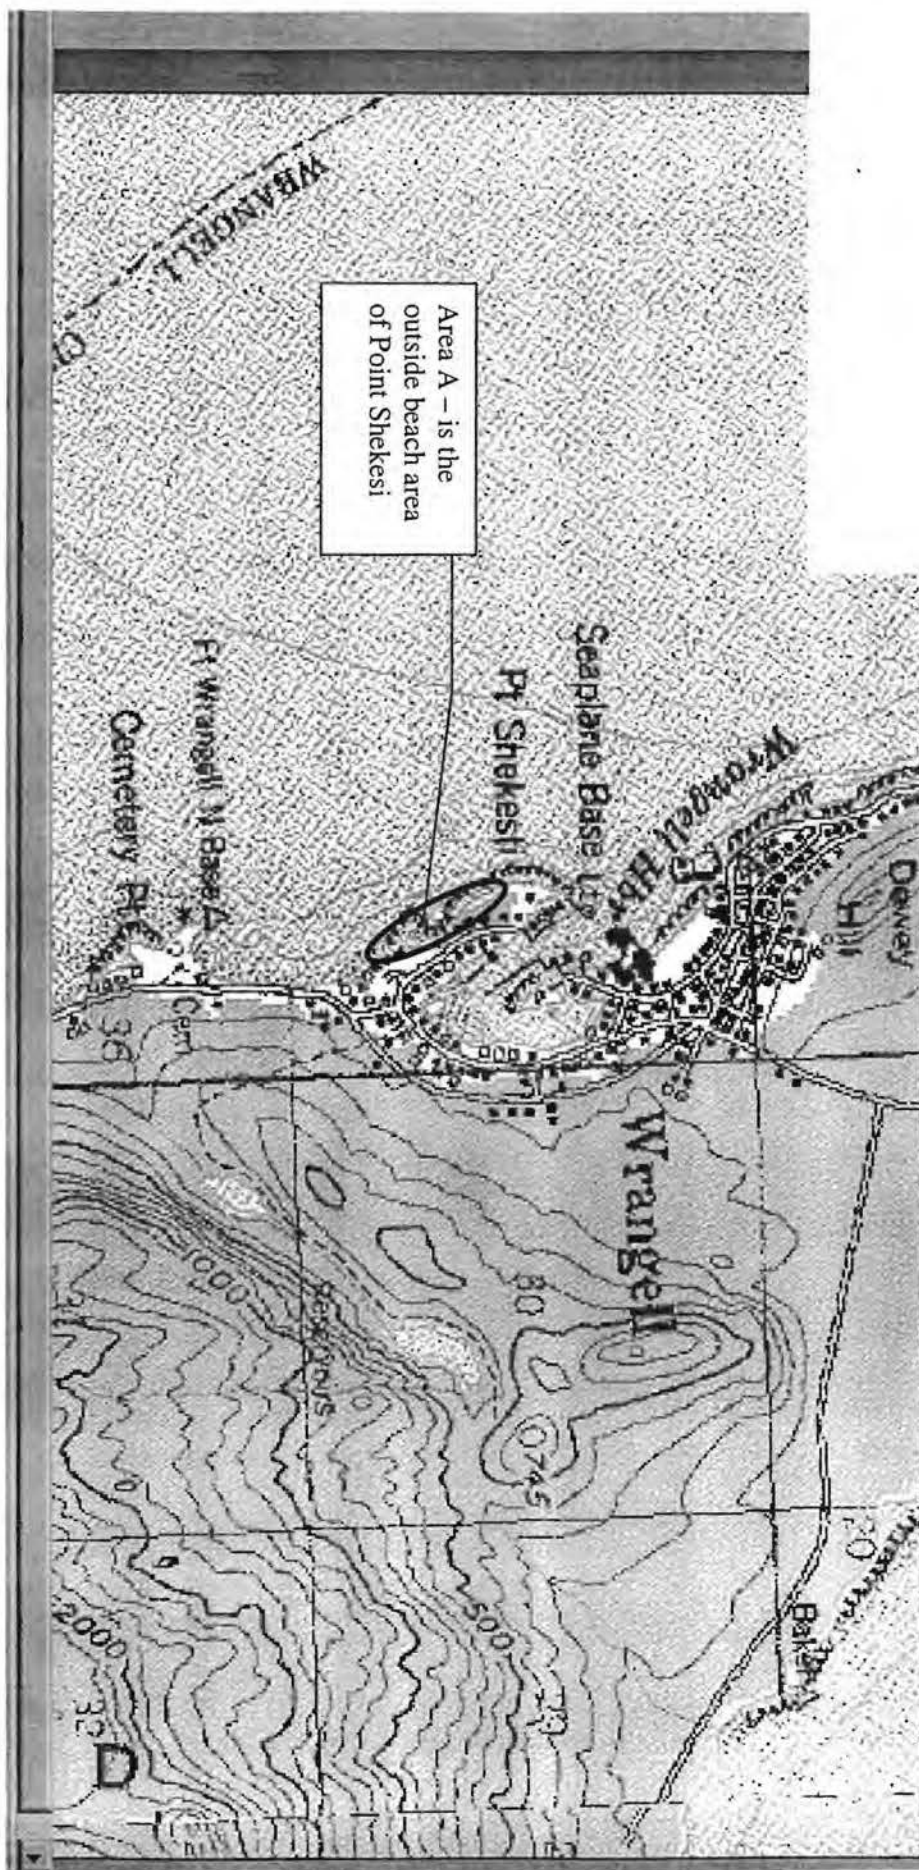

Area A - is the
outside beach area
of Point Shekesli