

REGULATION NO. 62.5
AIR POLLUTION CONTROL STANDARDS

STANDARD NO. 1 EMISSIONS FROM BURNING OPERATIONS

SECTION I - VISIBLE EMISSIONS

A. Existing Sources

No one shall discharge to the ambient air from any existing source constructed prior to February 11, 1971, smoke which exceeds an opacity of forty (40) percent. The forty (40) percent opacity limit may be exceeded for soot blowing, but may not be exceeded for more than six (6) minutes in a one hour period nor be exceeded for more than a total of twenty-four (24) minutes in a twenty-four (24) hour period. Emissions caused by soot blowing shall not exceed sixty (60) percent.

B. New Sources

No one shall discharge to the ambient air from any source constructed on or after February 11, 1971, smoke which exceeds an opacity of twenty (20) percent. The twenty (20) percent opacity limit may be exceeded for soot blowing, but may not be exceeded for more than six (6) minutes in a one hour period nor be exceeded for more than a total of twenty-four (24) minutes in a twenty-four (24) hour period. Emissions caused by soot blowing shall not exceed sixty (60) percent.

C. Special Provisions

Owners and operators shall, to the extent practicable, maintain and operate any source including associated air pollution control equipment in a manner consistent with good air pollution control practices for minimizing emissions. In addition, the owner or operator of fuel burning sources except natural gas and propane fired units, shall maintain a log of the time, magnitude, duration and any other pertinent information to determine periods of startup and shutdown and make available to the Department upon request.

D. Test Method

The method which is approved by the Department for determining compliance with opacity limitations under this Section is EPA Reference Method 9 (40 CFR 60, Appendix A, as revised July 1, 1986). Alternate methods may be utilized only if approved in advance by the Department and by the Environmental Protection Agency (EPA).

THIS IS THE FEDERALLY APPROVED REGULATION AS OF **JUN 25, 2018.**

	Date Submitted to EPA	Date Approved by EPA	Federal Register
Original Reg:	JAN 21, 1972	MAY 31, 1972	37 FR 10842
1st Revision:	DEC 20, 1978	JAN 29, 1980	45 FR 6572
2nd Revision:	SEP 10, 1980	DEC 16, 1980	46 FR 61268
3rd Revision:	MAR 16, 1989	JUL 02, 1990	55 FR 27226
4th Revision:	NOV 29, 2001	MAY 07, 2002	67 FR 30594
5th Revision:	AUG 8, 2014	JUN 25, 2018	83 FR 29455
6th Revision:	JUL 18, 2011 AUG 12, 2015 NOV 4, 2016	OCT 31, 2022	87 FR 62034

SECTION II - PARTICULATE MATTER EMISSIONS

A. Allowable Discharge

The allowable discharge of particulate matter resulting from fuel burning operations shall be limited to the values obtained by use of Figure 1 and/or Part B. (For the purpose of determining heat input, total equipment capacity refers to total equipment capacity discharging through each stack. If a boiler has more than one (1) stack the total rated capacity will be the boiler rated capacity discharging to these stacks). Interpolation of Figure 1 for fuel burning operations of 1300 million BTU per hour heat input and larger shall be accomplished by use of the equation:


$$E = 57.84 P^{-0.637}$$

where E = the allowable emission rate in pounds per million BTU heat input,
and P = million BTU heat input per hour

B. Special Provisions

All fuel burning operations of 10 million BTU per hour heat input and smaller constructed prior to February 11, 1971 shall be allowed 0.8 pounds (lbs) per million BTU input.

Figure 1

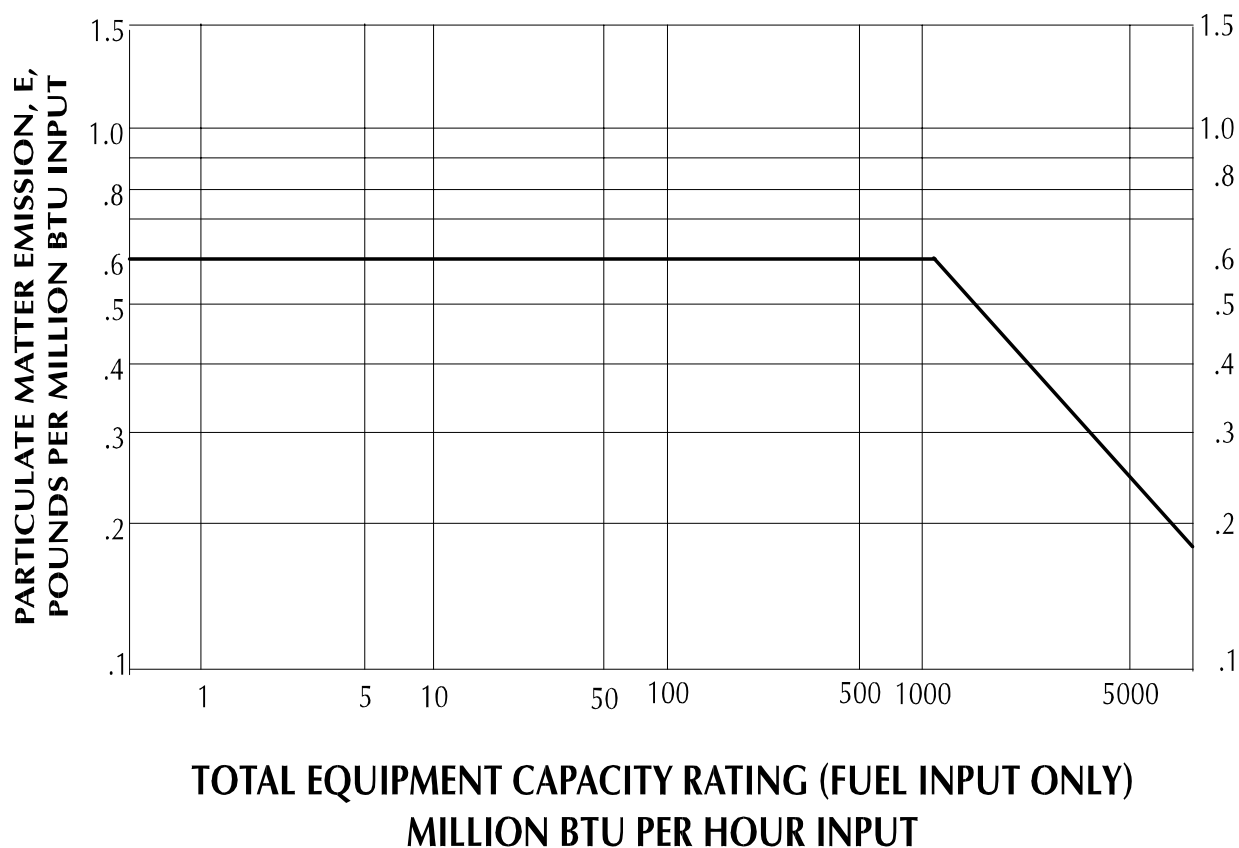

THIS IS THE FEDERALLY APPROVED REGULATION AS OF **JUN 25, 2018**.

	Date Submitted to EPA	Date Approved by EPA	Federal Register
Original Reg:	JAN 21, 1972	MAY 31, 1972	37 FR 10842
1st Revision:	DEC 20, 1978	JAN 29, 1980	45 FR 6572
2nd Revision:	APR 29, 1988	OCT 03, 1989	54 FR 40659
3rd Revision:	AUG 8, 2014	JUN 25, 2018	83 FR 29455

SECTION III - SULFUR DIOXIDE EMISSIONS

The maximum allowable discharge of sulfur dioxide (SO₂) from fuel burning operations shall be 2.3 lbs SO₂ per million Btu input.

THIS IS THE FEDERALLY APPROVED REGULATION AS OF **JUN 25, 2018.**

	Date Submitted to EPA	Date Approved by EPA	Federal Register
Original Reg:	JAN 21, 1972	MAY 31, 1972	37 FR 10842
1st Revision:	DEC 20, 1978	JAN 29, 1980	45 FR 6572
2nd Revision:	MAR 3, 1983	OCT 29, 1984	49 FR 43469
3rd Revision:	AUG 08, 2018	JUN 25, 2018	83 FR 29455

SECTION IV - OPACITY MONITORING REQUIREMENTS

A. Applicable Sources

1. Fossil-Fuel Fired Boilers

The owner or operator of any fossil fuel-fired steam generator of more than 250 million BTU per hour heat input capacity shall install, calibrate, operate, and maintain no later than June 14, 1978, continuous monitoring system(s) for the measurement of opacity which meets the performance specifications of Section IV.D except where:

a. Gaseous fuel is the only fuel burned;

b. Oil or a mixture of gas and oil are the only fuels burned and the steam generator is able to comply with the provisions of Sections I and II of this Standard without utilization of particulate matter collection equipment, and where the steam generator has never been found, through any administrative or judicial proceedings, to be in violation of Section I of this Standard.

c. The steam generator operates with an annual average capacity factor of 30 percent or less, as reported to the Federal Power Commission for calendar year 1974 or otherwise adequately demonstrated to the Department; and has not subsequently increased this factor to more than 30 percent.

2. Woodwaste Boilers

The owner or operator of any woodwaste boiler, not equipped with a wet scrubber, will be required to install, calibrate, operate and maintain continuous monitoring system(s) approved

by the Department for the measurement of opacity, if it meets one or more of the criteria listed in items A.2.a and A.2.b. If a boiler is fired on more than one fuel, the total capacity will determine the applicability.

a. Any woodwaste boiler of at least 100×10^6 BTU/hr. rated heat input.

b. Any woodwaste boiler, regardless of size, that has been operating in noncompliance with any applicable state air pollution control regulations and standards.

B. Continuous Opacity Monitor Reporting Requirements

1. The owner or operator of any fossil fuel-fired steam generator subject to the provisions of Section IV.A shall submit a written Continuous Opacity Monitor report to the Department semi-annually or more often if requested. All semi-annual reports must be postmarked by the 30th day following the end of each calendar semi-annual period. The report shall include, at a minimum, the information in items B.1.a through B.1.c below. A letter shall be sent in lieu of a semi-annual report if no incidences occurred during the reporting period.

The report shall include the following minimum information:

a. All integrated six minute opacity measurements for periods during which the applicable provisions of Section I have been exceeded, together with their nature and cause.

b. For periods of monitoring system malfunction:

(i) The date and time identifying each period during which the monitoring system was inoperative, except for zero and span checks.

(ii) The nature of monitoring system repairs or adjustments.

(iii) Proof of opacity monitoring system performance may be required by the Department whenever repairs or adjustments have been made.

c. Boiler system repairs or adjustments made to correct violations of the provisions of Section I.

2. Alternative data reporting procedures may be allowed if the owner or operator shows, to the satisfaction of the Department, that these procedures are at least as accurate as those described.

3. The owner or operator shall maintain a file of all information contained in the semi-annual reports, calibration data for the opacity monitoring system(s), relevant records of adjustments and maintenance performed on such system(s), and all other data generated by the

continuous opacity monitoring system(s), for a minimum of two years from the date of submission of such reports or collection of such data. The information contained on file must be made available for review by Department personnel upon request.

C. Exemption from Reporting Requirements

A temporary exemption from the opacity monitoring and reporting requirements of Section IV may be granted during any period of monitoring system(s) malfunction, provided the owner or operator shows, to the satisfaction of the Department, that the malfunction was unavoidable and is being repaired as expeditiously as possible.

D. Equipment Performance Specifications

1. The continuous opacity monitoring system(s) required by Section IV.A.1. of this Section (for fossil-fuel fired steam generators) shall conform with the performance specifications set forth in 40 CFR 60, Appendix B, Performance Specification 1, as revised July 1, 1986 which is incorporated by reference as a part of this Standard except that where the term "Administrator" is used the term "Department" shall be substituted. In addition, the opacity monitoring system(s) shall complete a minimum of one (1) cycle of operation for each successive 10-second period, be installed such that representative measurements of opacity from the affected steam generator are obtained, and have an instrument span of approximately 80 percent opacity.

2. The owner or operator shall record the zero and span drift in accordance with the method prescribed by the manufacturer of such opacity monitoring system(s); subject the system(s) to the manufacturer's recommended zero and span check at least once daily unless the manufacturer has recommended adjustments at shorter intervals, in which case such recommendations shall be followed; adjust the zero and span whenever the 24-hour zero drift or 24-hour calibration drift limits of 40 CFR, Part 60, Appendix B, Performance Specification 1, as revised July 1, 1986 are exceeded; adjust the opacity monitoring system(s) purchased prior to September 11, 1974, whenever the 24-hour zero drift or 24-hour calibration drift exceeds 4 percent opacity for those generators constructed prior to February 11, 1971 and 2 percent opacity for those generators constructed after February 11, 1971.

3. The monitoring systems must be approved by the Department prior to installation.

E. Monitor Location

When the effluents from two or more affected steam generators of similar design and operating characteristics are combined before released to the atmosphere, the opacity monitoring system(s) shall be installed on the combined effluent. When the affected steam generators are not of similar design and operating characteristics, or when the effluent from one affected steam generator is released to the atmosphere through more than one (1) point, the owner or operator shall apply for an alternate procedure to comply with the requirements of Section IV.

F. Exemptions from Monitoring Requirements

Whenever the requirements for continuous opacity monitoring cannot be implemented by the owner or operator due to physical source limitations, extreme economic burden, or infrequent steam generator operation of less than 30 days per year, or when the specified monitoring procedure would not provide accurate opacity determinations, alternate monitoring and reporting requirements may be approved on a case-by-case basis provided the owner or operator submits a written request to the Department which includes, but is not limited to:

1. The basis or reason(s) that alternate requirements are necessary;
2. A proposal of the alternate monitoring and reporting requirements; and,
3. Any other information needed by the Department to make a determination that the alternate requirements are adequate to meet the intent of Section IV.

THIS IS THE FEDERALLY APPROVED REGULATION AS OF SEP 18, 2020.

	Date Submitted to EPA	Date Approved by EPA	Federal Register
Original Reg:	DEC 20, 1978	JAN 29, 1980	45 FR 6572
1st Revision:	MAR 3, 1983	OCT 31, 1983	48 FR 50078
2nd Revision:	JUN 05, 1985	OCT 03, 1989	54 FR 40660
3rd Revision:	MAR 16, 1989	JUL 02, 1990	55 FR 27226
4th Revision:	AUG 8, 2014	JUN 25, 2018	83 FR 29455
5th Revision:	NOV 4, 2016	JUN 25, 2018	83 FR 29455
6th Revision:	AUG 8, 2014	SEP 18, 2020	85 FR 58283
7th Revision:	AUG 12, 2015	SEP 18, 2020	85 FR 58283

SECTION V - EXEMPTIONS

The following sources shall be exempt from the provisions of this standard:

- A. Residences of four families or less.
- B. Ocean-going vessels actually engaged in the physical process of national or international trade or defense.

THIS IS THE FEDERALLY APPROVED REGULATION AS OF OCT 3, 1989.

	Date Submitted to EPA	Date Approved by EPA	Federal Register
Original Reg:	DEC 20, 1978	JAN 29, 1980	45 FR 6572

1st Revision: JUN 5, 1985 OCT 3, 1989 54 FR 40659

SECTION VI - PERIODIC TESTING

An owner or operator of any source listed below shall ensure that scheduled periodic tests for particulate matter emissions are conducted every two years or as required by permit conditions and are performed in accordance with the provisions of R.61-62.1, Section IV, Source Tests. An owner or operator shall demonstrate compliance with SO₂ emissions by source testing, continuous monitoring, or fuel analysis as required by permit conditions.

- A. Oil-fired boilers greater than 250 x 10⁶ BTU/hr. rated input.
- B. Coal-fired boilers greater than 50 x 10⁶ BTU/hr. rated input.
- C. Woodwaste, or combination woodwaste boilers greater than 20 x 10⁶ BTU/hr. rated input.

THIS IS THE FEDERALLY APPROVED REGULATION AS OF **JUN 25, 2018.**

	Date Submitted to EPA	Date Approved by EPA	Federal Register
Original Reg:	MAR 3, 1983	OCT 31, 1983	48 FR 50078
1st Revision:	APR 29, 1988	OCT 3, 1989	54 FR 40662
2nd Revision:	SEP 4, 2002	AUG 10, 2004	69 FR 48395
3rd Revision:	AUG 8, 2014	JUN 25, 2018	83 FR 29455